A0

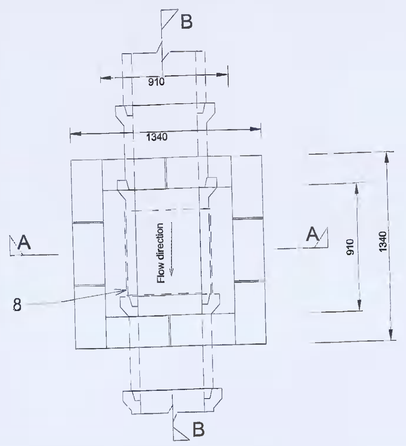

Plan Below Roof Slab

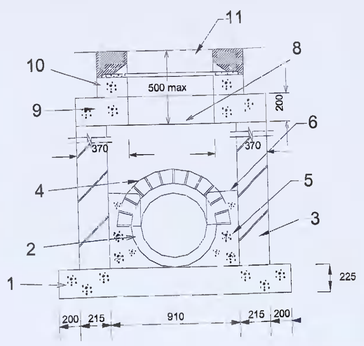

Section A-A

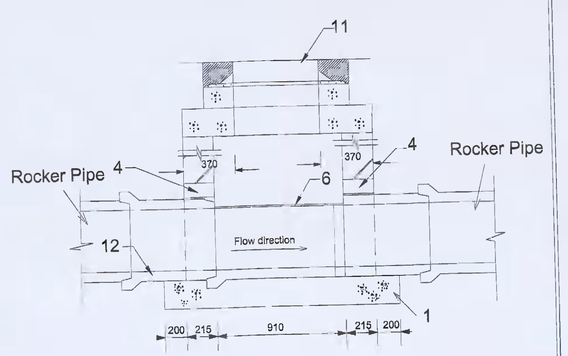

Section B-B

Manhole Details For Pipe Diam's. 150, 225, 300, 375, 450 .
Depth to Invert Less than 1.0m.

Greater Dublin Regional Code of Practice for Drainage Works			
Project:	STANDARD MANHOLE DETAILS		
Title:	TYPE A MANHOLE		
Drawn: JOM	Checked:	Approved:	
Date: FEB 2000	Scale: NOT TO SCALE	Drawing No.: 212701	
Revision:		Made by: ROD	Date: 13/11/02

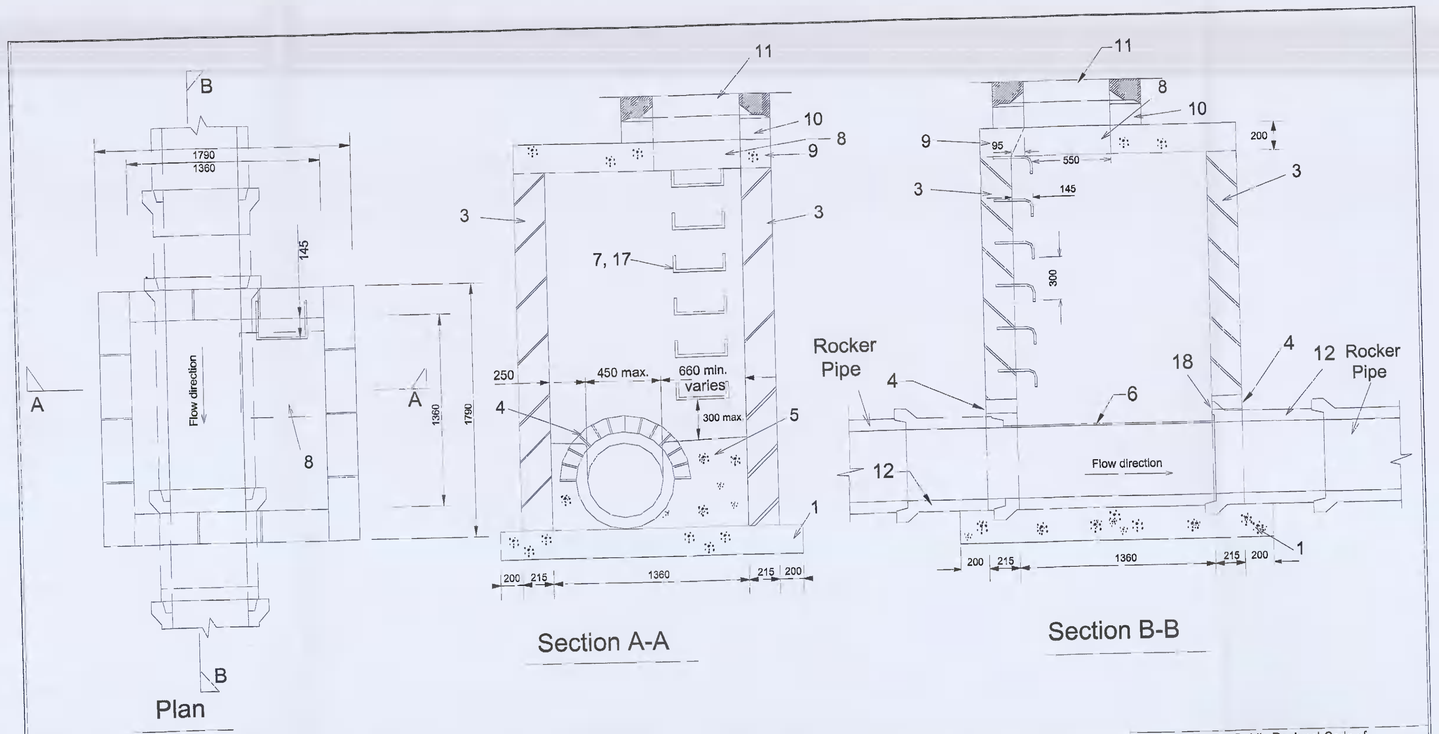

Manhole Details For Pipe Diam's. 225, 300, 375, 450.
Depth to Invert 1m to 3m.

Greater Dublin Regional Code of Practice for Drainage Works			
Project:	STANDARD MANHOLE DETAILS		
Title:	TYPE B MANHOLE		
Drawn: JOM	Checked:	Approved:	
Date: FEB 2000	Scale: NOT TO SCALE	Drawing No.: 212702	
Revision:		Made by: ROD	Date: 13/11/02

Drawing Notes:

1) 225mm thick Cl. 20N/20mm Mass Concrete Foundations.

2) Preformed half circle channel pipes. The pipeline may, where practicable, be laid through the manhole and the crown cut out to half diameter, provided flexible joints are situated on each side no further than 600mm from the inner face of manhole wall.

3) Manhole construction.
- For Surface Water Manholes High-density blocks to Cl.S10 of IS.20 Part 1:1997 or Cl. 30N/20mm Insitu concrete.
- Block work shall be bedded and jointed using mortar to I5408. Beds and vertical joints shall be completely filled with mortar as the blocks are laid.
- Joints shall be flush pointed as the work proceeds.
- All Foul Manholes must be faced in solid Engineering Brick (min. class A or B), or insitu concrete for 1 metre above Benching Level.
- Brick to be bonded to block work using English Garden Wall Bond.

4) Relieving arch formed by 215x102x65 solid engineering brick Class A or B as per drawing.
Relieving arches used in brick or block work manholes extend over full thickness of wall.
A Double Arch is to be formed for pipe diameters greater than 600mm.

5) Benching and pipe channel pipe surround - Cl. 20/20 concrete.

6) Benching finished in 2:1 sand-cement mortar with a smooth trowel finish, at 1 in 30 slope towards channel.

7) Standard rungs at 300c/c vertically and galvanized to the latest version of B.S. 729 or equivalent. Note: Steps irons are not acceptable.

8) 600mm square ope in roof slab.

9) Precast R.C. Roof Slab shall be 200mm thick in Class 30N/20mm, with 40mm cover to steel.

10) 1 to 2 courses of solid engineering bricks Cl.B to I.S.91:1993 set in 1:3 (cement and mortar).

11) Class D400 or E600 manhole cover and frame to IS/EN 124. 150mm deep frame for roads and 100mm deep for footpaths and green areas. Non-rock design, closed keyways. manufactured from spheroidal graphite cast iron (ductile cast iron), 600 x 600 (600diam.) clear opening, cover and frame coated in bitumen or other approved material, cover to have a minimum mass of 145kg/m2, frame bearing area shall be 80,000mm2 min. frames shall be designed to prevent covers falling into manhole. Frames shall be bedded on approved mortar to manufacturers instructions.

12) Short length pipe and pipe joint external to manhole shall not exceed 600mm from the inner face of manhole wall.

13) Toe holes of 230mm minimum depth and galvanized steel safety railings to be provided in benching of sewers greater than 525mm diameter and depth to invert >3m for access to invert.

14) A safety chain is to be provided on pipes that exceed 450mm in diameter. Mild safety chain shall be 10mm nominal size grade M(H) non-calibrated chain, type 1, complying with B.S.4942 Part 2 or equivalent.

15) When depth of manholes to invert is greater than 3.0m ladders shall be used instead of rungs to B.S.4211 or equivalent except that stringers should be not less than 65 x 12mm in section and rungs 25mm in diameter.
Fixed ladders should meet the dimensional requirements of B.S.4211 or equivalent.

16) Ladder stringers should be adequately supported from the manhole wall at intervals of not more than 2.0m stringers should be bolted to cleats to facilitate renewal.

17) All ladders, rungs, handrails, safety chains etc shall be hot dip galvanized to B.S.729 or equivalent.

18) Pipe should be cut flush with the inside surface of the manhole wall so that the channel extends the full length of the manhole (except for precast manholes).

19) Position of 610 square ope in intermediate roof slab.

20) For manholes >3m depth to Invert use 30N/20mm insitu concrete. Reinforcing mesh ref. A393 @ 6.16kg/m to be fixed at mid point of wall. Additional reinforcement to be supplied over pipe crown.

21) For Pre cast Manholes, Chamber walls and cover slab to be constructed to IS EN 1917 and IS 420 2004

22) Manhole Openings to be situated furthest from the nearest Carriageway. Manhole steps / access to be positioned to allow viewing of oncoming traffic.

23) For bedding and sealing of Chamber rings, the top ring (to Pre cast cover slab) and bottom ring to be bedded with cement mortar. For intermediate rings, joints to be sealed with approved pre-formed jointing strip.

24) Pre cast Manholes to be surrounded with a minimum of 150mm thick Grade C20/40 concrete

General Notes

i) All brick to be Solid Engineering Brick Class A or B.

ii) For pipe diameter >750mm use manhole with internal diameter size = pipe size + 1metre + 300mm.

iii) Distance from the top rung of the ladder to ground level must be a maximum of 500mm.

Manhole Details For Pipe Diam's. 225, 300, 375, 450.
Depth to Invert 3m. to 6m.

Greater Dublin Regional Code of Practice for Drainage Works			
Project:	STANDARD MANHOLE DETAILS		
Title:	TYPE C MANHOLE		
Drawn: JOM	Checked:	Approved:	
Date: FEB 2000	Scale: NOT TO SCALE	Drawing No.: 212703	
Revision:		Made by: ROD	Date: 13/11/02

Manhole Details For Pipe Diam's. 525, 600, 675 & 750mm
Depth to Invert 1.0m to 3m.

Greater Dublin Regional Code of Practice for Drainage Works			
Project:	STANDARD MANHOLE DETAILS		
Title:	TYPE D MANHOLE		
Drawn: JOM	Checked:	Approved:	
Date: FEB 2000	Scale: NOT TO SCALE	Drawing No.: 212704	
Revision:		Made by: ROD	Date: 13/11/02

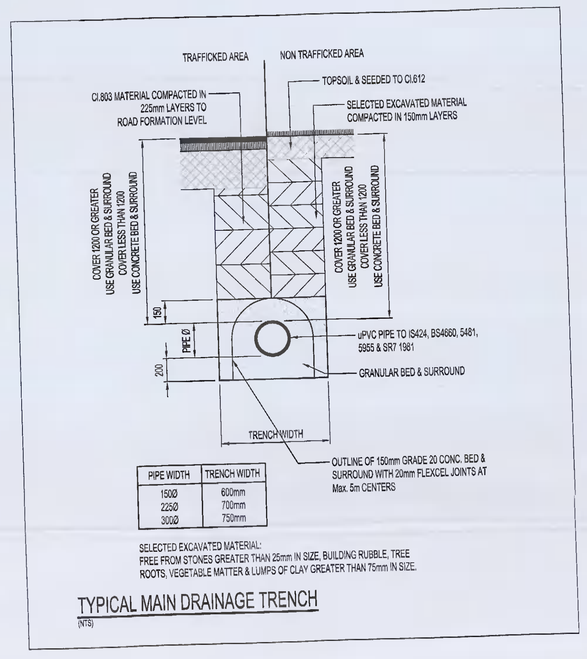

PIPE WIDTH	TRENCH WIDTH
150/3	600mm
225/3	700mm
300/3	750mm

TYPICAL MAIN DRAINAGE TRENCH
(NTS)

Mark	Date	By	Ch	Apr.	Revision
PL1	04/02/21	ED	-	PK	ISSUED FOR PLANNING

Job Title: WAREHOUSE DEVELOPMENT AT BROWINSBARN, CITYWEST CAMPUS, DUBLIN 24	Drawing Title: SW MANHOLES, GULLIES, HYDROBRAKE MH, HEADWALL, AND BACKDROP DETAILS 1 OF 3
Architect/Client: Exeter Ireland Property IV B Limited	Drawing Status: PLANNING

Drawn: ED	
Checked: -	
Approved: PK	
Scale: NTS	
Date: February 2021	

KAVANAGH BURKE
CONSULTING ENGINEERS
Tel. 01 - 450 0694
Fax. 01 - 456 4340
Email: pkavanagh@kavanaghburke.ie
Unit G3, Calmount Pk. Ballymount, Dublin 12.

Job No.	Drawing No.	Rev.
D1678	D7-1	PL1