


- Notes:**
- Proposed drainage to be coordinated with existing underground services.
 - This drawing is to be read in conjunction with all other relevant engineers, architects and sub-contractors drawings and details.
 - All drainage piping is within the influence line of structural loads will use ductile iron piping or will be provided with concrete bed and surround to detail IE-DUBZZ-STE1-EO-ARP-DR-C-0113.

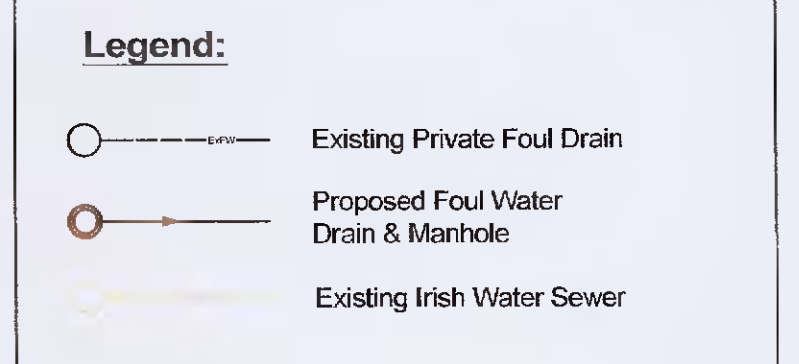

C01	28/07/21	CDS	CDS	JMAC
Issued for Planning				
Rev	Date	By	Chkd	Appd

ARUP
 Arup, 50 Ringwood Road
 Dublin, D04 T9X0
 www.arup.ie
 Tel +353(0)1 233 4488 Fax +353(0)1 668 3169

Client
Digital Netherlands VIII B.V.
 (Netherlands)

Project Title
INXN DUB15/16

Drawing Title
Proposed Foul Water Layout

Scale at A1	1:500
Role	Civil
Suitability	Planning
Arup Job No	280503-00
Rev	C01
Name	IE-DUBZZ-STE1-EO-ARP-DR-C-0110