



**Trench Detail (Sprinkler)**  
Scale: 1:10


• If minimum cover cannot be achieved a foam concrete bed and surround is to be installed.

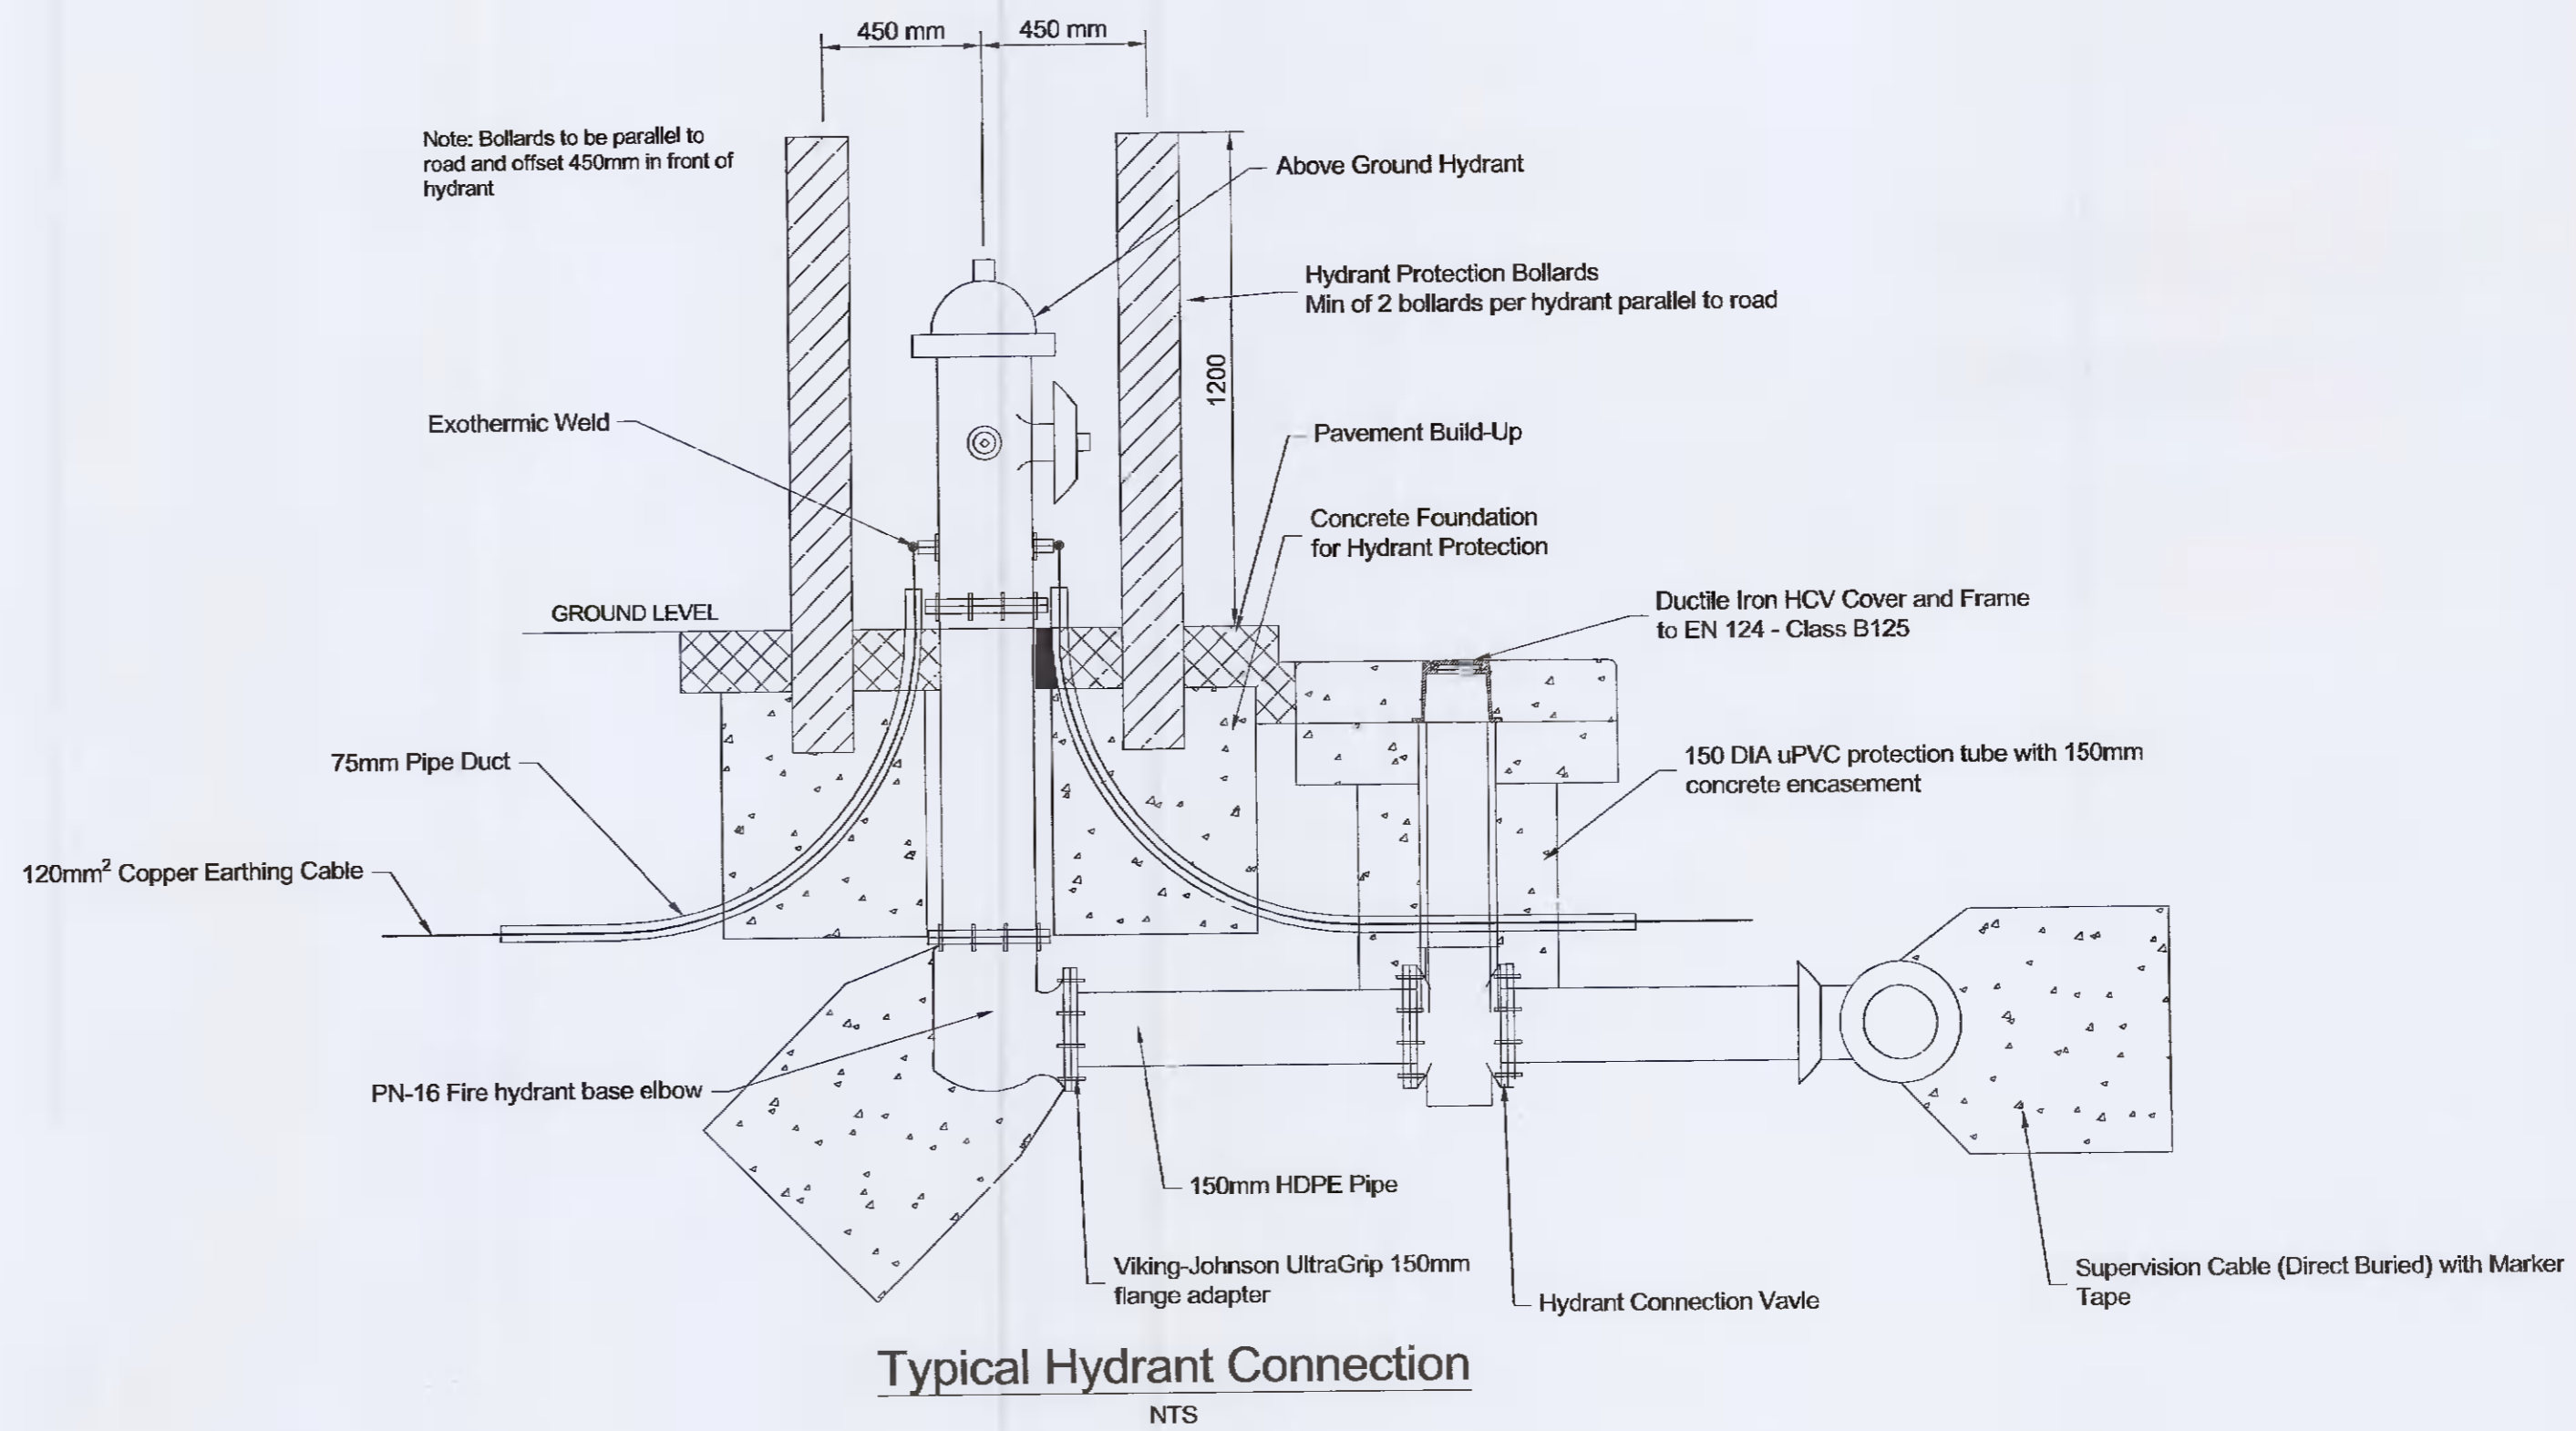

**Typical Hydrant Connection**  
NTS

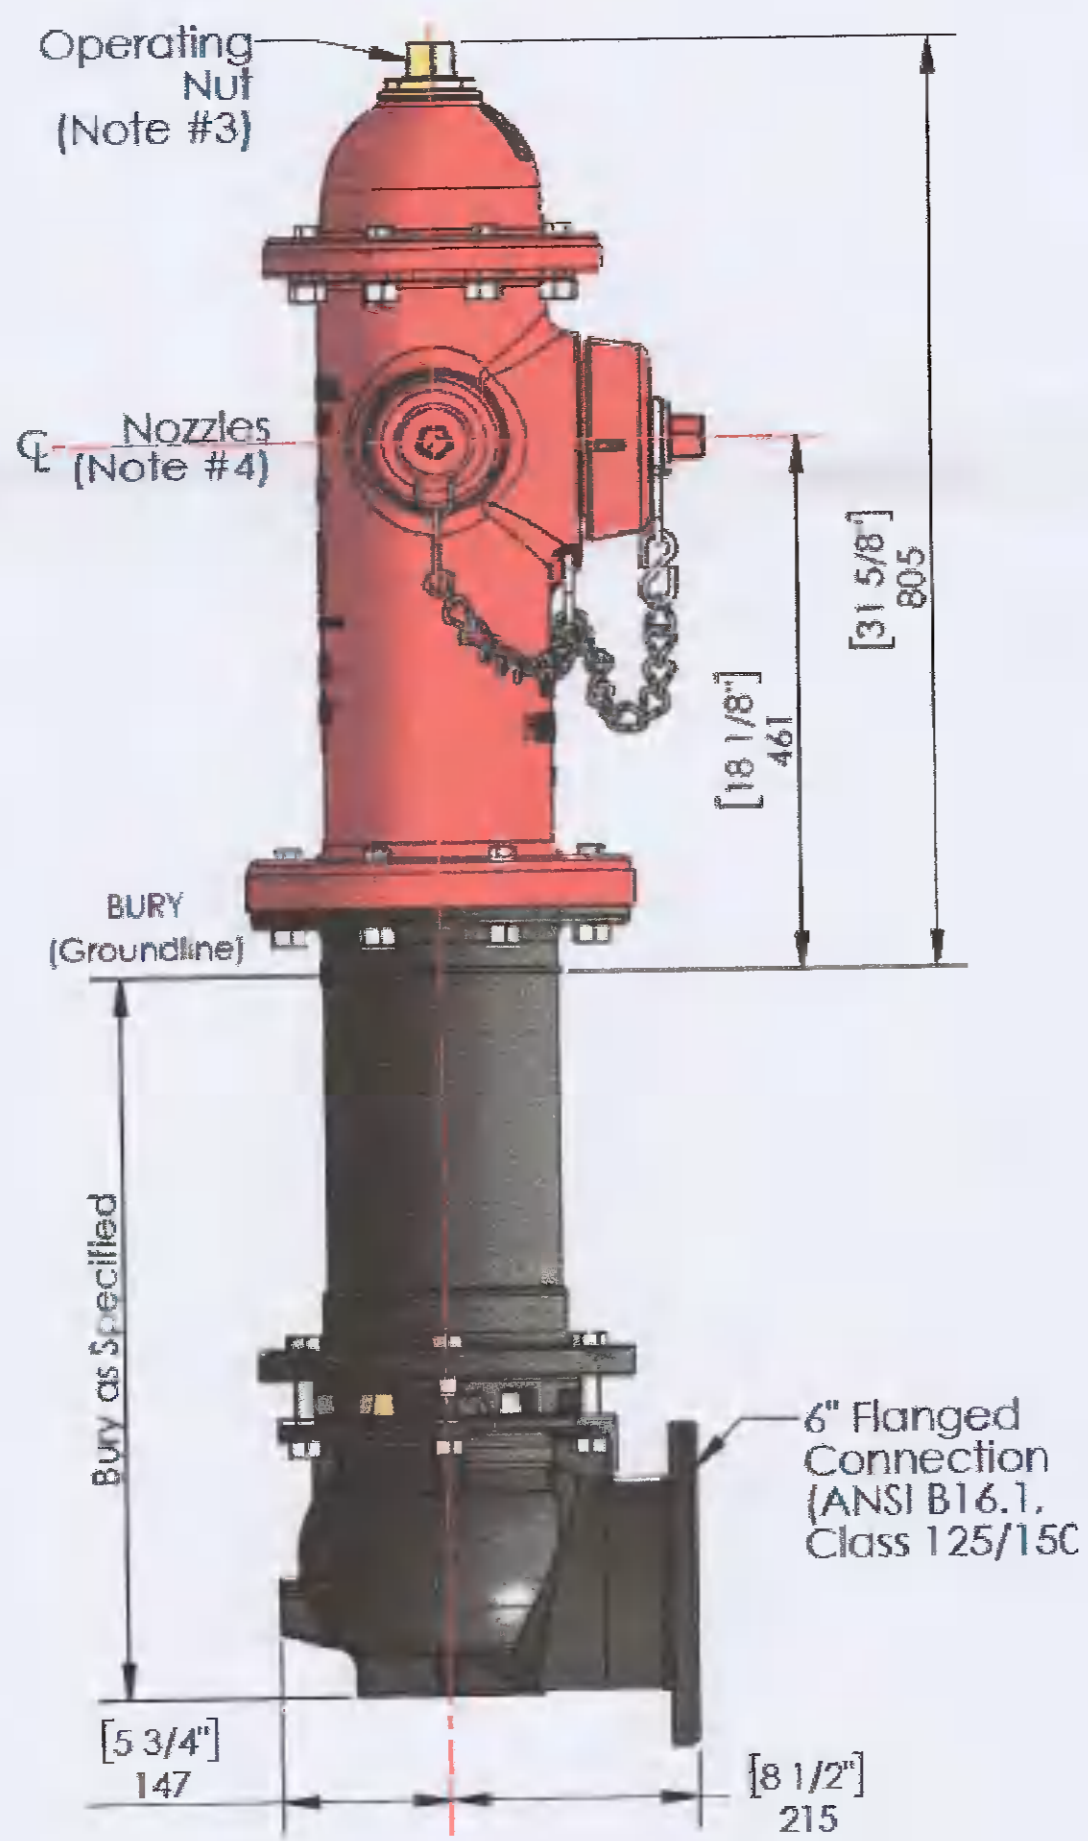

**WEFLO Hydrant Detail**  
NTS

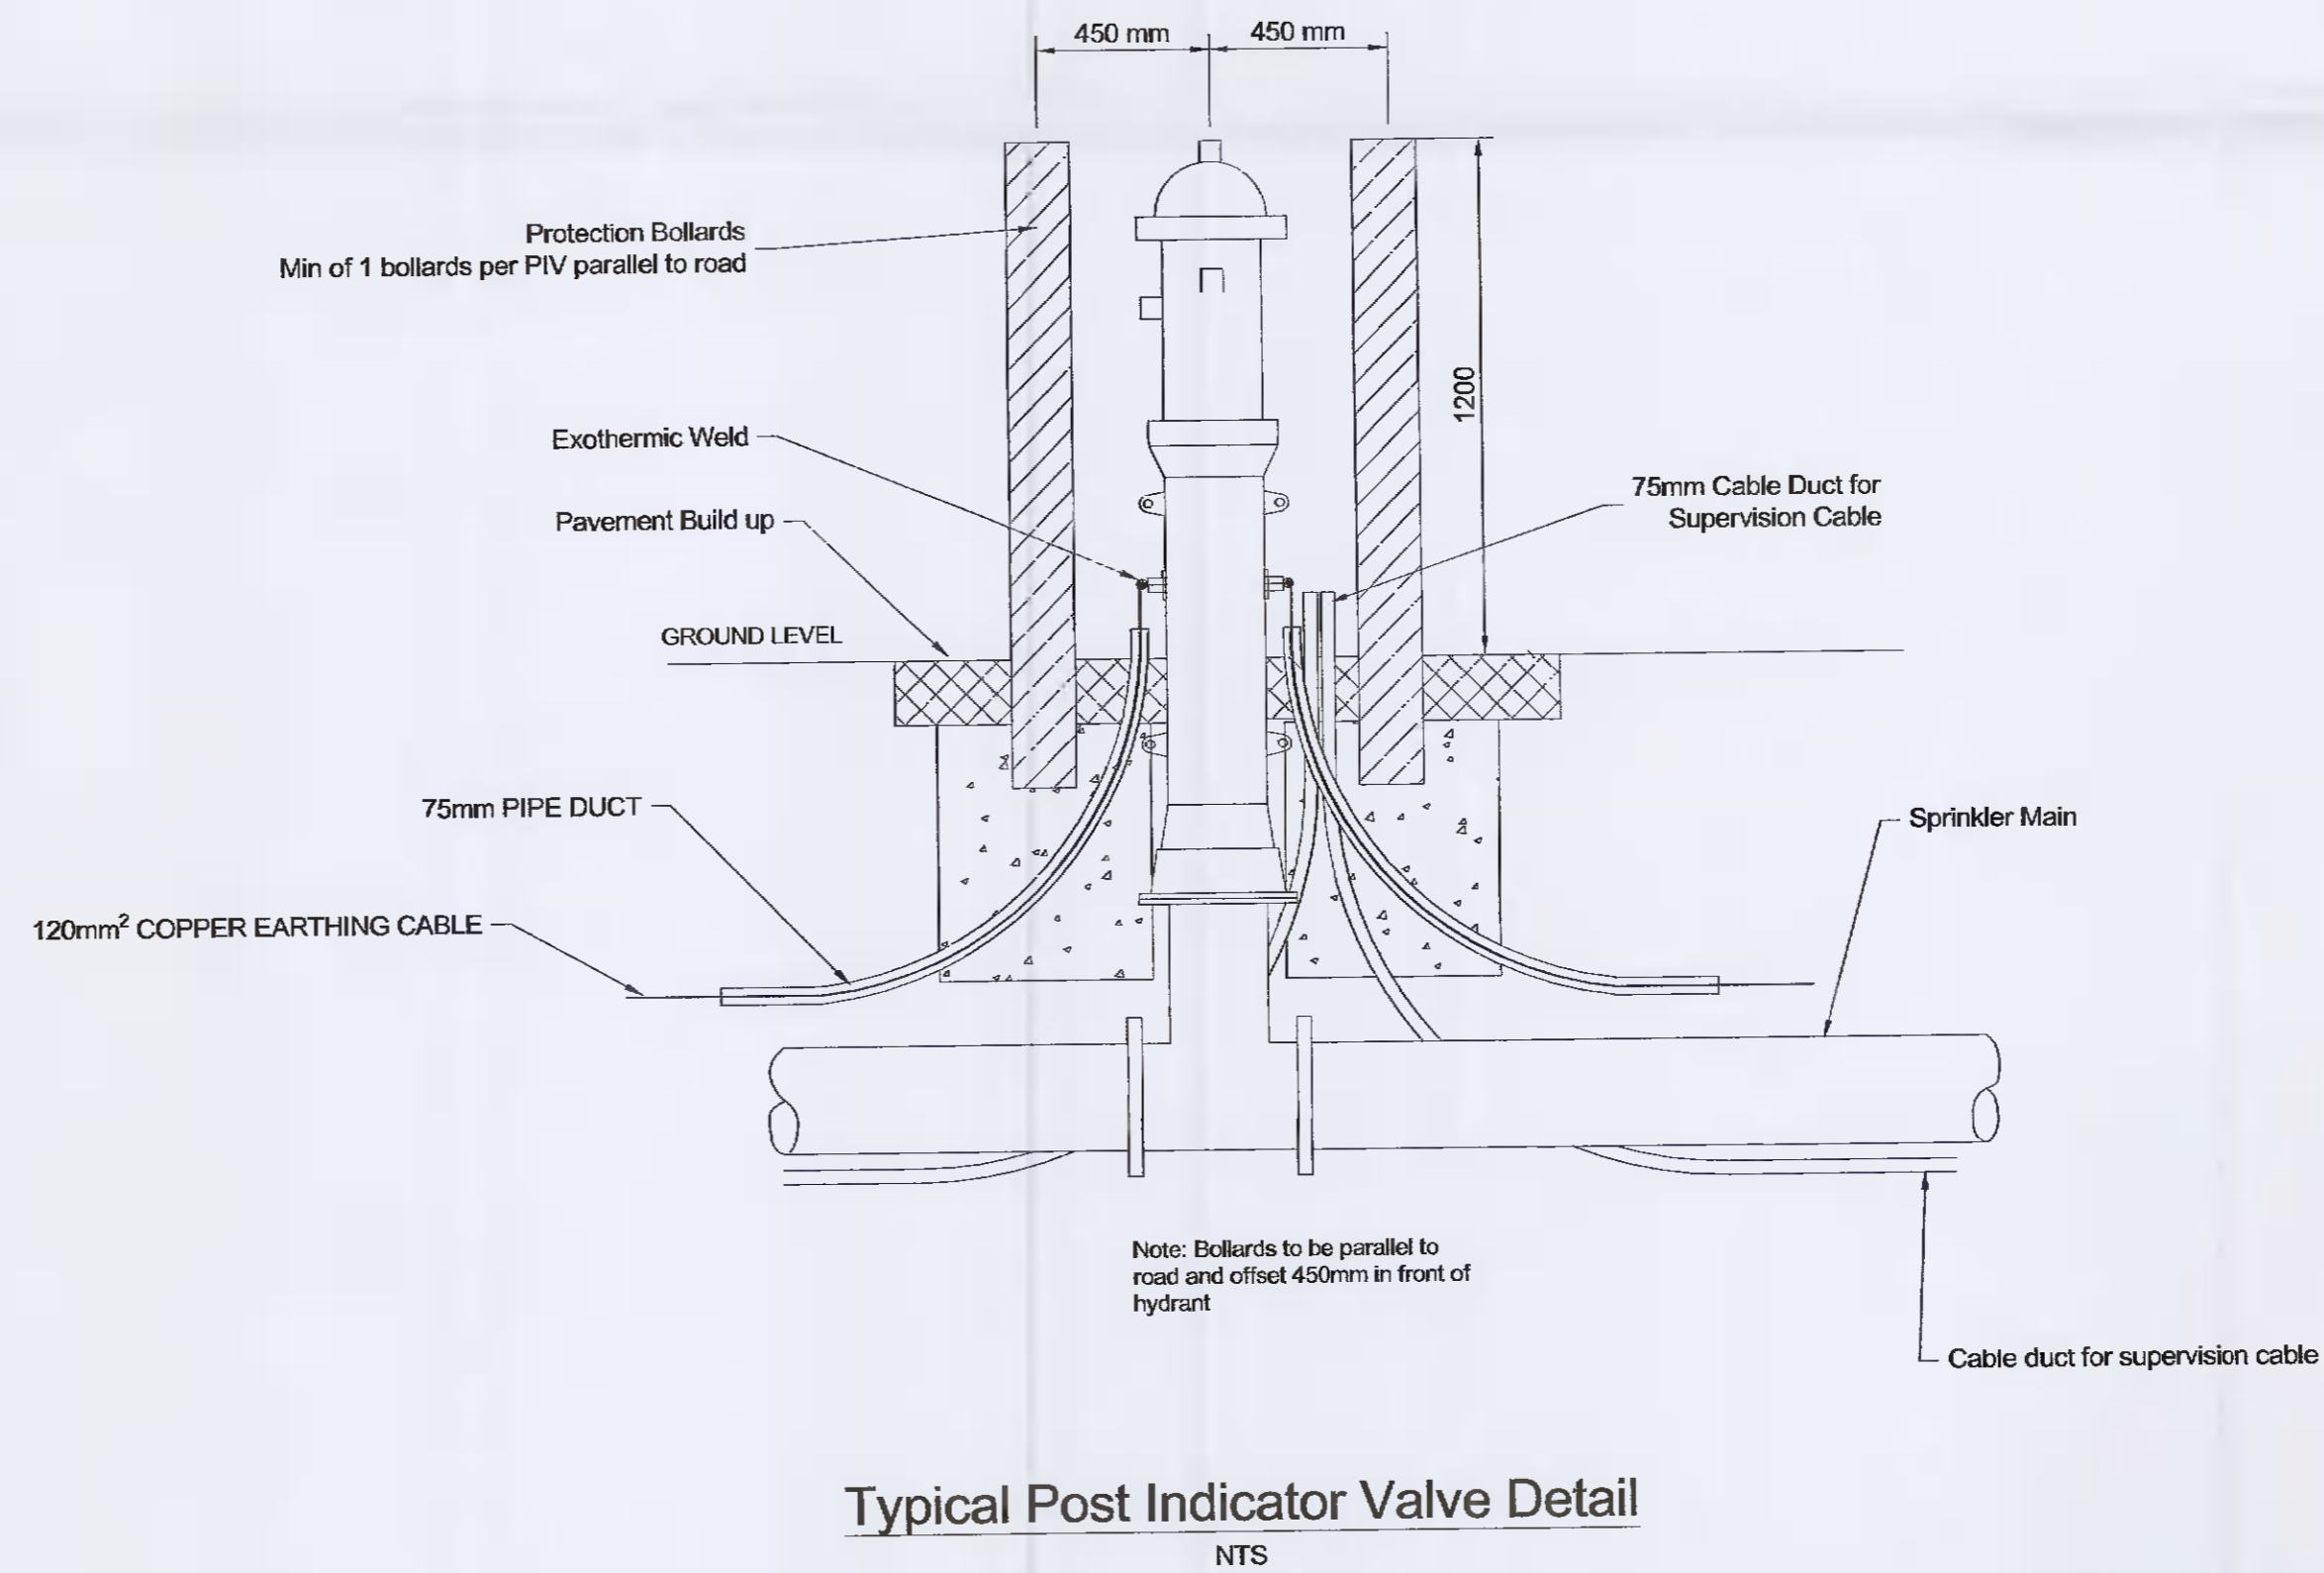

**Typical Post Indicator Valve Detail**  
NTS

CD1	16/07/21	DF	CDS	JMAC
Issued for Planning				
Rev	Date	By	Chkd	Appd

**ARUP**

Arup, 50 Ringsend Road  
Dublin, D04 T6X0  
www.arup.ie  
Tel +353(0)1 233 4166 Fax +353(0)1 666 3160

Client  
Digital Netherlands VIII B.V.  
(Netherlands)

Project Title  
INXN DUB15/16

Drawing Title  
Standard Details Sheet 8 of 11

Scale at A1	As Shown
Role	Civil
Suitability	Planning
Arup Job No	Rev
280503-00	C01
Name	
IE-DUBZZ-STE1-EO-ARP-DR-C-0119	