

Brendan English

Unit F1, Centrepoint Park  
Oak Road  
Dublin 12  
Co. Dublin  
D12P308

Uisce Éireann  
Bosca OP 448  
Oifig Sheachadta na  
Cathrach Thosa  
Cathair Chorcaí

Irish Water  
PO Box 448  
South City  
Delivery Office  
Cork City

[www.water.ie](http://www.water.ie)

12 October 2021

**Re: CDS21006460 pre-connection enquiry - Subject to contract | Contract denied**

**Connection for Single Domestic of 1 unit(s) at Palmyra, Whitechurch Road, Rathfarnham, Dublin 16**

Dear Sir/Madam,

Irish Water has reviewed your pre-connection enquiry in relation to a Wastewater connection at Palmyra, Whitechurch Road, Rathfarnham, Dublin 16 (**the Premises**). Based upon the details you have provided with your pre-connection enquiry and on our desk top analysis of the capacity currently available in the Irish Water network(s) as assessed by Irish Water, we wish to advise you that your proposed connection to the Irish Water network(s) can be facilitated at this moment in time.


SERVICE	<p style="text-align: center;"><b>OUTCOME OF PRE-CONNECTION ENQUIRY</b></p> <p style="text-align: center;"><b><u>THIS IS NOT A CONNECTION OFFER. YOU MUST APPLY FOR A CONNECTION(S) TO THE IRISH WATER NETWORK(S) IF YOU WISH TO PROCEED.</u></b></p>
Water Connection	N/A
Wastewater Connection	Feasible without infrastructure upgrade by Irish Water
<b>SITE SPECIFIC COMMENTS</b>	
Water Connection	N/A
Wastewater Connection	<p>There is a 225mm gravity sewer approx. 26m from the subject site as per mapping submitted by the applicant.</p> <p>The elevation levels of the foul sewer and subject site are to be verified by the applicant to ensure that a gravity connection can be carried out.</p> <p>It is the responsibility of the applicant to obtain all relevant permissions required to connect to the IW network through third party lands prior to the connection works taking place.</p> <p>The proposed wastewater connection is connecting to Irish Water infrastructure through third party infrastructure not owned by Irish Water.</p>

Prior to connection the customer is to provide a letter to Irish Water from the third party owner confirming the following:

- (a) The customer has permission to connect to the third party infrastructure
- (b) The third party infrastructure has sufficient capacity to cater for the additional load
- (c) The third party infrastructure is of sufficient integrity to take the connection and the additional load

The design and construction of the Wastewater pipes and related infrastructure to be installed in this development shall comply with the Irish Water Connections and Developer Services Standard Details and Codes of Practice that are available on the Irish Water website. Irish Water reserves the right to supplement these requirements with Codes of Practice and these will be issued with the connection agreement.

The map included below outlines the current Irish Water infrastructure adjacent to your site:

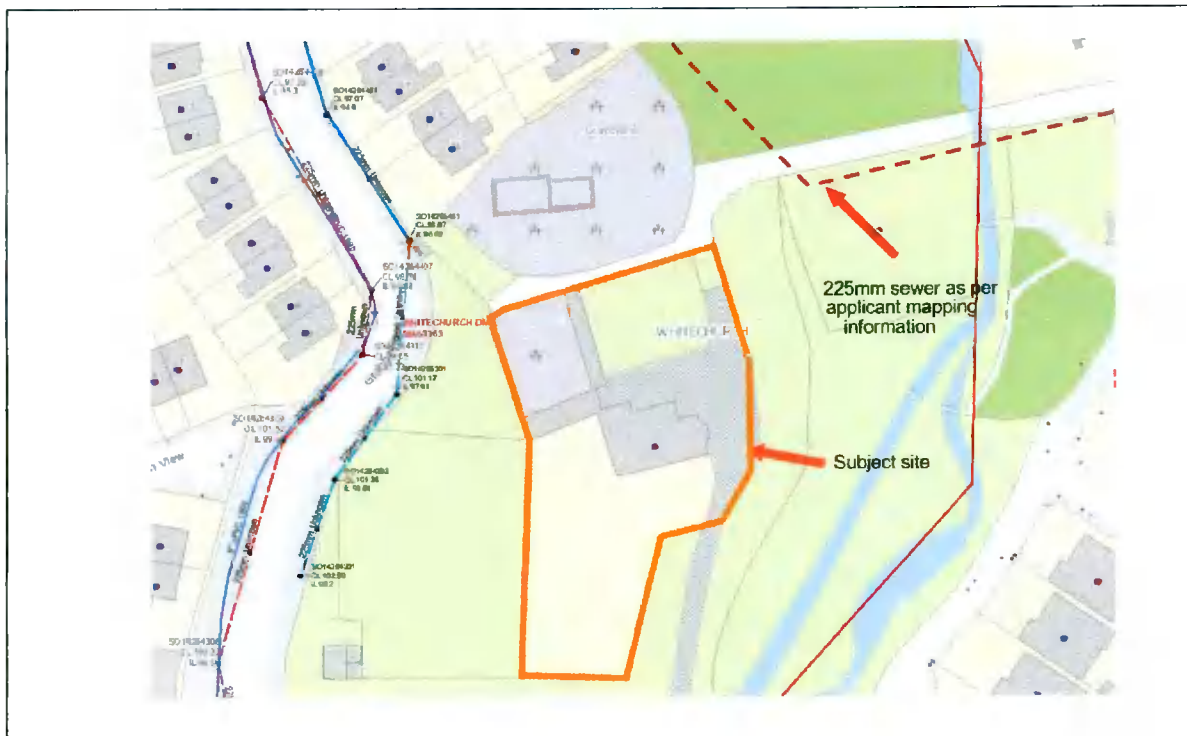

Reproduced from the Ordnance Survey of Ireland by Permission of the Government. License No. 3-3-34

Whilst every care has been taken in its compilation Irish Water gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Irish Water. Irish Water can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Irish Water underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Irish Water underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.

**General Notes:**

- 1) The initial assessment referred to above is carried out taking into account water demand and wastewater discharge volumes and infrastructure details on the date of the assessment. **The availability of capacity may change at any date after this assessment.**
- 2) This feedback does not constitute a contract in whole or in part to provide a connection to any Irish Water infrastructure. All feasibility assessments are subject to the constraints of the Irish Water Capital Investment Plan.
- 3) The feedback provided is subject to a Connection Agreement/contract being signed at a later date.
- 4) A Connection Agreement will be required to commencing the connection works associated with the enquiry this can be applied for at <https://www.water.ie/connections/get-connected/>
- 5) A Connection Agreement cannot be issued until all statutory approvals are successfully in place.
- 6) Irish Water Connection Policy/ Charges can be found at <https://www.water.ie/connections/information/connection-charges/>
- 7) Please note the Confirmation of Feasibility does not extend to your fire flow requirements.
- 8) Irish Water is not responsible for the management or disposal of storm water or ground waters. You are advised to contact the relevant Local Authority to discuss the management or disposal of proposed storm water or ground water discharges
- 9) To access Irish Water Maps email [datarequests@water.ie](mailto:datarequests@water.ie)
- 10) All works to the Irish Water infrastructure, including works in the Public Space, shall have to be carried out by Irish Water.

If you have any further questions, please contact Kevin McManmon from the design team at [kmcmanmon@water.ie](mailto:kmcmanmon@water.ie) For further information, visit [www.water.ie/connections](http://www.water.ie/connections).

Yours sincerely,



**Yvonne Harris**

**Head of Customer Operations**