

01 Ground Floor Plan
NTS

Red circles on plan denote location of detail

The existing harling is thought to be a cement-based harling - it is not original. The proposal is to remove this harling as it will be damaging to the masonry substrate and will be preventing excess moisture from escaping from the wall.


New lime-based harling will be re-applied in a traditional 3-layer process.

1st layer - tack coat (4mm thick)
 2nd layer - dubbing out & straightening coat (10mm thick)
 3rd layer - finish & harling coat (10mm thick)

This results in a total thickness of 25mm. The proposed glazing to the entrance lobby and glazed link is to be set against the existing masonry and the new render applied up to the aluminium clamp of the glazing unit. This way, the existing stone is not damaged.


Notes
 Copyright and not to be reproduced without the consent of Holmes Miller. Holmes Miller accepts responsibility for this document only to the commissioning Party and not to any other. Holmes Miller does not accept liability for accuracy or veracity of survey information provided by others and horizontal dimensions and levels provided by Holmes Miller and based on survey information provided by others must be verified on site.
 DO NOT SCALE. Use figured dimensions only.

Masonry Construction
 Refer to F30 specification (which includes SE input) together with SE drawings and specifications for full details of wall ties, supports, restrains and similar.

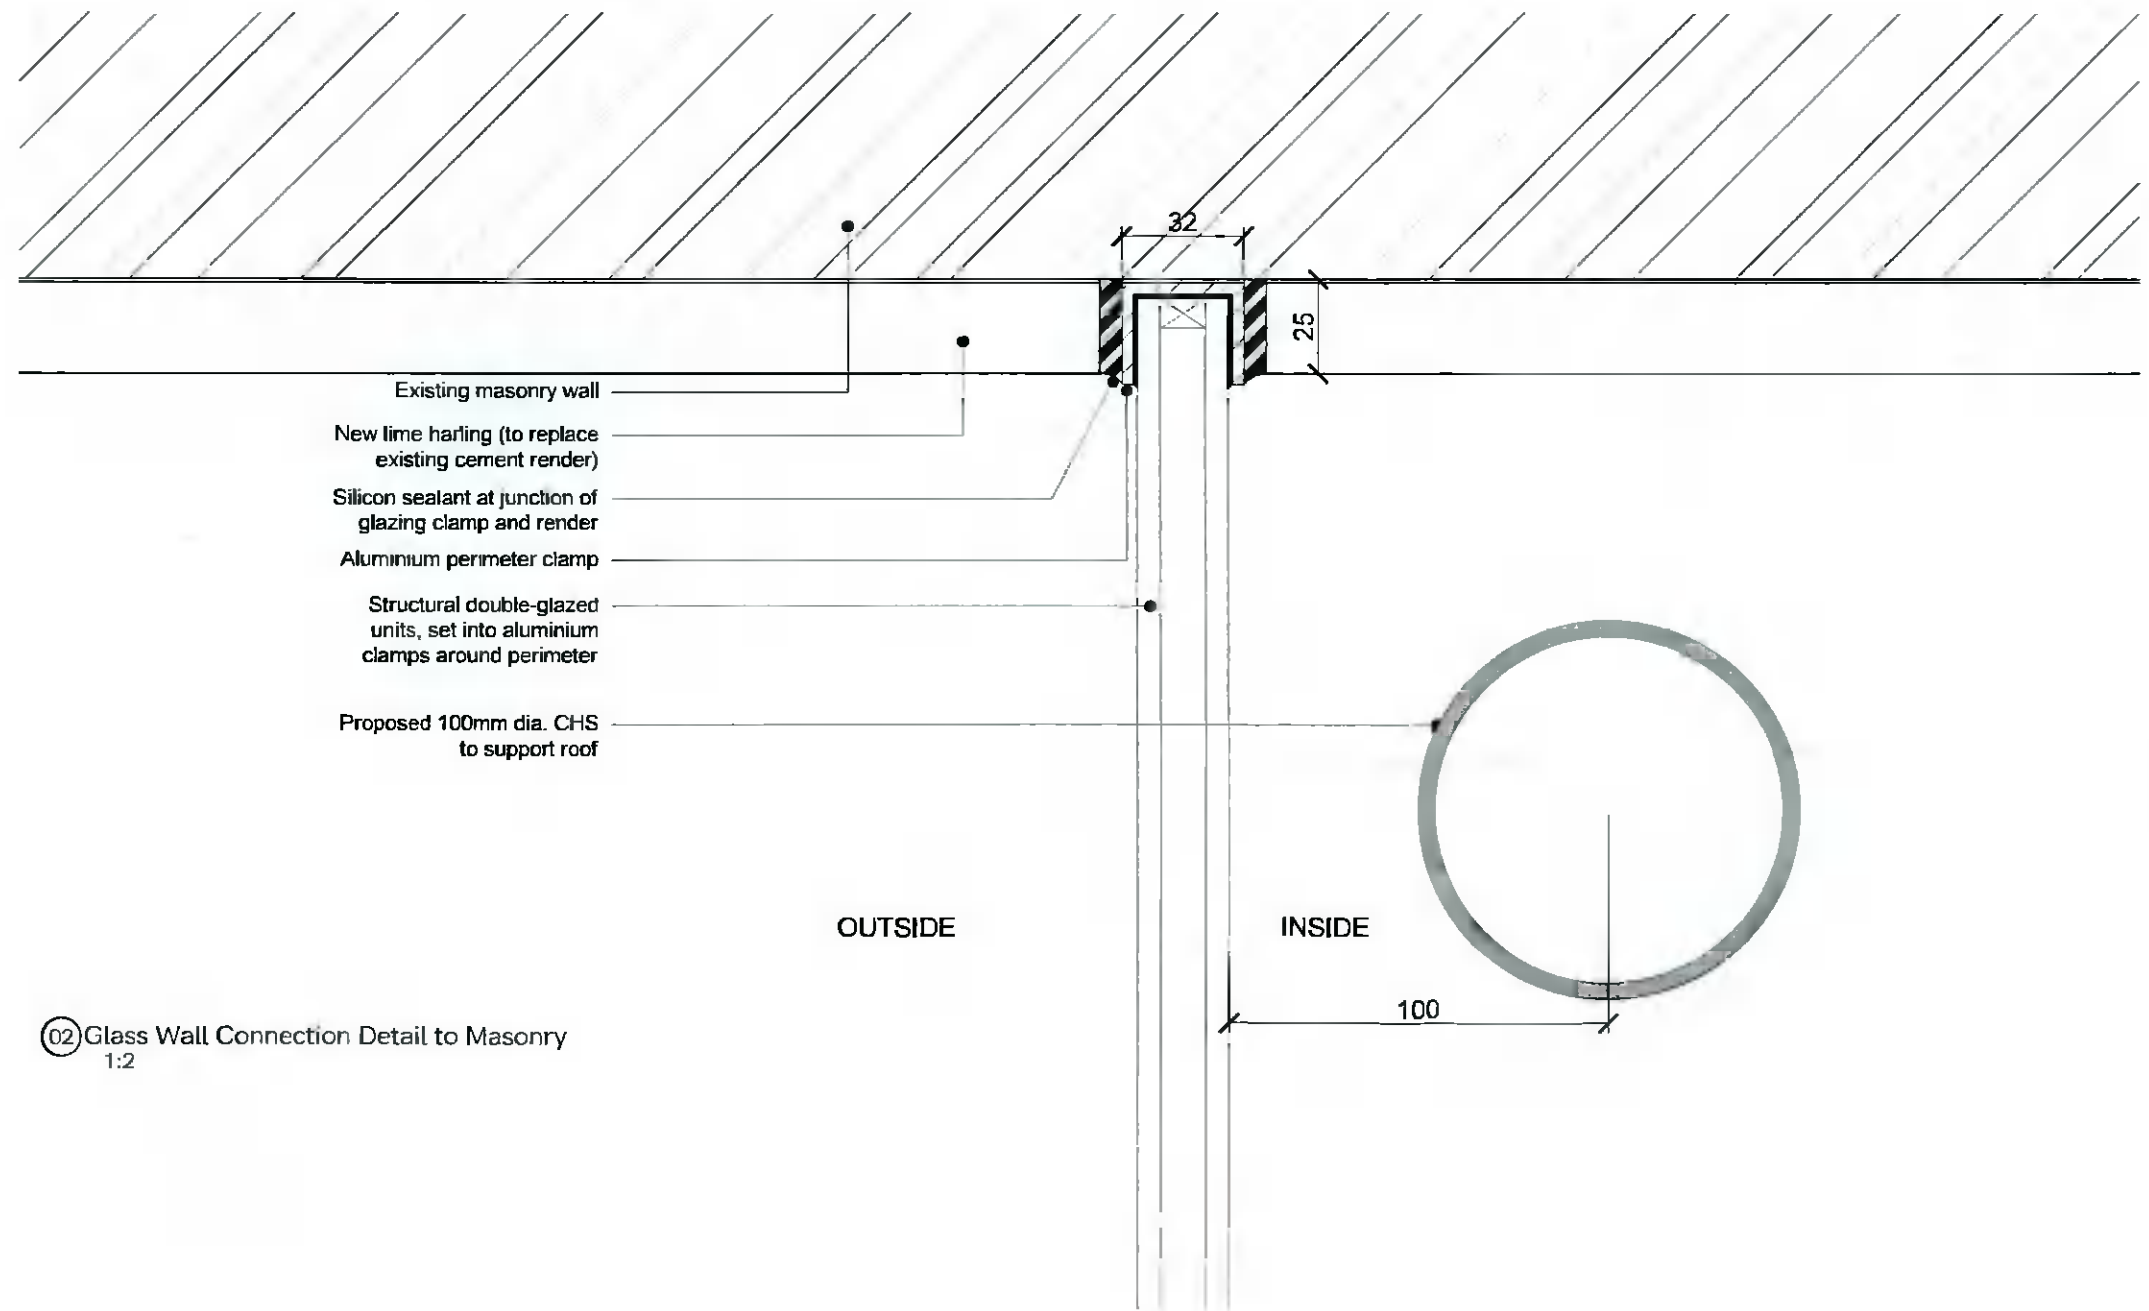

02 Glass Wall Connection Detail to Masonry
1:2

03 F30 Appendix 30 03 10.12.21
 Rev Notes Drawn Appr Date

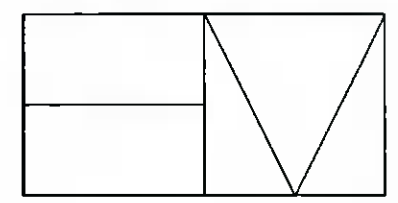

Holmes Miller
 89 Minerva Street
 Glasgow
 G3 6LE
 0141 204 2080
 www.holmesmiller.com

Project 4801
Newbrook House Luxury Suites

Drawing Name
 Detail of Glazing Connection to Existing House

Scale @A3	Checked	Revision
1:2	DJ	P01

Drawing Number
 4801-HML-ZZ-XX-DR-A-22001