


016

THIS DRAWING IS COPYRIGHT © ALL RIGHTS RESERVED. NO PART OF THIS DRAWING MAY BE REPRODUCED, STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT THE PRIOR WRITTEN PERMISSION FROM MCELLIGOTT CONSULTING ENGINEERS LIMITED.

NOTES

01. DO NOT SCALE. USE FIGURED DIMENSIONS ONLY.
02. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS.
03. FINAL LOCATION OF MINIPILLARS & DUCTS TO BE AGREED WITH ESB SUPERVISOR PRIOR TO INSTALLATION.
04. PROVIDE FOR ESB METER CABINET, INTERNAL METER & BRACKETS, SURGE PROTECTION & CABLE TO PUMPING STATION CONTROL PANEL.
05. REFER TO ESB PUBLICATION ELECTRICAL SERVICES GUIDE BOOK FOR HOUSING SCHEMES FOR ALL INSTALLATION DETAILS.
06. THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH THE NATIONAL CODE OF PRACTICE FOR CUSTOMER INTERFACE ISSUED BY ESB.
07. THIS PROPOSAL IS SUBJECT TO APPROVAL FROM THE LOCAL AUTHORITY & PLANNING PERMISSION.
08. ALL PUBLIC LIGHTING COLUMNS MUST BE A MINIMUM OF 800mm AWAY FROM THE KERB EDGE.
09. ALL PUBLIC LIGHTING COLUMNS TO BE A MINIMUM OF 7M AWAY FROM ANY TREES (TREES WILL BE RELOCATED IF ANY CLASHES OCCUR).
10. WHERE ACCESS TO LIGHTING COLUMNS IS OBSTRUCTED BY PATHWAYS ETC A RAISE & LOWER TYPE COLUMN SHOULD BE USED.
11. THIS IS NOT AN APPROVED PUBLIC LIGHTING DESIGN DRAWING INFORMATION ONLY.
12. LOCATION OF LIGHTING PILLARS TO BE CONFIRMED ON RECEIPT OF ESB DESIGN DRAWING.

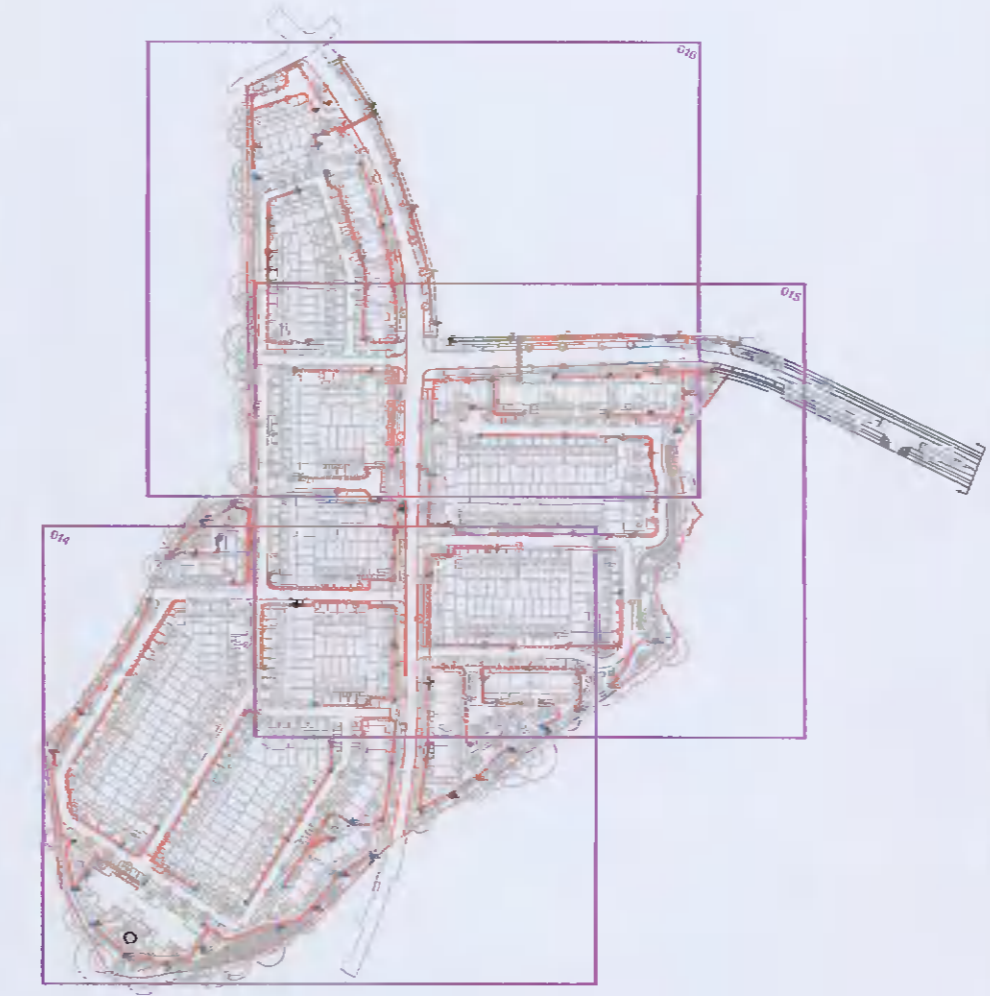

KEY PLAN

THIS IS NOT AN APPROVED PUBLIC LIGHTING DESIGN INFORMATION ONLY

LEGEND

- LIGHTING MICRO PILLAR (LOCATION AT LEAST 2 METERS FROM ESB PILLAR)
- 2 x 6sq NYCY CABLE LAID IN 100mm PVC DUCT TO ET211:2003. SINGLE WALL DUCTING, COLOUR RED TO BE USED MANUFACTURED FROM HIGH DENSITY POLYETHYLENE (H.D.P.E.), 107mm EXTERNAL DIAMETER, HAVING A WALL THICKNESS OF 5mm. THIS DUCTING TO HAVE THE WORDS "STREET LIGHTING" STAMPED ON, IN TRENCH. ALL WORKS TO LOCAL AUTHORITY SPECIFICATION. THIS IS A CIRCUIT LAYOUT AND NOT INDICATIVE OF WHERE DUCTS ARE TO BE LAID.
- P-B** COLUMN DETAILS:
HEIGHT: 6m
BRACKET LENGTH: POST-TOP
INCLINATION: 5 INCLINATION
COLUMN QUANTITY: 1
- P-C** COLUMN DETAILS:
HEIGHT: 6m
BRACKET LENGTH: POST-TOP
INCLINATION: 5 INCLINATION
COLUMN QUANTITY: 1
- LANTERN DETAILS**
LANTERN TYPE: 25W LED
MAKE & MODEL: CU-PHOSCO-P852-12-P4-WW-CB0750-25W
- LANTERN DETAILS**
LANTERN TYPE: 9W LED
MAKE & MODEL: CU-PHOSCO-P852-R3B-WW-CB0200-9W
- R&L** ABACUS RAISE & LOWER LIGHTING COLUMN.
- BAFFLE** BAFFLES TO BE FITTED TO LANTERNS LABELLED ALONG SITE BOUNDARY WALKWAYS.

C	FOR INFORMATION	RT	TMC	TMC	10/12/2021
B	FOR INFORMATION	RT	TMC	TMC	02/12/2021
A	FOR INFORMATION	RT	TMC	TMC	08/10/2021
ISSUE	DESCRIPTION	DRN	ORIG	APP	DATE

McElligott
CONSULTING ENGINEERS
H2a Centrepoint Business Park, Oak Road, Dublin 12
tel: +353 (0)1 474 3014 email: info@mcelligott.ie web: www.mcelligott.ie

CLIENT: HUGH MCGREEVY & SONS

PROJECT: TUBBER LANE 3

TITLE: PHASE 3 PUBLIC LIGHTING LAYOUT

SHEET: A1	SCALE: 1:500	PROJECT No: 21039	DRAWING No: E016
-----------	--------------	-------------------	------------------

