
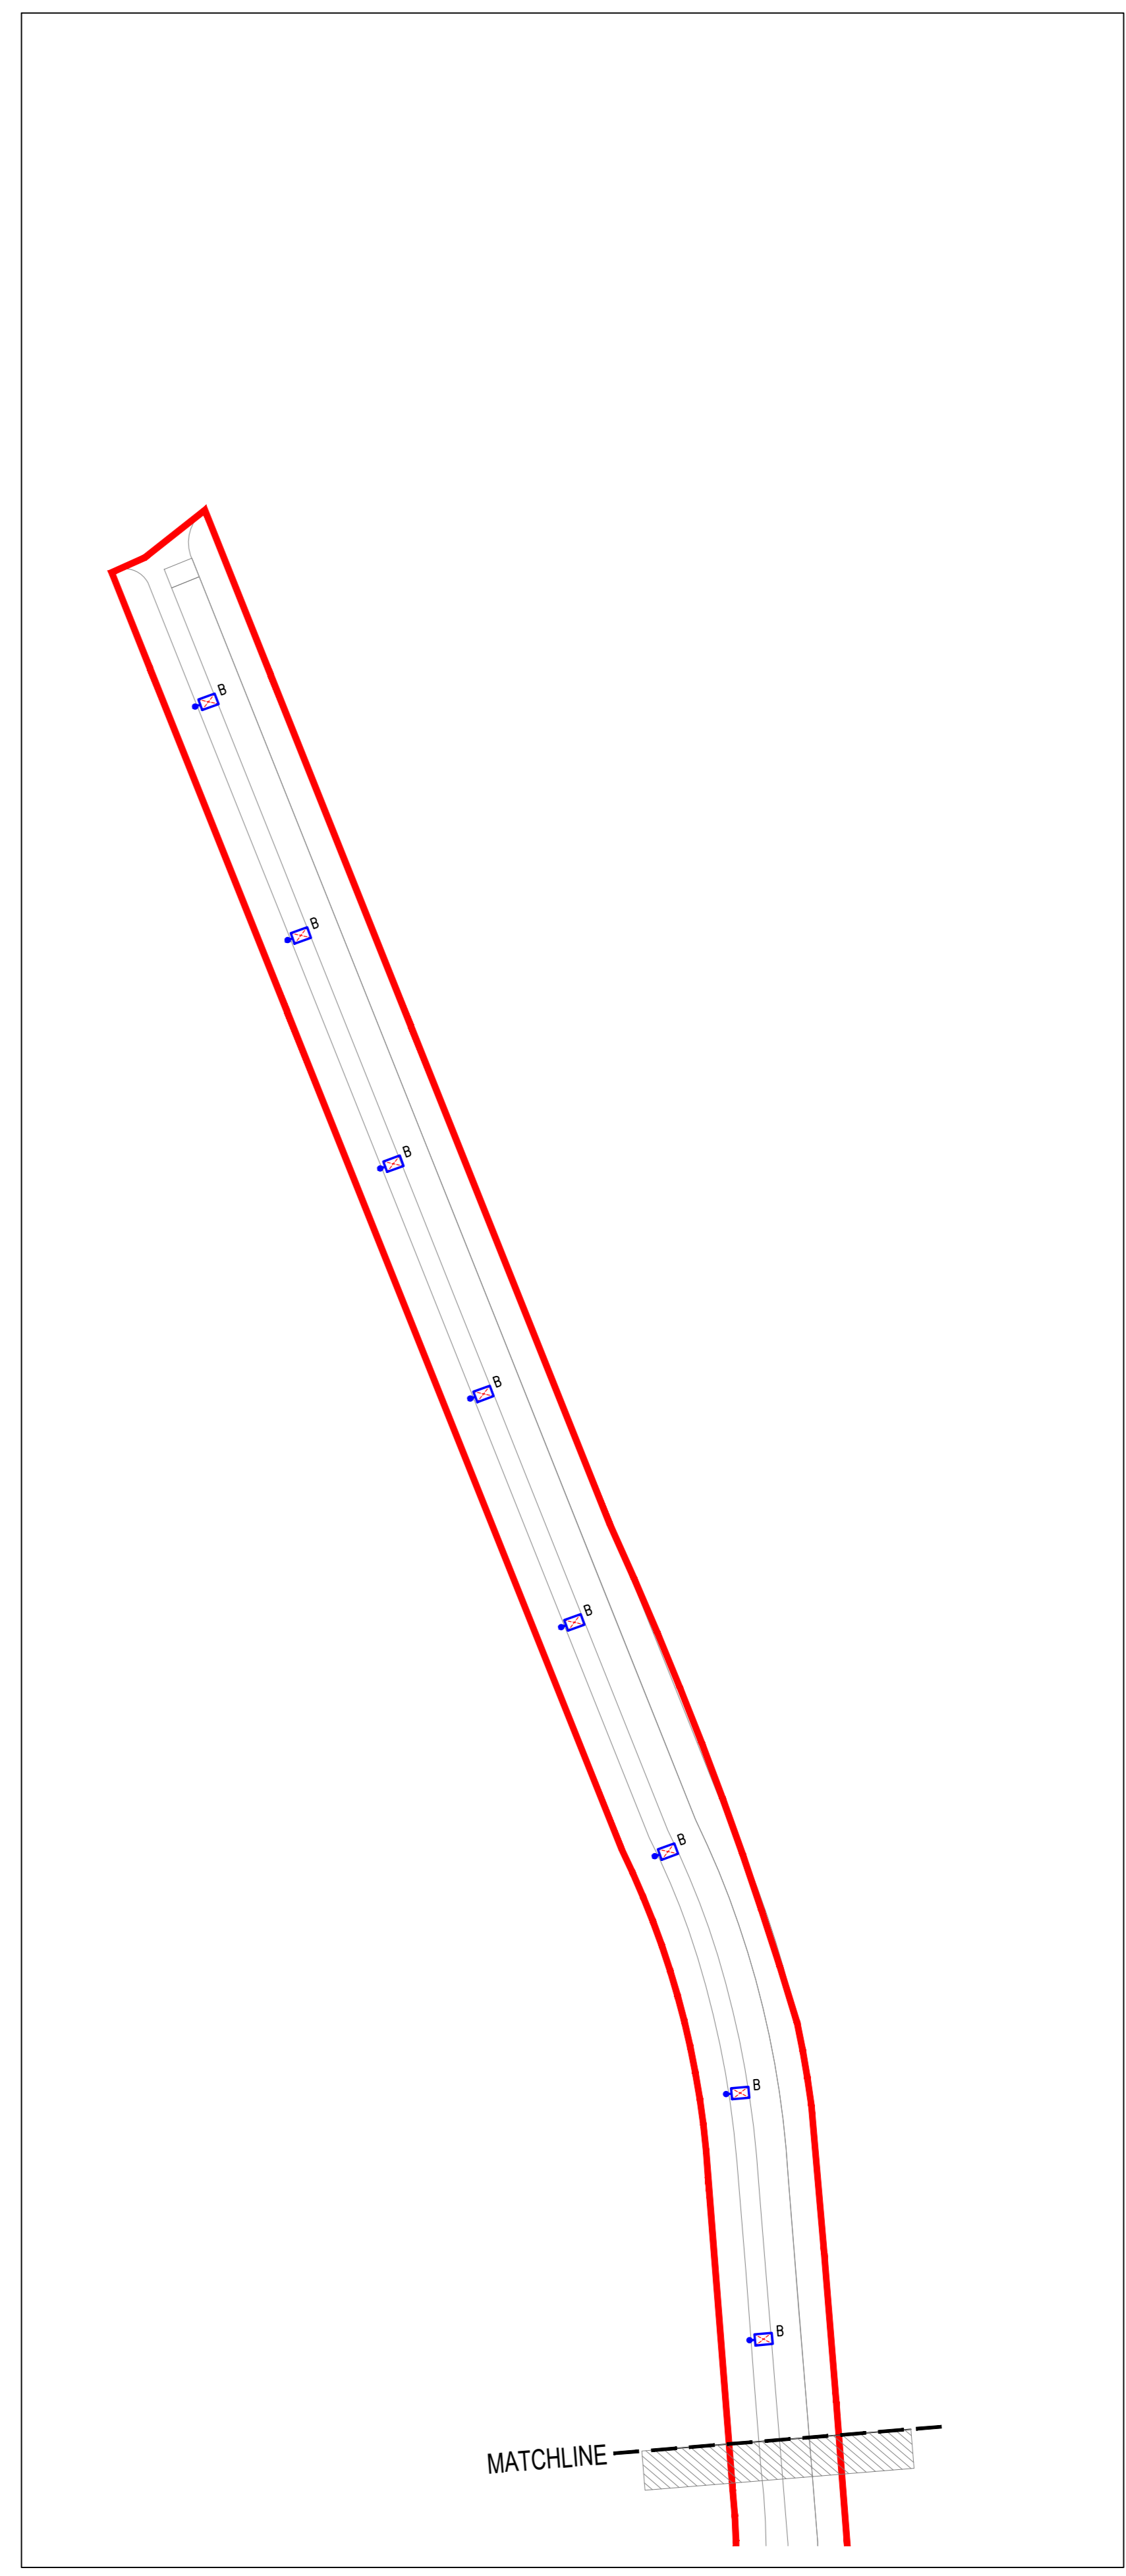


- GENERAL NOTES:**
1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS AND STRUCTURAL ENGINEERS' CONSTRUCTION ISSUE DRAWINGS, FIRE CERTIFICATE & FIRE DRAWINGS, ALONG WITH THE CONSULTANTS MECHANICAL AND ELECTRICAL SPECIFICATIONS AND ANY OTHER DOCUMENTATION.
  2. DO NOT SCALE FROM THIS DRAWING. THIS DRAWING IS REPRESENTATIVE ONLY. ALL DIMENSIONS ARE IN MILLIMETERS (mm), UNLESS OTHERWISE STATED. USE THE FIGURED DIMENSIONS WHEN SHOWN.
  3. THE EXACT LOCATION OF SERVICES AND FITTINGS TO BE AGREED ON SITE WITH THE ARCHITECT AND/OR MECHANICAL OR STRUCTURAL ENGINEER PRIOR TO THEIR INSTALLATION.
  4. THE MECHANICAL AND ELECTRICAL SERVICES ARE TO BE CO-ORDINATED WITH ALL OTHER TRACES AND TO BE AGREED ON SITE PRIOR TO THEIR INSTALLATION. THE CONTRACTOR SHALL ALLOW FOR THE SETTING OUT AND INSTALLATION AROUND ALL OBSTRUCTIONS. ADDITIONAL LOSSES INCURRED BY THE CONTRACTOR DUE TO THE LACK OF CO-ORDINATION WILL NOT BE ENTERAINED.
  5. CONNECTIONS TO ALL EQUIPMENT TO BE MADE BY THE CONTRACTOR.
  6. FIRE / SMOKE DAMPERS, FIRE COLLAR / SLEEVES, INTUMESCENT PUTTY AND FIRE BARRIERS ARE TO BE INSTALLED WHERE DUCTING, PIPework, CABLES, CONTAINMENT AND ANY OTHER SERVICES PASS THROUGH A FIRE WALL / COMPARTMENT OR FLOOR.
  7. ANY DISCREPANCIES BETWEEN THIS DRAWING AND ON SITE CONDITIONS MUST BE REPORTED TO RENAISSANCE ENGINEERING LTD. IMMEDIATELY. ANY CHANGES FROM THIS DESIGN DRAWING MUST BE AGREED WITH THE ENGINEER IN WRITING. A FAILURE TO OBTAIN THIS APPROVAL COULD LEAD TO DIFFICULTY IN APPROVING PAYMENT FOR THE VARIATION(S).
  8. INSTALLATION / CONSTRUCTION / AS-BUILT DRAWINGS TO BE PREPARED WITH REFERENCES TO THE LATEST ARCHITECTS AND STRUCTURAL ENGINEERS' CONSTRUCTION ISSUE DRAWINGS AND LATEST FIRE CERTIFICATE DRAWINGS.
  9. ALL WORKS TO COMPLY WITH THE NATIONAL CODE OF PRACTICE FOR CUSTOMER INTERFACE 4th EDITION 2008.

- LIGHTING SERVICES LEGEND:**
- A ADVA STREET LUMINAIRE (70)  
26.5W LED WITH LS22 OPTIC  
TLE: 12'  
FITTED ON 6M POLE WITH 300mm OFFSET ARM.
  - B ADVA STREET LUMINAIRE (42)  
18W LED WITH LS22 OPTIC  
TLE: 9'  
FITTED ON 6M POLE.
  - C SQUAL STREET LUMINAIRE (4)  
43W SPANOTIC  
FITTED TO 5M POLE.

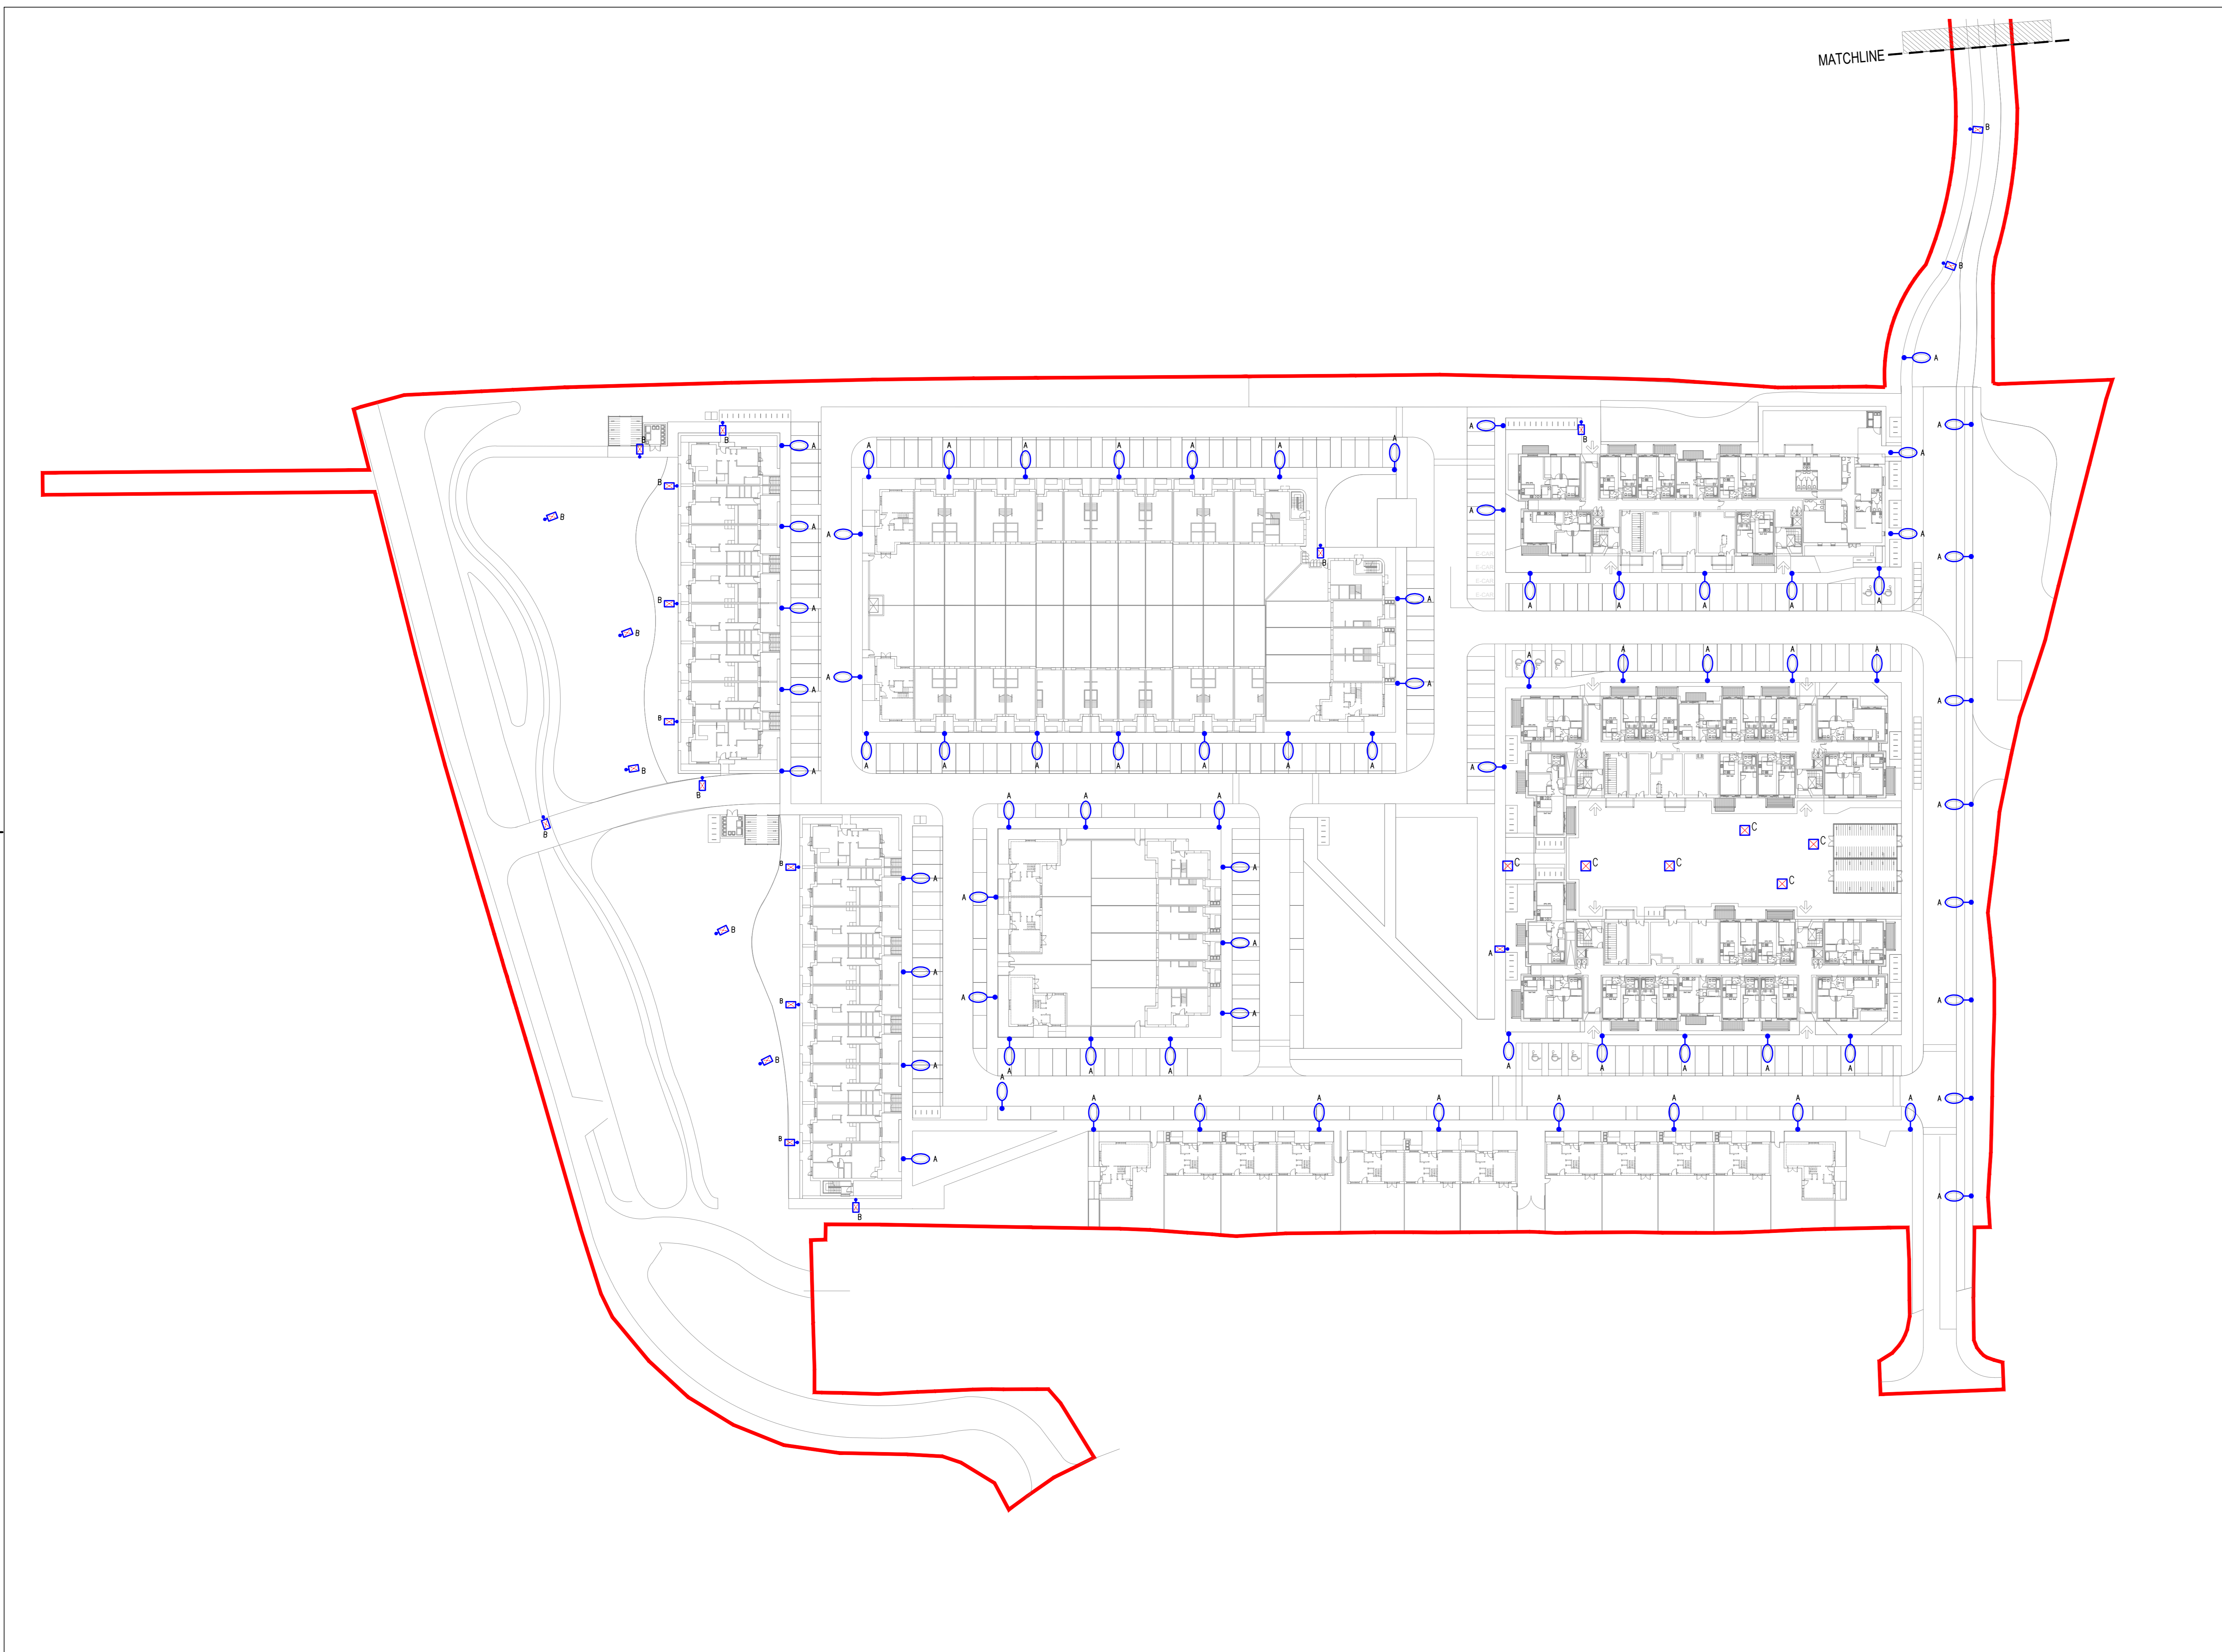

P2	15.12.21	RE-ISSUED FOR INFORMATION	CM	BS
P1	09.11.21	RE-ISSUED FOR INFORMATION	CM	BS
P	13.10.21	ISSUED FOR INFORMATION	GB	BS
Rev.	Date	Revision Description	Des.	CHKD.

 Renaissance Engineering Ltd.  
 2nd Floor, 87-79, South Street, Dublin 8, D08 XYS3.  
 Telephone: +353 (0) 1 475 0850  
 Email: info@re.ie  
 Web: www.renaissanceengineering.ie

Client:  
**TETRARCH RESIDENTIAL LTD**

Architect:  
**DARMODY ARCHITECTURE**

Project:  
**STRATEGIC HOUSING DEVELOPMENT  
 MILL ROAD, SAGGART  
 CO. DUBLIN**

Drawing Title:  
**SITE LIGHTING LAYOUT**

Date:	29.09.21	Scale:	1:500	Proj. No.:	20-117	Drawn No.:	63-50	Project:	P2
Designer:	CM	Checker:	BS	Norman:	SM	2D File Name:	20-117-63-50.dwg		

