


RFE CABINET TO BE LOCATED ON PAD FOR CO-LOCATION SITES. FOR GREENFIELD SITES, RFE CABINET AND FOUNDATION TO BE LOCATED AT FENCE

View A

- ① 50mm RED PVC POWER SUPPLY DUCT TO H3G105 CABINET
- ② 50mm RED PVC DUCT FOR POWER TO NODE B
- ③ 125mm RED PVC POWER SUPPLY DUCT

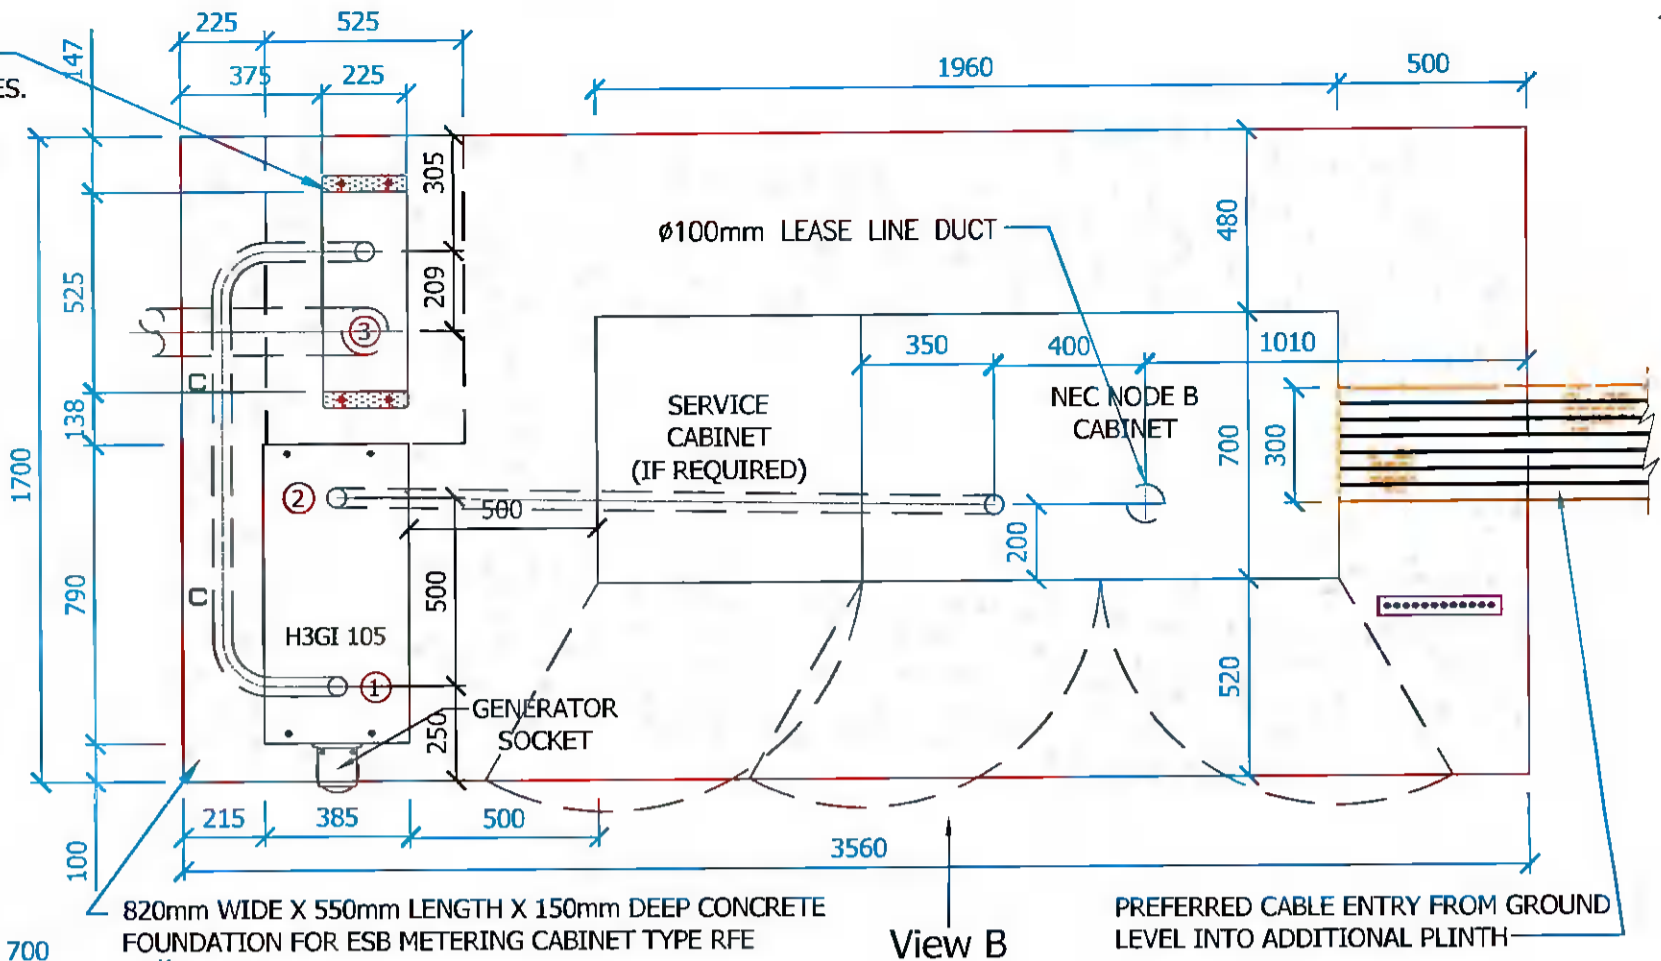


820mm WIDE X 550mm LENGTH X 150mm DEEP CONCRETE FOUNDATION FOR ESB METERING CABINET TYPE RFE

View B


PREFERRED CABLE ENTRY FROM GROUND LEVEL INTO ADDITIONAL PLINTH

Plan

Illustrative Purposes Only - Exempted Development Class 31 (f)

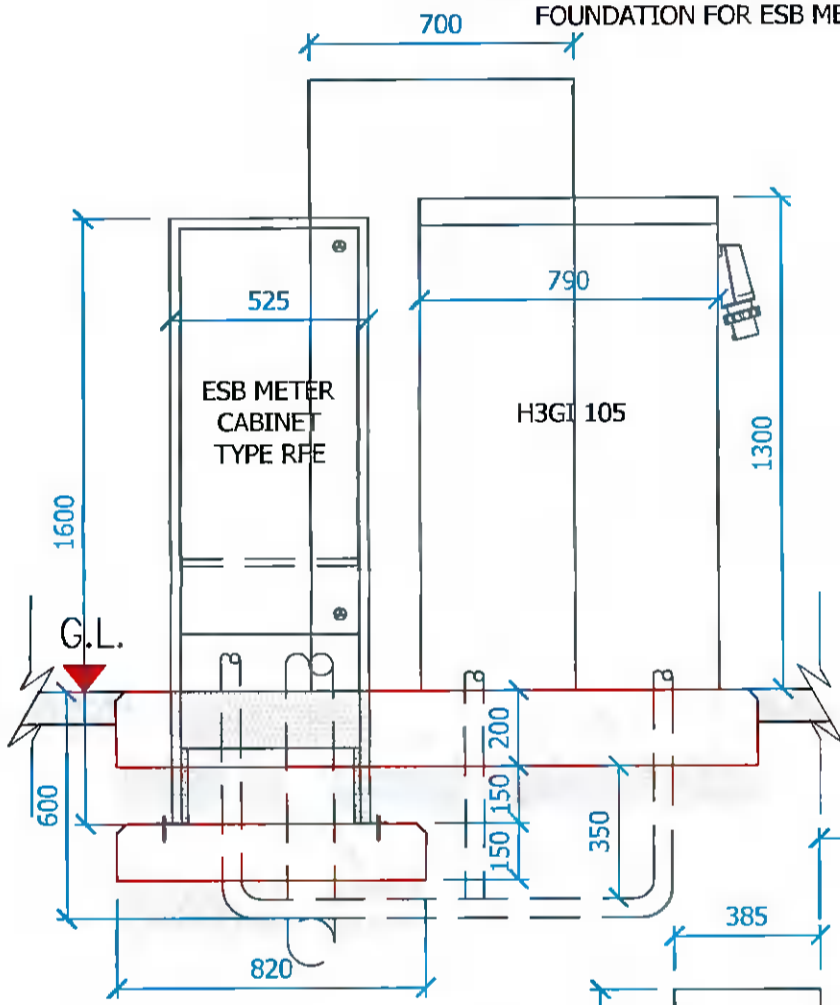

View A

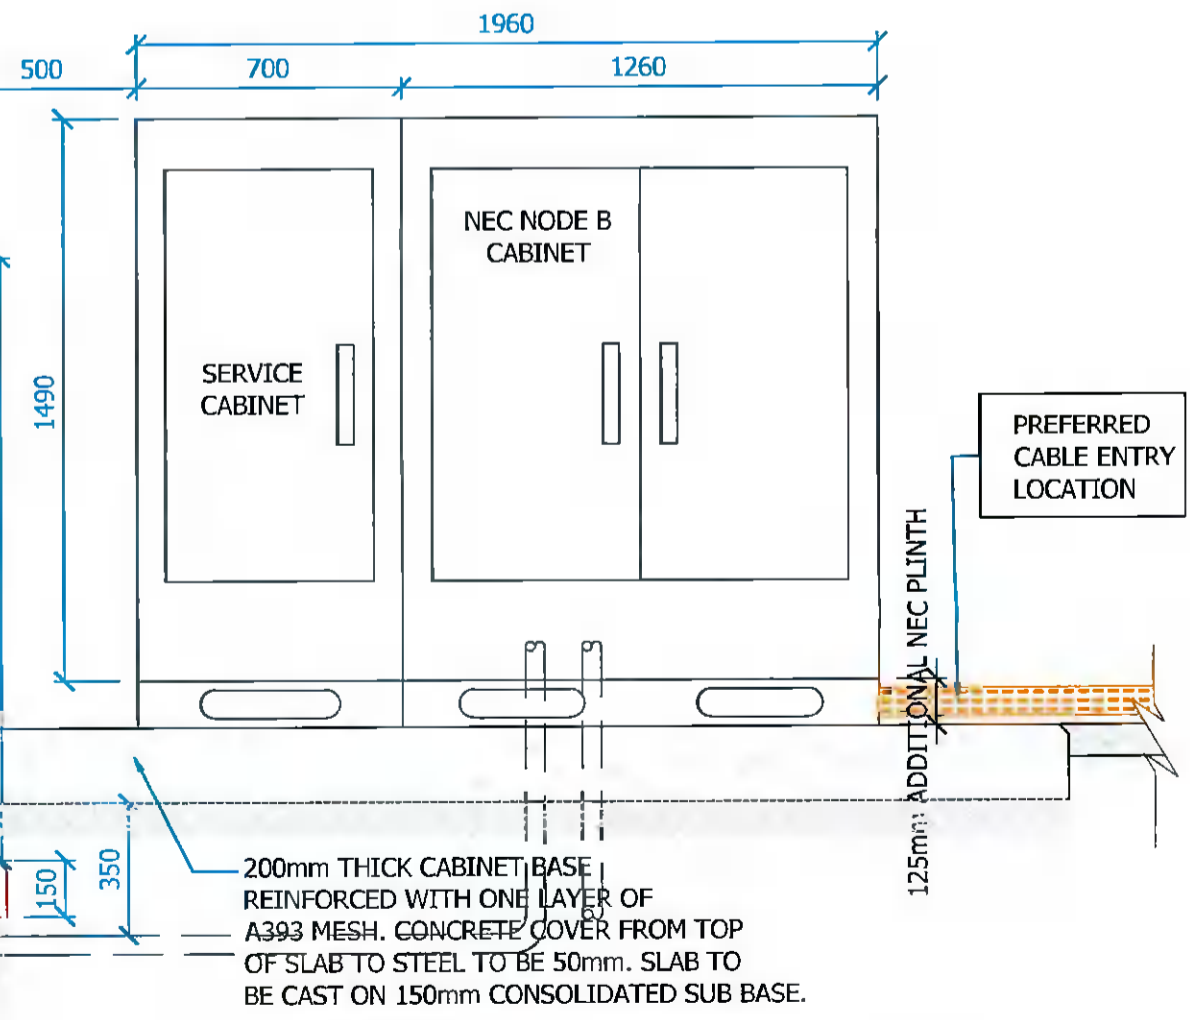

View B

| | ESB Telecoms Ltd. 43 Merrion Square East, Dublin 2. Ph: 01-7025071 | <table border="1"> <thead> <tr> <th>REV.</th> <th>DATE</th> <th>DESCRIPTION</th> <th>CHK</th> <th>APP</th> </tr> </thead> <tbody> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table> | REV. | DATE | DESCRIPTION | CHK | APP | | | | | | H3GI ODU Lattice Tower Balgaddy 38kV Substation Kishoge Lucan Co. Dublin | Proposed Height: 1.615 metres | Drawn By: N. Fitzpatrick |
|---|---|---|-------------|-------------|--------------------|-----|-----|--|--|--|--|--|---|-------------------------------|--------------------------|
| | | | REV. | DATE | DESCRIPTION | CHK | APP | | | | | | | | |
| | | | | | | | | | | | | | | | |
| Proposed Type: H3G Out Door Units (ODU's) | Issue Date: 24 January 2021 | | | | | | | | | | | | | | |
| Proposed Colour: Grey | Drawing No: Balgaddy 38kV_11 | ESB Ref: Varied | Ops App by: | Scale: 1:20 | File: /H3G/Cab.dwg | | | | | | | | | | |