



PREVAILING WIND (SW)

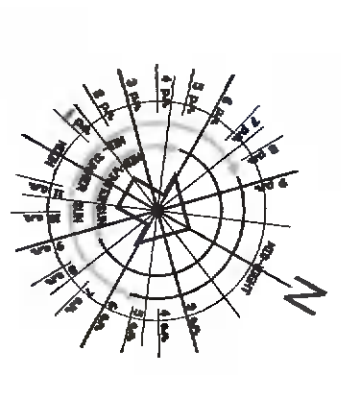

0 2 4 10

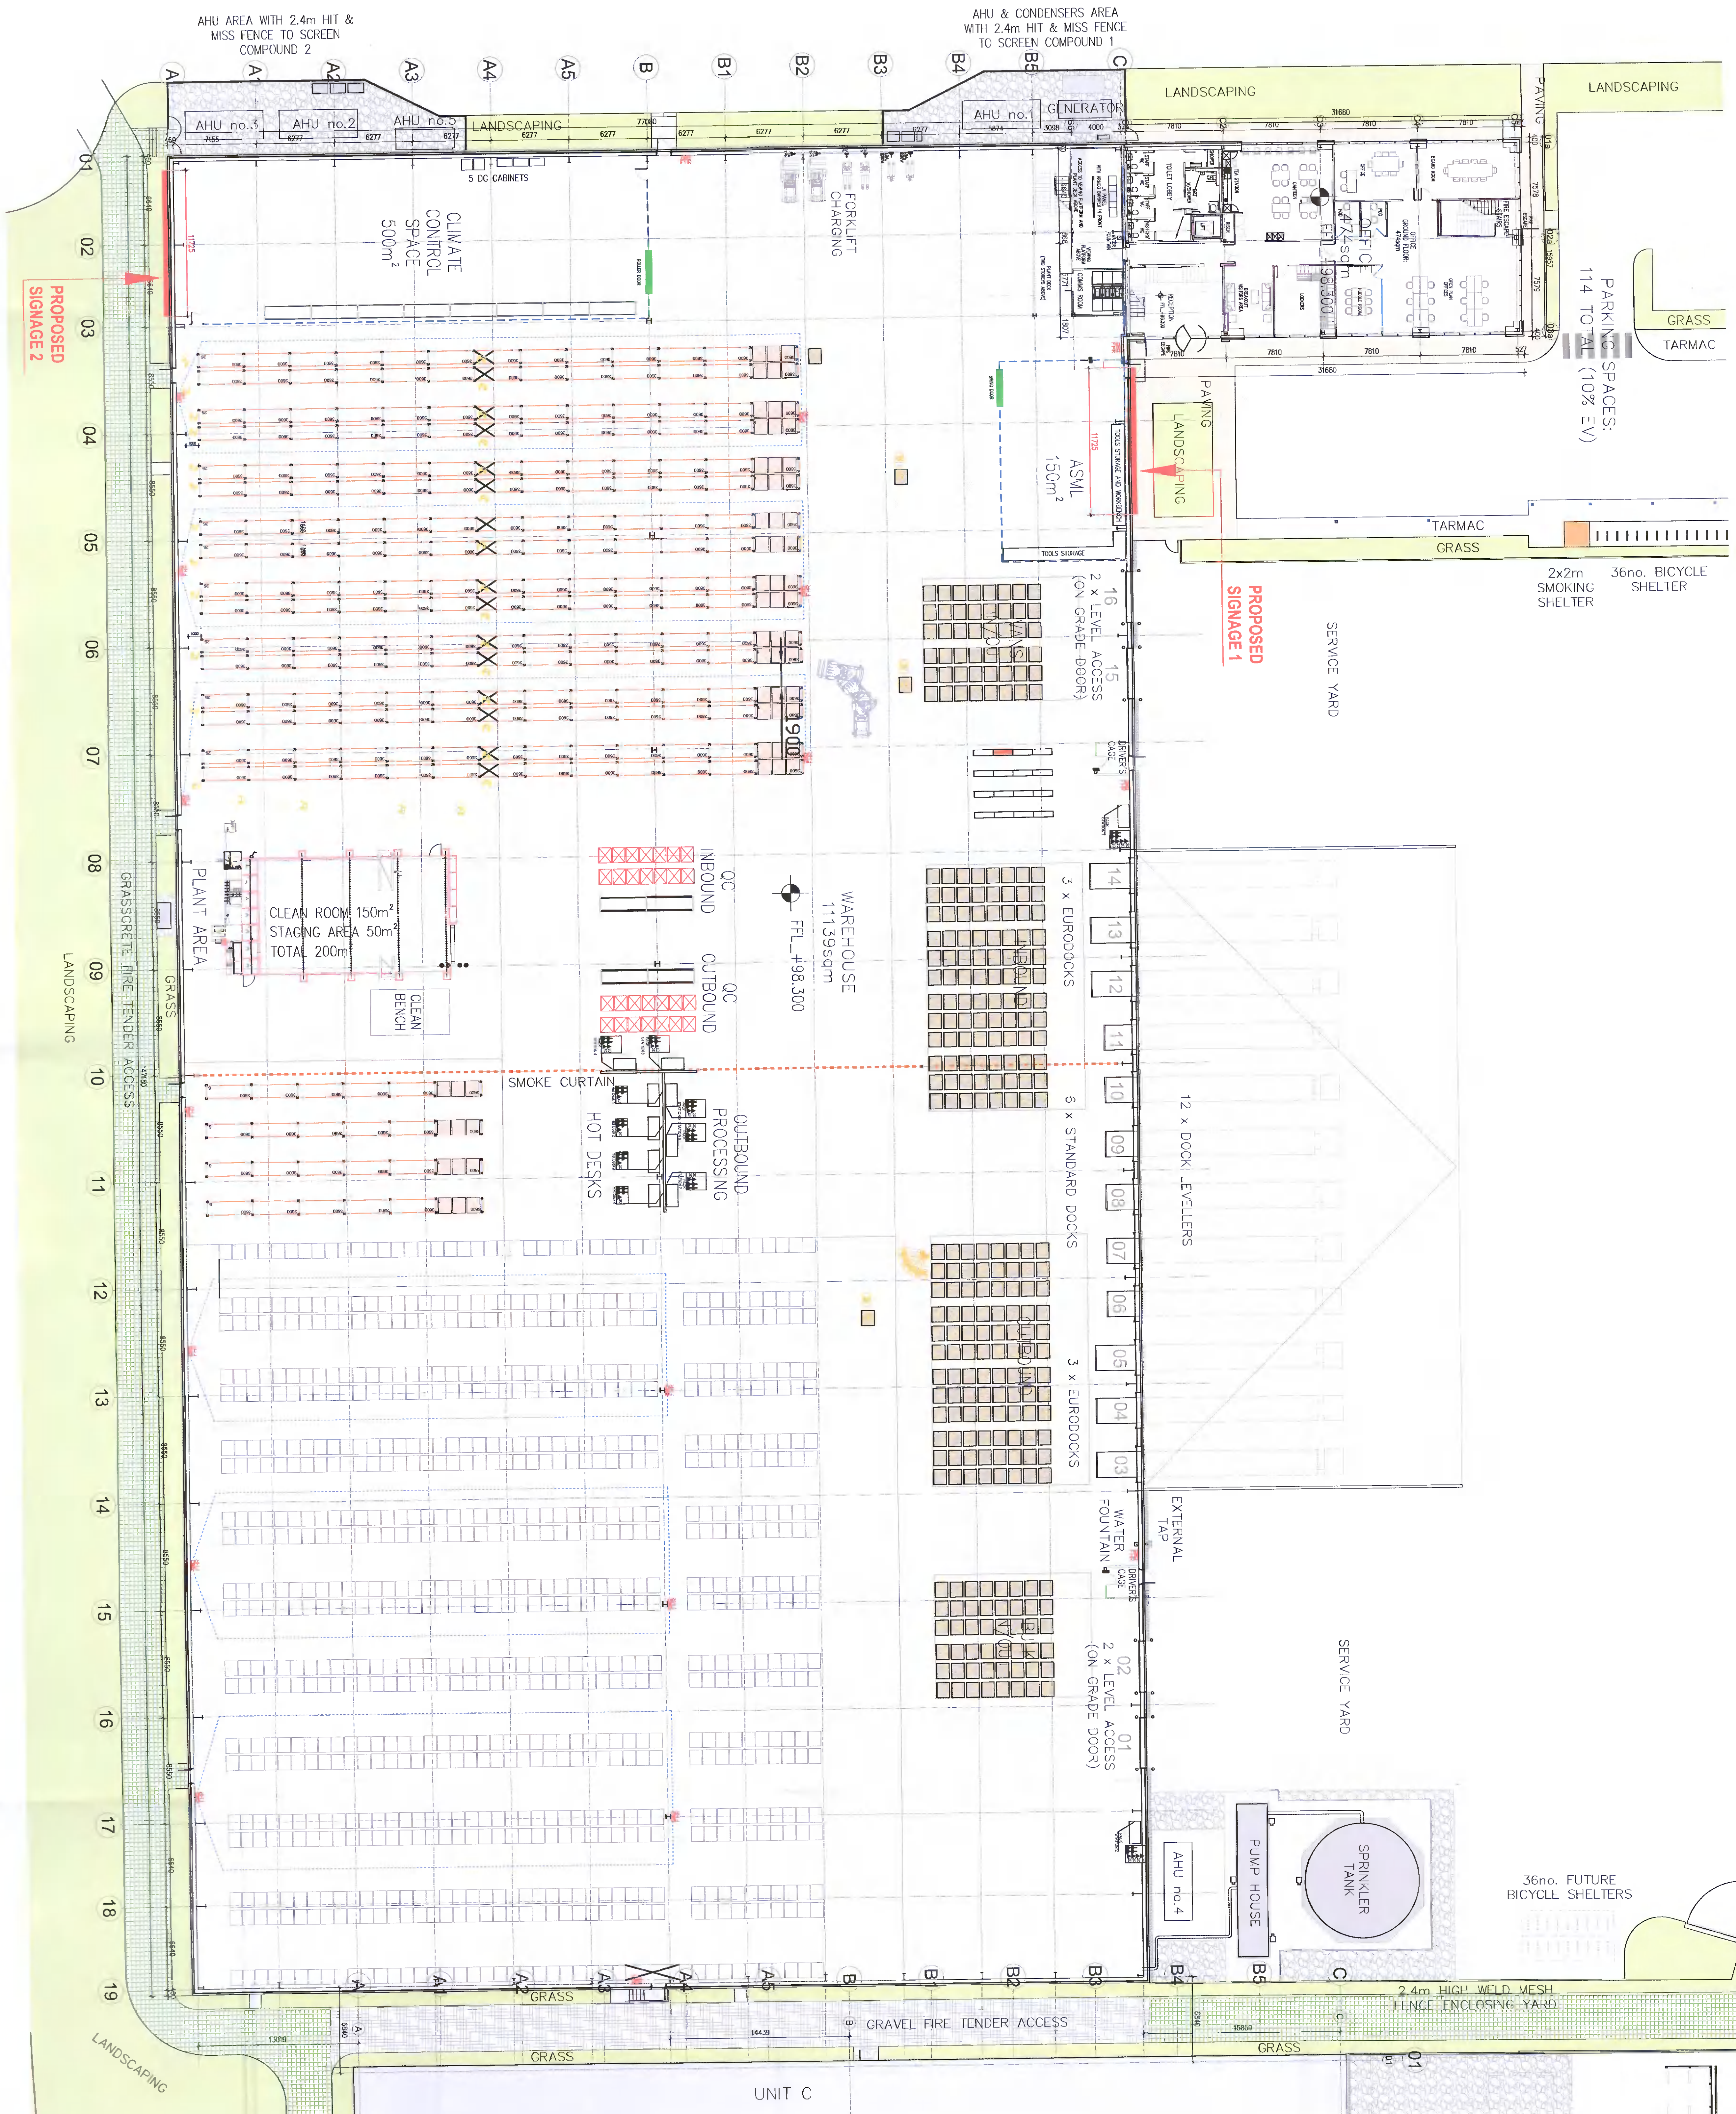

LEGEND:

- 60MIN COMPARTMENT WALL
- 60MIN FIRE RATED WALL
- 30MIN FIRE RATED WALL
- SMOKE CURTAIN

ESCAPE ROUTE DOORS:  
WHERE ELECTRICALLY POWERED LOCKS ARE INSTALLED ON DOORS FORMING PART OF THE ESCAPE ROUTES  
(E.G. ACCESS READERS)  
THEY SHOULD RETURN TO THE UNLOCKED POSITION UNDER ANY OF THE FOLLOWING CONDITIONS:  
- ON OPERATION OF THE FIRE ALARM.  
- ON LOSS OF POWER OR SYSTEM ERROR.  
- ON ACTIVATION OF A MANUAL DOOR RELEASE UNIT (TYPE A) EMERGENCY DOOR RELEASE BUTTON) CONFORMING TO BS EN 54-11:2001+1+A1 POSITIONED AT THE DOOR ON THE SIDE APPROACHED BY PEOPLE MAKING THEIR ESCAPE.

ON OPERATION OF THE FIRE ALARM.  
ON LOSS OF POWER OR SYSTEM ERROR.  
ON ACTIVATION OF A MANUAL DOOR RELEASE UNIT (TYPE A) EMERGENCY DOOR RELEASE BUTTON) CONFORMING TO BS EN 54-11:2001+1+A1 POSITIONED AT THE DOOR ON THE SIDE APPROACHED BY PEOPLE MAKING THEIR ESCAPE.

Revision	Number	Date	Description
REV 1	A		Initial Drawing in AutoCAD
REV 2	B		Final Design - User Approved Dimensions Done
REV 3	C		Structural Design - User Approved Dimensions Done
REV 4	D		Structural Design - User Approved Dimensions Done
REV 5	E		Structural Design - User Approved Dimensions Done
REV 6	F		Structural Design - User Approved Dimensions Done
REV 7	G		Structural Design - User Approved Dimensions Done
REV 8	H		Structural Design - User Approved Dimensions Done
REV 9	I		Structural Design - User Approved Dimensions Done
REV 10	J		Structural Design - User Approved Dimensions Done
REV 11	K		Structural Design - User Approved Dimensions Done
REV 12	L		Structural Design - User Approved Dimensions Done
REV 13	M		Structural Design - User Approved Dimensions Done
REV 14	N		Structural Design - User Approved Dimensions Done
REV 15	O		Structural Design - User Approved Dimensions Done
REV 16	P		Structural Design - User Approved Dimensions Done
REV 17	Q		Structural Design - User Approved Dimensions Done
REV 18	R		Structural Design - User Approved Dimensions Done
REV 19	S		Structural Design - User Approved Dimensions Done
REV 20	T		Structural Design - User Approved Dimensions Done
REV 21	U		Structural Design - User Approved Dimensions Done
REV 22	V		Structural Design - User Approved Dimensions Done
REV 23	W		Structural Design - User Approved Dimensions Done
REV 24	X		Structural Design - User Approved Dimensions Done
REV 25	Y		Structural Design - User Approved Dimensions Done
REV 26	Z		Structural Design - User Approved Dimensions Done

**J S A Architects**  
 CHARITABLE ACCOUNTANTS 10 BOOTHBYWAY AVENUE,  
 STURROCK, COV. LEICESTERShire, LE12 8JG  
 01530 850000  
 www.jsaarchitects.co.uk

Client: WED Dobbies Limited  
 Project: Biddenden Business Park - UNIT D SIGNAGE FOR 100 SCREENERS  
 Description: UNIT D - GROUND FLOOR PLAN  
 Date: 21/04/2022 Sheet: 40 Scale: 1/200  
 Job No: 2020  
 Drawn: [Name] By: SJI  
 Date: 21/04/2022  
 Scale: 1/200  
 Job No: 2020