
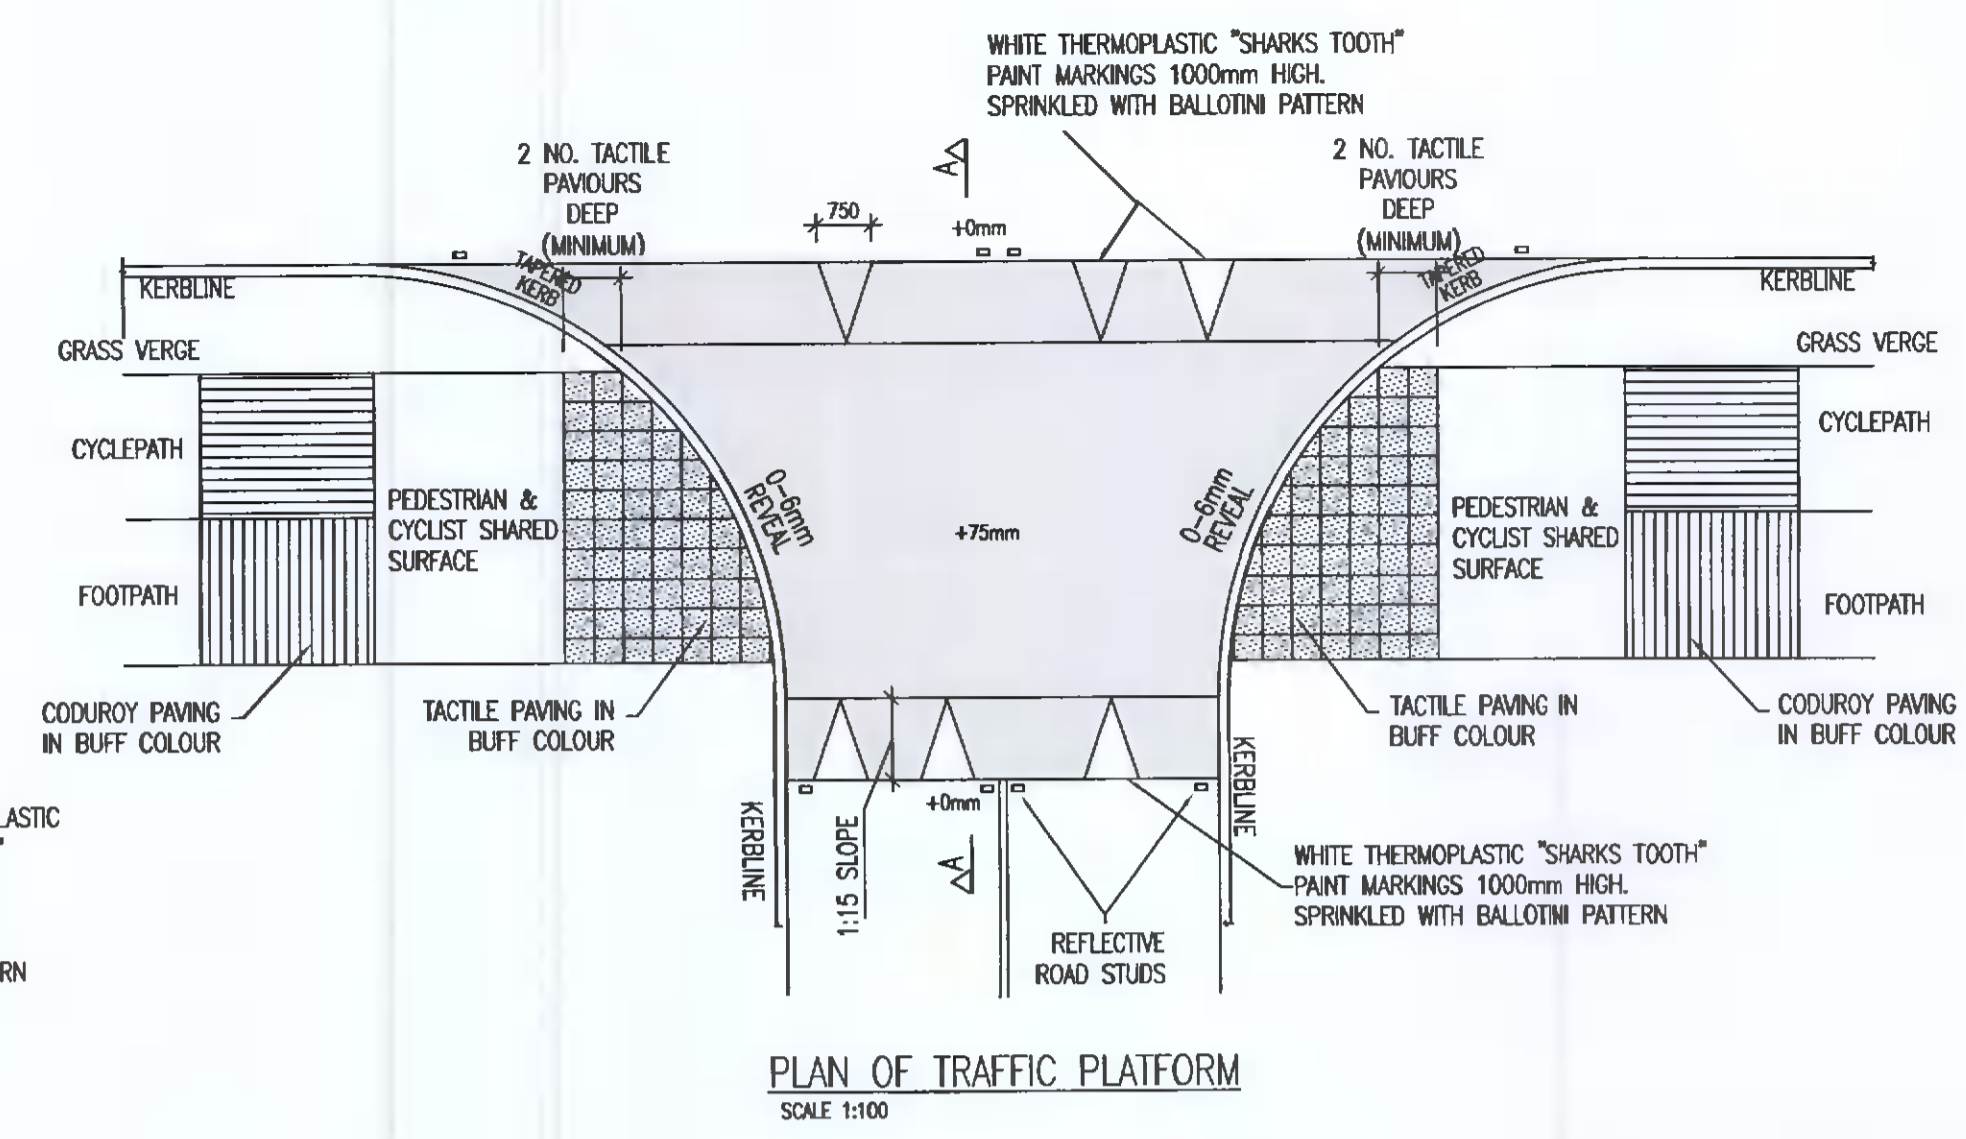
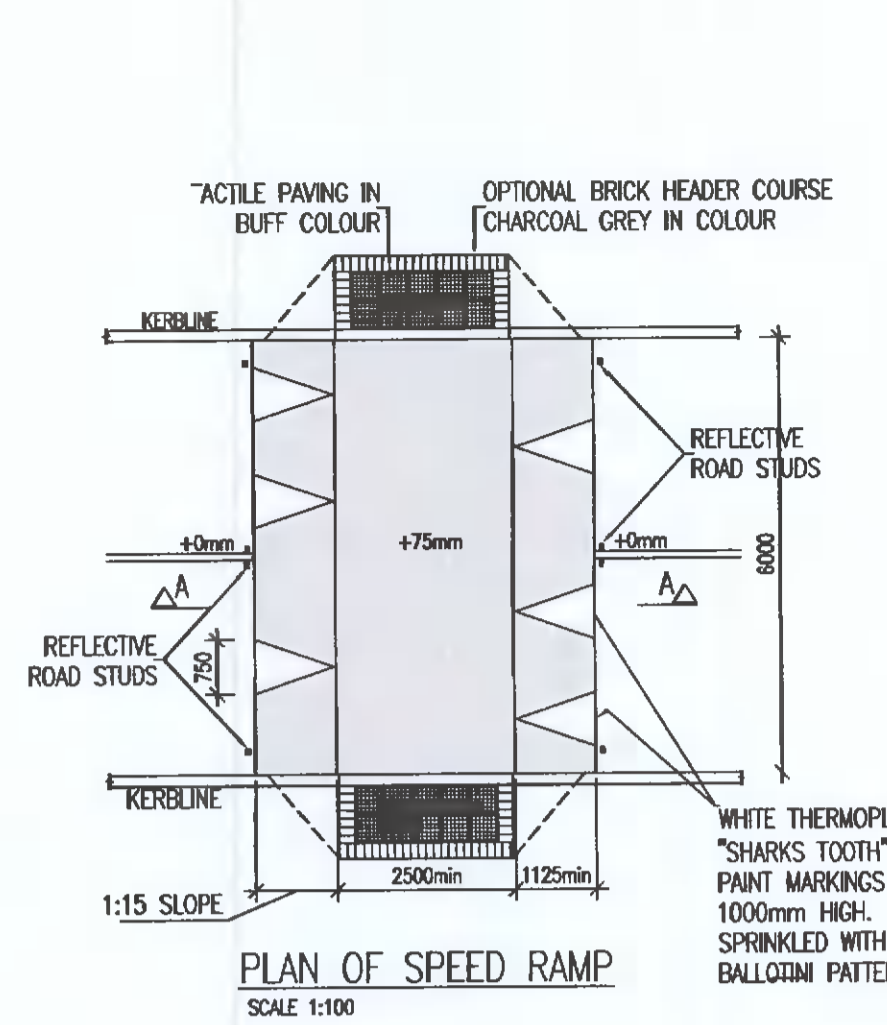







NOTES

- DO NOT SCALE. USE FIGURED DIMENSIONS ONLY.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS
- U3 CONCRETE FINISH INSITU.
- CONCRETE KERBS SHALL COMPLY WITH THE RECOMMENDATIONS OF BS 5931 AND SHALL BE PROTECTED FROM ADVERSE WEATHER UNTIL CURED.
- EXPANSION AND CONSTRUCTION JOINTS IN KERB TO MATCH JOINTS IN ROADS AND FOOTWAYS. SAW CUT OR CAST IN-SITU MOVEMENT JOINTS TO MATCH IN KERBS AND PAVEMENTS AT C. 3m C/C IN LINE WITH SDCC TIC REQUIREMENTS. ADDITIONALLY SAW CUT ALL KERBS AT WEAK POINTS.
- ALL ROAD WORKS TO BE TO SOUTH DUBLIN COUNTY COUNCIL STANDARDS FOR TAKING IN CHARGE.
- ALL ROADS WITHIN TAKING IN CHARGE AREA TO COMPLY WITH SDCC TIC POLICY - APPENDIX 6 - ROADS MINIMUM STANDARDS.




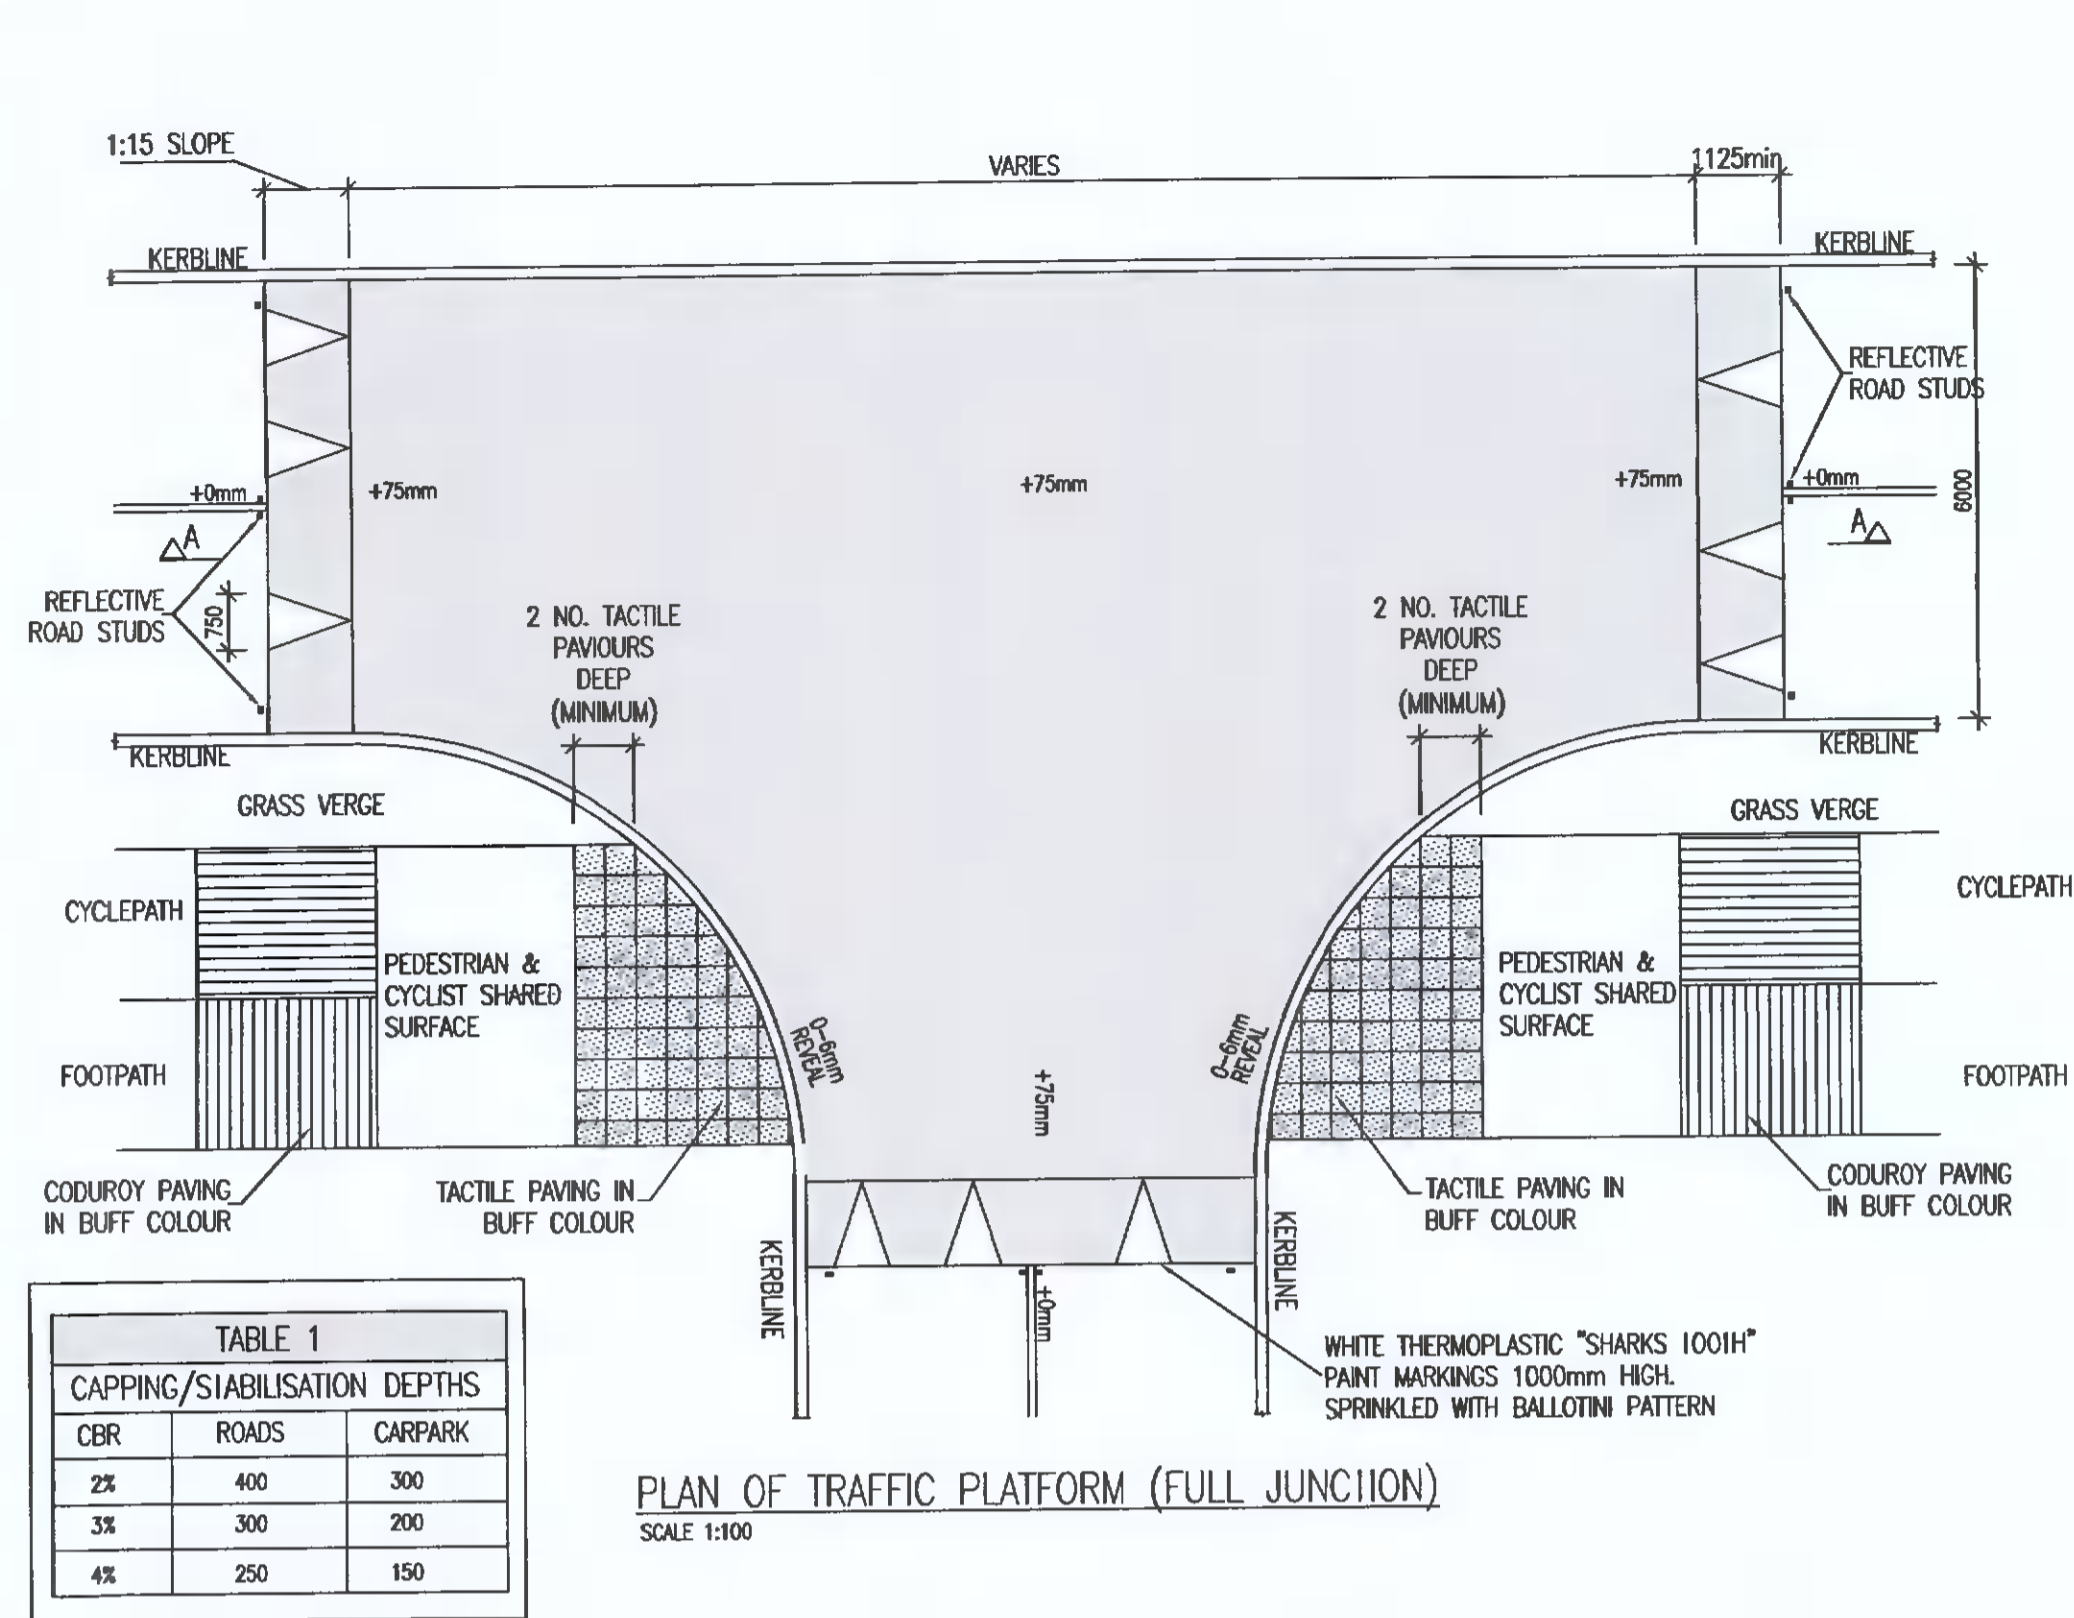


NOTE :

- FOR AREAS WHERE CBR VALUES ARE BELOW 2%, CARRY OUT THE FOLLOWING:
 - THE SOFT AREA IS TO BE EXCAVATED OUT FULLY AND REPLACED WITH A GENERAL FILL MATERIAL (CLASS 1A/1B) TO N.R.A. SPECIFICATION TO THE UNDERSIDE OF AN 'ENKAGRID' LAYER (ENKAGRID TRC 40 OR SIMILAR 40kN/m). SEPARATION GEOTEXTILE TO BE PLACED BETWEEN THE SUBGRADE AND CAPPING.
 - OR
 - SOIL TO BE STABILISED IN-SITU WITH LIME/CEMENT TO SPECIALIST CONTRACTOR SPECIFICATION TO FORMATION LEVEL, MINIMUM CBR 5%.
 AN ENGINEER SHOULD INSPECT THE SOFT AREA WHEN IT HAS BEEN FULLY EXCAVATED OUT PRIOR TO THE FILL/STABILISED MATERIAL BEING PLACED/WORKED.
- FOR AREAS WHERE CBR VALUES ARE BETWEEN 2% AND 5%, CARRY OUT THE FOLLOWING:
 - THE SOIL IS TO BE EXCAVATED OUT FULLY AND REPLACED WITH A CAPPING MATERIAL TYPE 6F1/6F2 TO N.R.A. SPECIFICATION. DEPTHS OF CAPPING MATERIAL AS PER TABLE 1 BELOW. SEPARATION GEOTEXTILE TO BE PLACED BETWEEN THE SUBGRADE AND CAPPING.
 - OR
 - SOIL TO BE STABILISED IN-SITU WITH LIME/CEMENT TO SPECIALIST CONTRACTOR SPECIFICATION TO FORMATION LEVEL, MINIMUM CBR 5%, DEPTHS OF MATERIAL TO BE STABILISED AS PER TABLE 1 BELOW.

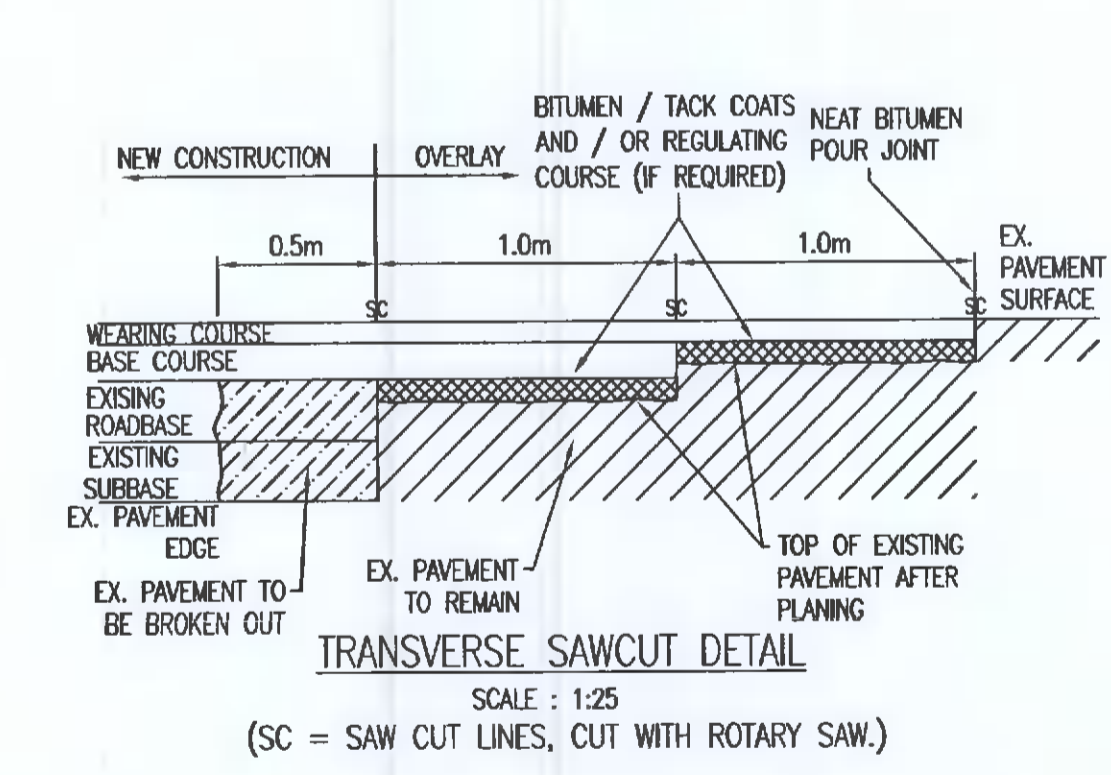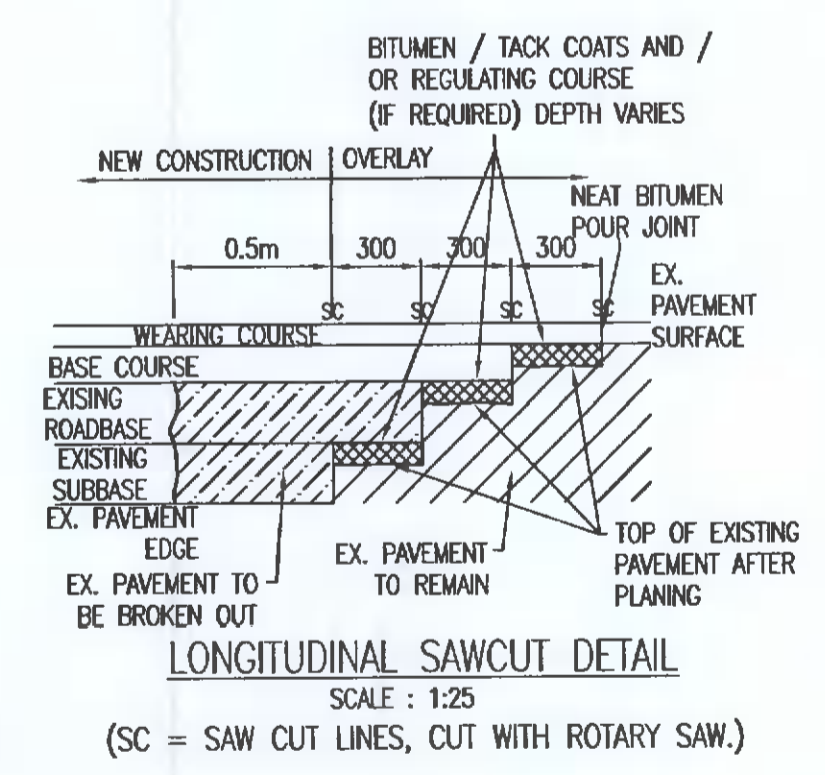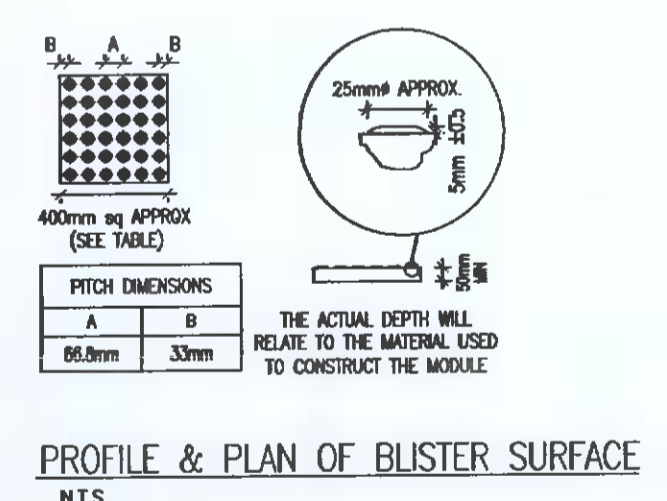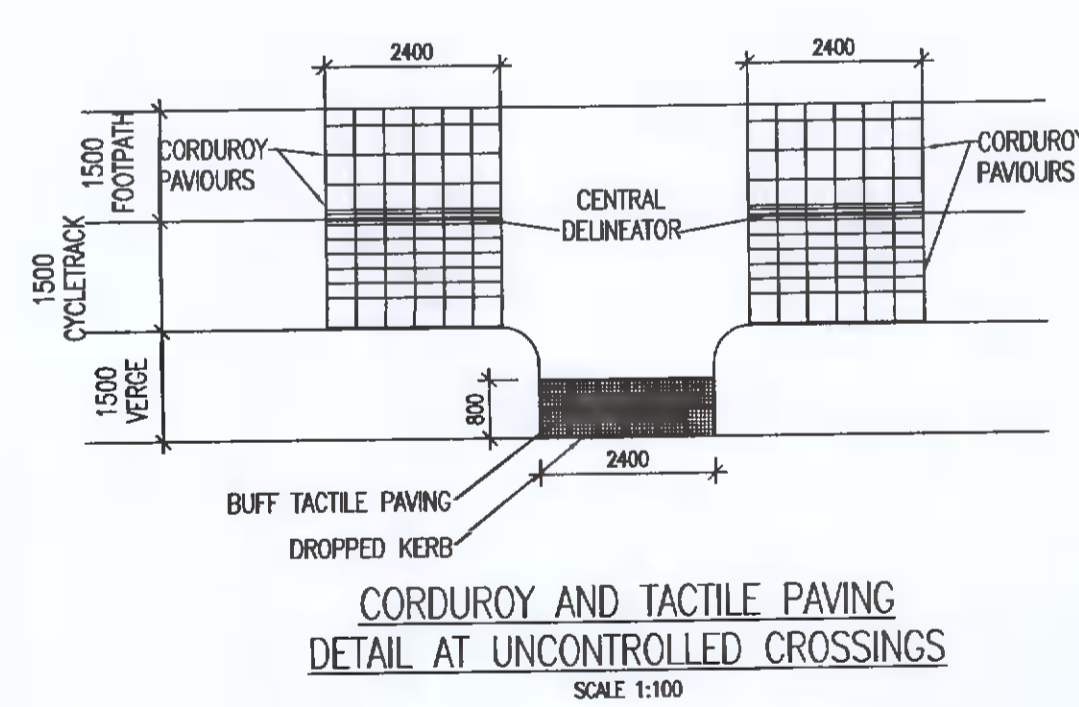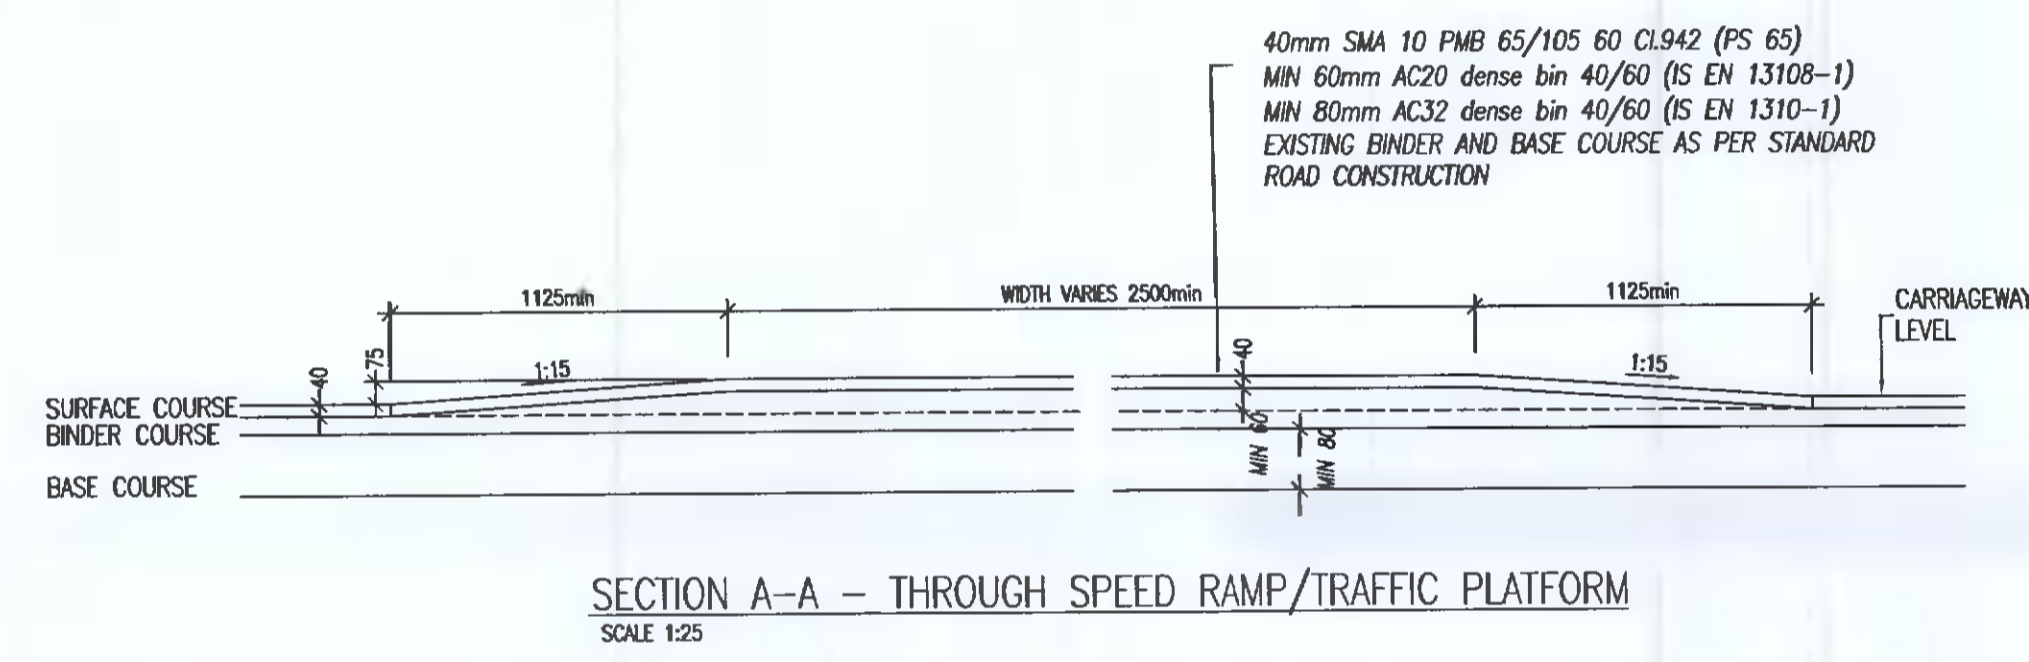

[SUFFICIENT WORKING ROAD MUST BE MADE AVAILABLE TO ENSURE SAWCUT CAN BE CORRECTLY CONSTRUCTED]

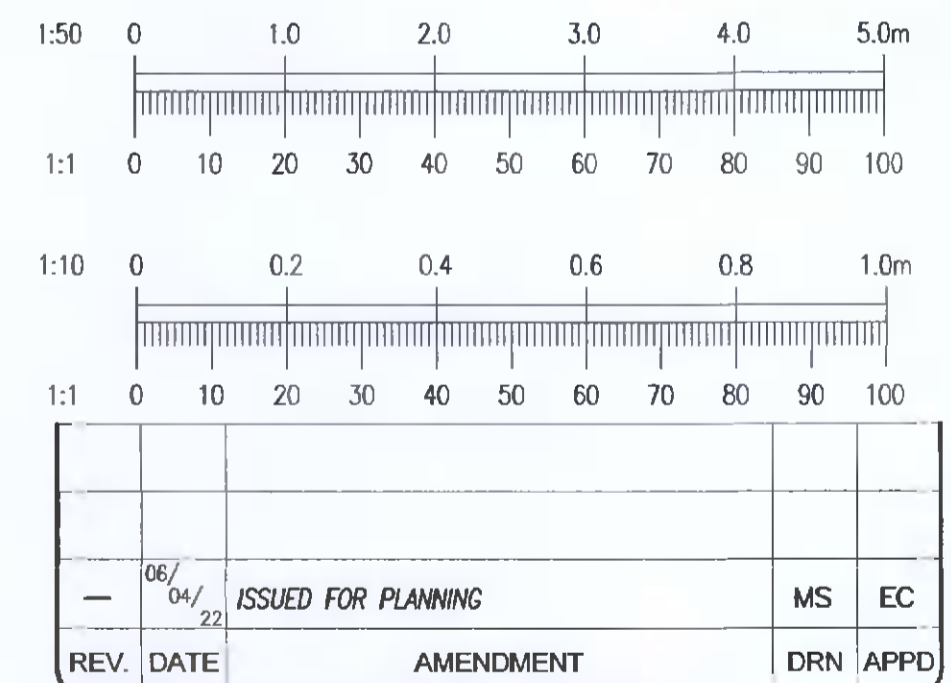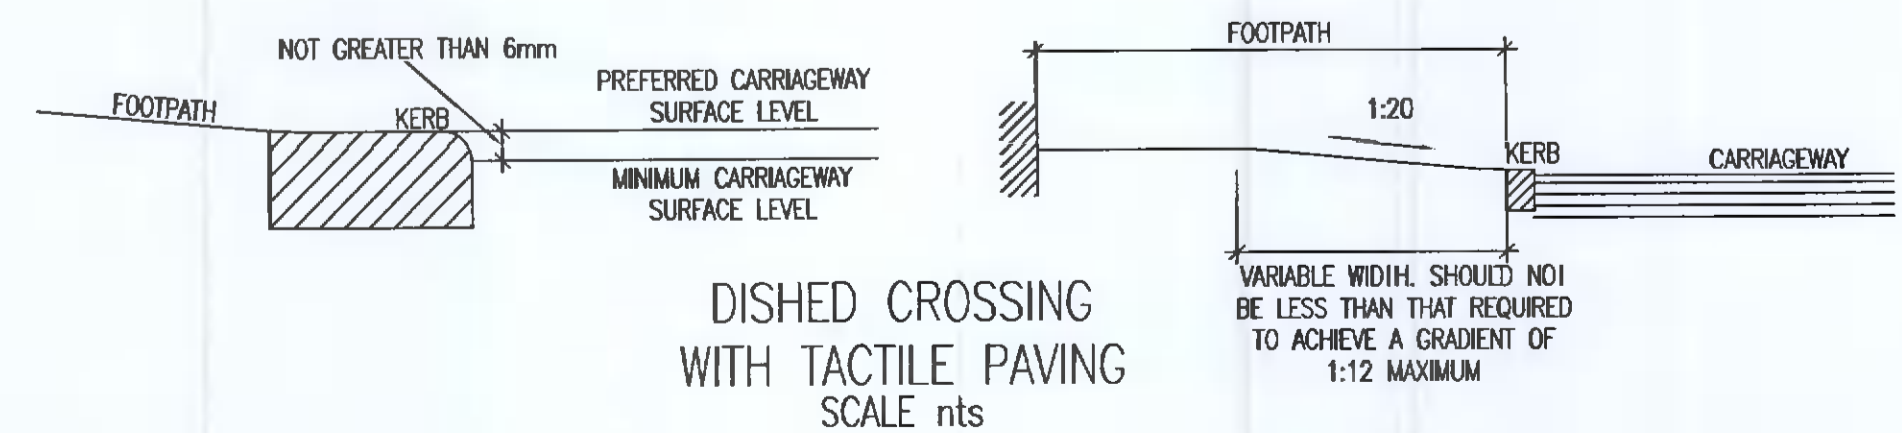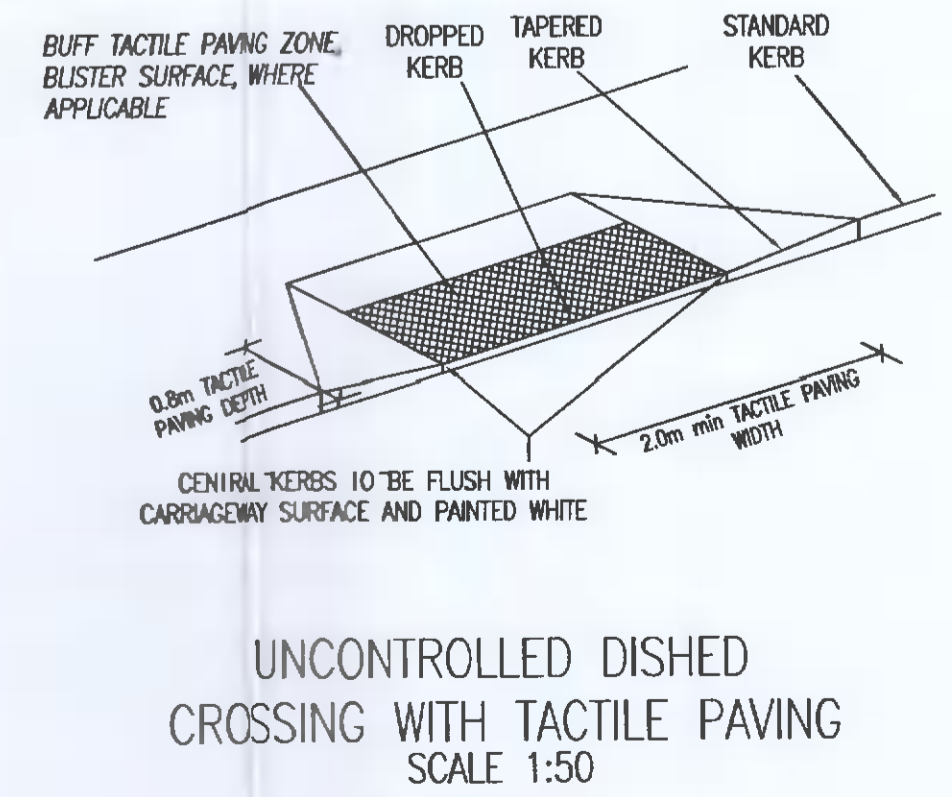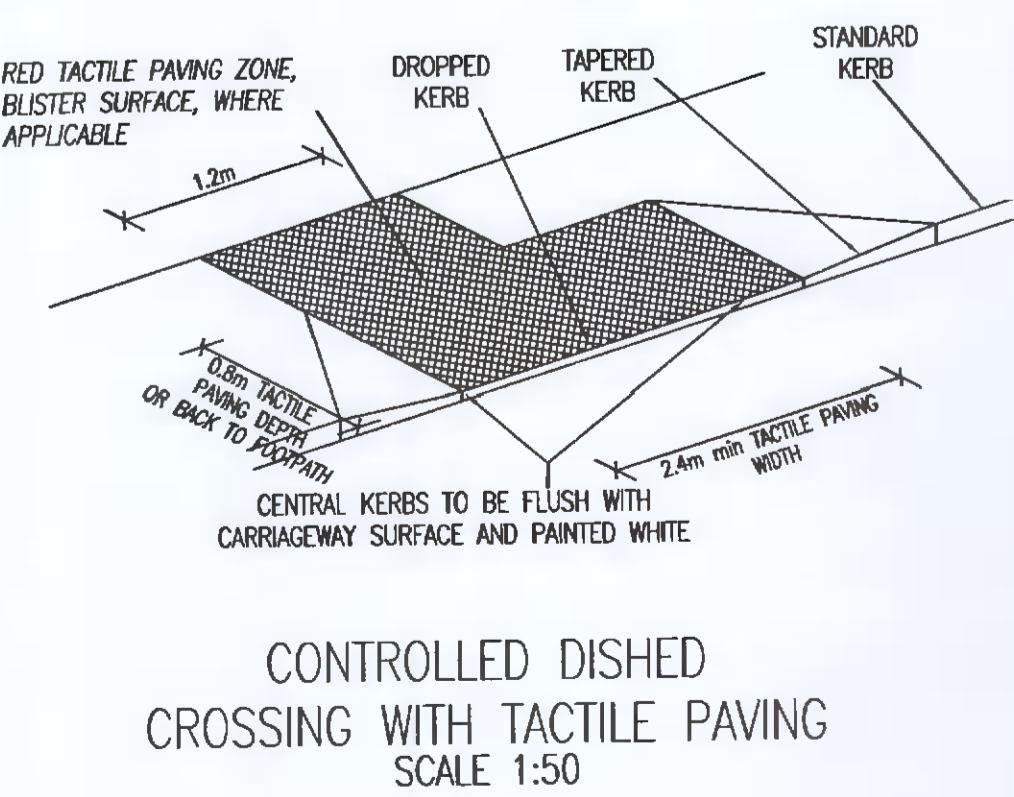

STATUS **FOR PLANNING ONLY NOT FOR CONSTRUCTION**

Waterman Moylan
Engineering Consultants
BLOCK 5, EASTPOINT BUSINESS PARK, ALFIE BYRNE ROAD, DUBLIN D03 K7W7 IRELAND.
Tel: (01) 664 8500 Fax: (01) 661 3618
Email: info@waterman-moylan.ie www.waterman-moylan.ie

CLIENT **QUINTAIN DEVELOPMENTS IRELAND Ltd.**
ARCHITECT **MOLA ARCHITECTS**
PROJECT **TANDY'S LANE VILLAGE - Phase 2**
TITLE **TYPICAL ROAD CONSTRUCTION DETAILS SHEET 2 OF 2**

DRAWN MS	DESIGNED SV	APPROVED EC	DATE APRIL 2022
SCALE AS SHOWN	JOB NO. 21-058	DRG. NO. P191	REVISION -