NOTE:
PRECAST CONCRETE MANHOLES SHALL ONLY BE USED WHERE THE WATER TABLE IS LOW. THEY SHALL NOT BE USED WHERE THERE IS A PERCHED WATER TABLE, WHERE THE SEWER IS LOCATED NEXT TO A RIVER, LAKE OR OTHER WATER BODY AND WITHIN AREAS THAT ARE IDENTIFIED BY THE OFFICE OF PUBLIC WORKS CATCHMENT FLOOD RISK ASSESSMENT AND MANAGEMENT (CFRAM) WITH A FLOOD RISK OF 1 IN 10 YEARS. "

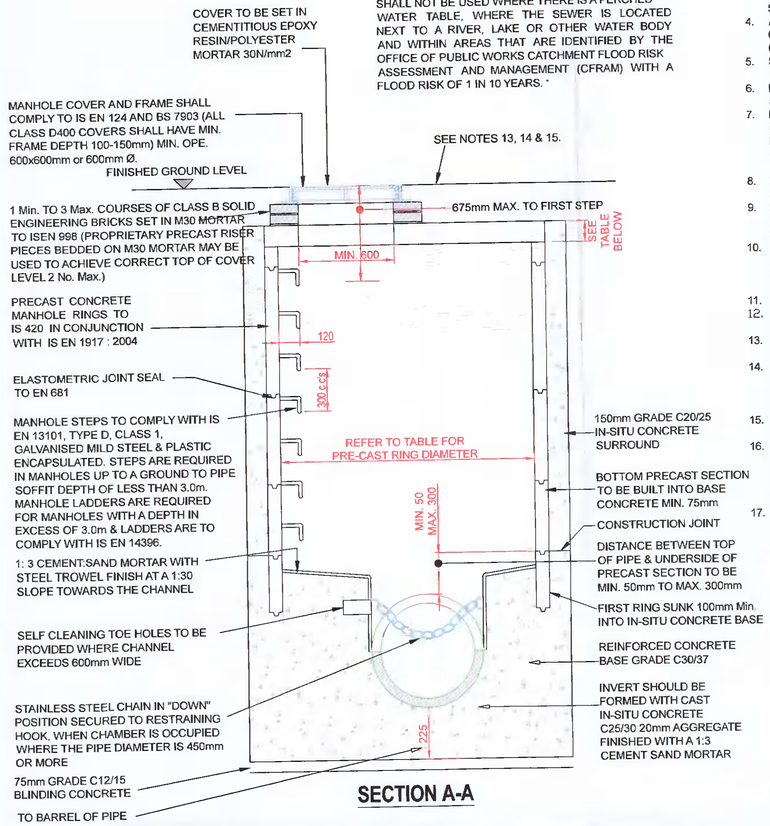

SECTION A-A

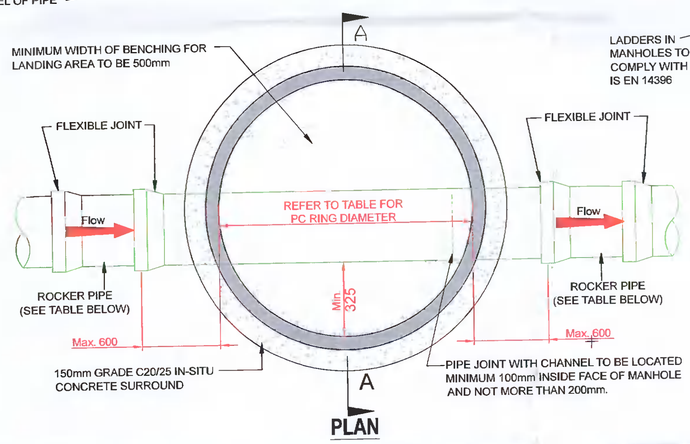

PLAN

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. PRE-CAST MANHOLES UNITS: COMPLYING WITH REQUIREMENTS OF IS EN 1917 AND IS 420.
3. THICKER MANHOLE BASES REQUIRED FOR SEWERS IN EXCESS OF 3m DEEP WHERE THE SIZE IS GREATER THAN THE STANDARD MINIMUM SIZE.
4. APPROVED PRE-CAST CONCRETE BASES MAY BE USED INCORPORATING CHANNELS, BENCHING ETC. SUBJECT TO IRISH WATER REVIEW AND COMPLYING WITH ISEN 1719 AND IS 420.
5. STRUCTURAL DESIGN AND REINFORCEMENT DETAILS TO BE PROVIDED BY THE DEVELOPER AND SUBMITTED TO IRISH WATER FOR REVIEW.
6. MANHOLES GREATER THAN 3m IN DEPTH WILL REQUIRE A DETAILED STRUCTURAL DESIGN AND BE SUBJECT TO IRISH WATER REVIEW.
7. MANHOLE ROOFS SHALL CONSIST OF A RE-INFORCED CONCRETE SLAB OF IN-SITU CONCRETE, C30/37, WITH A MINIMUM THICKNESS OF 225mm DESIGNED TO CARRY ALL LIVE AND DEAD LOADS. ALTERNATIVELY, APPROVED PRE-CAST CONCRETE ROOF SLABS MAY BE USED SUBJECT TO IRISH WATER REVIEW AND COMPLIANCE WITH IS EN 1917
8. COVERS AND FRAMES SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS SUBJECT TO REVIEW BY IRISH WATER.
9. 200mm ALL AROUND x 100mm DEEP, C20/25 CONCRETE PLINTH COMPLETE WITH BULL NOSE FINISH AND TO BE PROVIDED COMPLETE WITH MILD STEEL REINFORCEMENT LINK AROUND COVERS IN GREEN AREAS.
10. ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO REVIEW BY IRISH WATER.
11. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206 : 2013.
12. ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
13. NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
14. EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
15. IF DEPTH FROM GROUND TO PIPE SOFFIT IS GREATER THAN 6m DEEP, A SITE SPECIFIC ENGINEERED SOLUTION FOR ACCESS SHALL BE PROVIDED.
16. PROPRIETARY WATERTIGHT PCC MANHOLE RING SYSTEMS WITH A WALL THICKNESS > 125mm, & A WATER TIGHT JOINT SEALING SYSTEM, MAY BE USED WITHOUT CONCRETE SURROUND, SUBJECT TO THE GROUND WATER LEVEL AT THE MANHOLE BEING LOW, & SUBJECT TO REVIEW BY IRISH WATER.
17. THE INTERNAL MANHOLE DIAMETERS SHOWN IN THE TABLE BELOW ARE MINIMUM DIMENSIONS AND WILL INCREASE DEPENDING ON THE NUMBER AND DIAMETER OF ADDITIONAL INLETS AND FINISHED WITH A 1:3 SAND/CEMENT FINISH TO SUIT FLOW OF INLETS AND OUTLET.

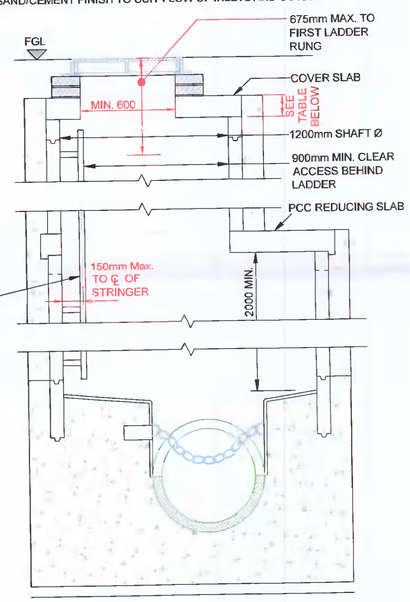

MANHOLE DETAIL > 3m & < 6m GROUND TO SOFFIT DEPTH

(NOTE: ON MANHOLES <1.5mØ, REDUCING SLAB NOT TO BE USED & PCC RINGS TO CONTINUE UP TO COVER SLAB)

MINIMUM MANHOLE DIAMETERS			
DIAMETER OF LARGEST PIPE IN MANHOLE (mm)	INTERNAL DIAMETER OF MANHOLE (mm)	MIN. PRECAST ROOF SLAB EFFECTIVE THICKNESS (mm)	MIN. IN-SITU ROOF SLAB THICKNESS (mm)
LESS THAN 375	1200	160	225
375 TO 450	1350	160	225
500 TO *50	1500	170	225

ROCKER PIPE LENGTH	
PIPE DIAMETER (mm)	ROCKER PIPE LENGTH (mm)
150 TO 600	600
GREATER THAN 600 *TO 750	1000
GREATER THAN *750	1250

*SEWERS GREATER THAN 450mm Ø ARE OUTSIDE THE SCOPE OF THE STANDARD DETAILS. MANHOLE SIZE OF THESE CHAMBERS MAY BE REUIRED DUE TO MULTIPLE PIPES WITHIN MANHOLE.

STD-WW-10 PRECAST CONCRETE MANHOLE WITH CAST IN SITU BASE

NTS

NOTE:
PRECAST CONCRETE MANHOLES SHALL ONLY BE USED WHERE THE WATER TABLE IS LOW. THEY SHALL NOT BE USED WHERE THERE IS A PERCHED WATER TABLE, WHERE THE SEWER IS LOCATED NEXT TO A RIVER, LAKE OR OTHER WATER BODY AND WITHIN AREAS THAT ARE IDENTIFIED BY THE OFFICE OF PUBLIC WORKS CATCHMENT FLOOD RISK ASSESSMENT AND MANAGEMENT (CFRAM) WITH A FLOOD RISK OF 1 IN 10 YEARS.

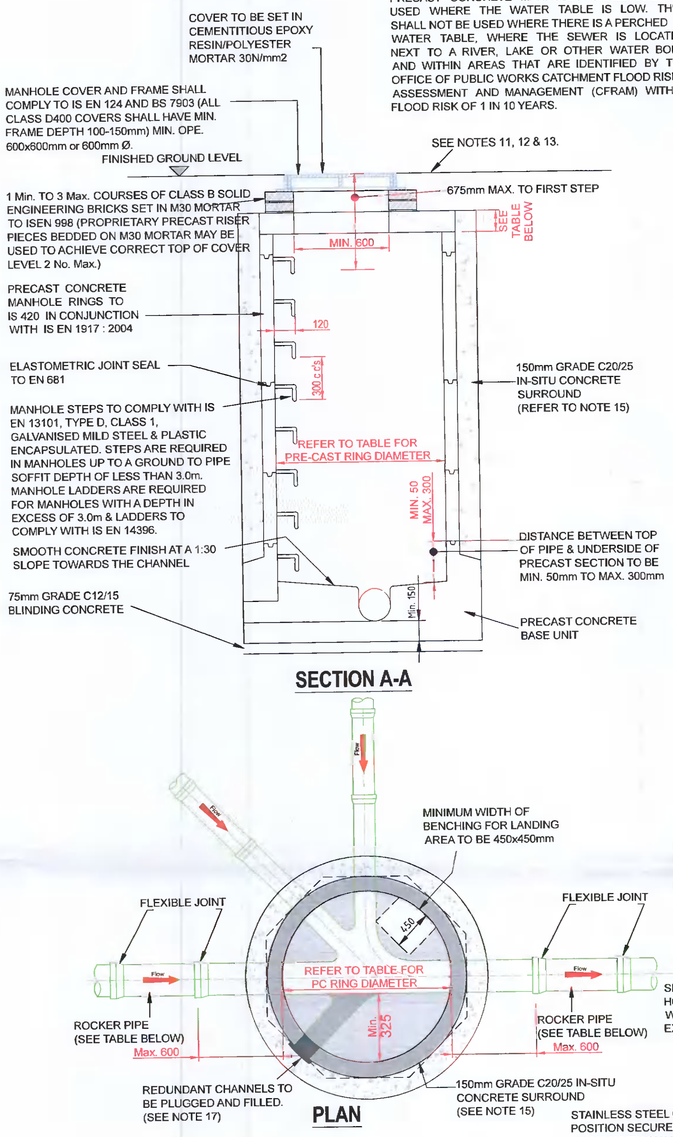

SECTION A-A

PLAN

NOTE:
IF FLEXIBLE PIPES ARE BEING USED, ROCKER PIPES ARE NOT REQUIRED.

MINIMUM MANHOLE DIAMETERS			
DIAMETER OF LARGEST PIPE IN MANHOLE (mm)	INTERNAL DIAMETER OF MANHOLE (mm)	MIN. PRECAST ROOF SLAB EFFECTIVE THICKNESS (mm)	MIN. IN-SITU ROOF SLAB THICKNESS (mm)
LESS THAN 375	1200	160	225
375 TO 450	1350	160	225
500 TO 750	1500	170	225

ROCKER PIPE LENGTH	
PIPE DIAMETER (mm)	ROCKER PIPE LENGTH (mm)
150 TO 600	600
GREATER THAN 600 TO 750	1000
GREATER THAN 750	1250

*SEWERS GREATER THAN 450mm Ø ARE OUTSIDE THE SCOPE OF THE STANDARD DETAILS. MANHOLE SIZE OF THESE CHAMBERS MAY BE REUIRED DUE TO MULTIPLE PIPES WITHIN MANHOLE.

STD-WW-10A PRECAST CONCRETE MANHOLE & BASE

NTS

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. PRE-CAST MANHOLES UNITS: COMPLYING WITH REQUIREMENTS OF IS EN 1917 AND IS 420.
3. PRE-CAST CONCRETE BASE INCORPORATING CHANNELS, BENCHING ETC. SUBJECT TO IRISH WATER REVIEW ANDCOMPLYING WITH ISEN 1917 & IS 420.
4. IN SITUATIONS WHERE P.C.C. MANHOLE BASES HAVE REDUNDANT CHANNELS, THESE SHALL BE PLUGGED AND FILLED BY SCABBLING, AND INFILLED WITH GRADE C20/25 CONCRETE TO MATCH EXISTING BASE AND BENCHED TO SUIT FLOW WITHIN THE MANHOLE BASE..
5. MANHOLES GREATER THAN 3m IN DEPTH WILL REQUIRE A DETAILED STRUCTURAL DESIGN AND BE SUBJECT TO IRISH WATER REVIEW.
6. PRE-CAST CONCRETE ROOF SLABS TO BE USED SUBJECT TO IRISH WATER REVIEW AND COMPLIANCE WITH IS 420.
7. COVERS AND FRAMES SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS SUBJECT TO REVIEW BY IRISH WATER.
8. 200mm ALL AROUND x 100mm DEEP, C20/25 CONCRETE PLINTH COMPLETE WITH BULL NOSE FINISH AND TO BE PROVIDED COMPLETE WITH MILD STEEL REINFORCEMENT LINK AROUND COVERS IN GREEN AREAS..
9. ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO REVIEW BY IRISH WATER.
10. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206 : 2013.
11. ANY SPECIAL ROAD REINSTATEMENT AROUND COVER & FRAME SHALL BE TO ROAD AUTHORITY'S REQUIREMENTS.
12. NEW ROAD CONSTRUCTION & SURFACE FINISH TO BE TO ROAD AUTHORITY REQUIREMENTS.
13. EXISTING ROAD REINSTATEMENT TO COMPLY WITH CURRENT VERSION OF "GUIDELINES FOR MANAGING OPENINGS IN PUBLIC ROADS" BY THE DEPT. OF TRANSPORT, TOURISM & SPORT, OR TRANSPORT INFRASTRUCTURE IRELAND REQUIREMENTS.
14. IF DEPTH FROM GROUND TO PIPE SOFFIT IS GREATER THAN 6m DEEP, A SITE SPECIFIC ENGINEERED SOLUTION FOR ACCESS SHALL BE PROVIDED.
15. PROPRIETARY WATERTIGHT PCC MANHOLE RING SYSTEMS WITH A WALL THICKNESS > 125mm, & A WATER TIGHT JOINT SEALING SYSTEM, MAY BE USED WITHOUT CONCRETE SURROUND, SUBJECT TO THE GROUND WATER LEVEL AT THE MANHOLE BEING LOW, & SUBJECT TO REVIEW BY IRISH WATER.
16. THE INTERNAL MANHOLE DIAMETERS SHOWN IN THE TABLE BELOW ARE MINIMUM DIMENSIONS AND WILL INCREASE DEPENDING ON THE NUMBER AND DIAMETER OF ADDITIONAL INLETS AND FINISHED WITH A 1:3 SAND/CEMENT FINISH TO SUIT FLOW OF INLETS AND OUTLET.

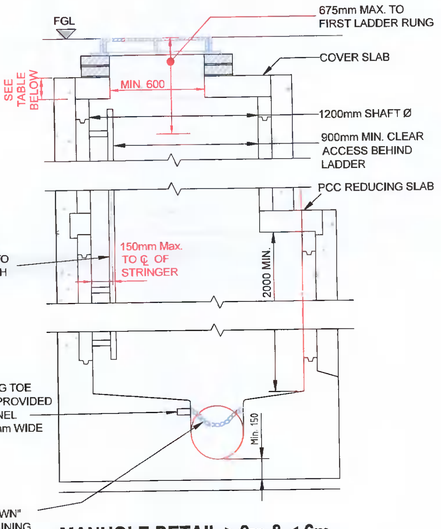

MANHOLE DETAIL > 3m & < 6m GROUND TO SOFFIT DEPTH

(NOTE: ON MANHOLES <1.5mØ, REDUCING SLAB NOT TO BE USED & PCC RINGS TO CONTINUE UP TO COVER SLAB)

NOTES
1. For setting out refer to Architect's drawings.
2. This drawing to be read in conjunction with all other Architectural and Engineering drawings and all other relevant drawings and Specifications.
3. DO NOT SCALE THIS DRAWING. Use figured dimensions only.
4. No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of GKCE LTD as copyright holder except as agreed for use on the project for which the document was originally issued.

- [ ] PROGRESS
- [x] PLANNING
- [ ] TENDER
- [ ] CONSTRUCTION

Issued To	Date	No. Of Copies
Architect		
Quantity Surveyor		
Main Contractor		
M.& E. Engineers		
Client		
Clerk of Works		

Rev	By	Date	Description
A	AA	27.05.2022	DRAINAGE

Scales: AS SHOWN | A1 | Date: MAY2022 | Drawn: AA | Checked:

JOB TITLE
PROPOSED RESIDENTIAL DEVELOPMENT AT THE REAR OF NO.13 NEWLANDS DRIVE,CLONDALKIN
Client:H.H.M Investments Ltd

DRG. TITLE
DRAINAGE DETAILS SHEET 2

GK Consulting Engineers LTD
Consulting Engineers
Unit 12 Millbank Business Centre K78CF75
ph 018749322
email office@gkce.ie
www.gkce.ie

DRAWING NUMBER: GK21214—C202
REV: A