


ALL DIMENSIONS TO BE CHECKED ON SITE
NO DIMENSIONS TO BE SCALED FROM THIS DRAWING
DRAWING IS TO BE READ IN CONJUNCTION WITH RELEVANT CONSULTANTS DRAWINGS



10400 Rodgers Road
Houston, Texas 77070
Phone: 281-374-8644
Fax: 281-374-8992

Henry J Lyons

Architecture + Interiors
henryjlyons.com
+353 1 888 3333
info@henryjlyons.com
51-54 Pearse Street
Dublin D02 K458

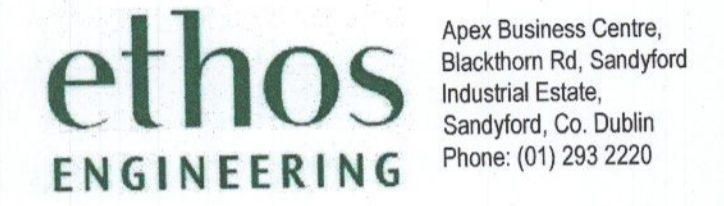

Apex Business Centre,
Blackthorn Rd, Sandyford
Industrial Estate,
Sandyford, Co. Dublin
Phone: (01) 293 2220




SIXTH FLOOR PROSPECT HOUSE 100 NEW OXFORD
STREET LONDON WC1A 1HB Tel: 0207 0433410



LEGEND

- PROPOSED PRIVATE SURFACE WATER SEWER
- PROPOSED PRIVATE FOUL SEWER
- EXISTING PRIVATE FOUL WATER SEWER
- EXISTING PRIVATE SURFACE WATER SEWER
- EXISTING PUBLIC FOUL SEWER
- EXISTING PUBLIC SURFACE WATER SEWER
- MANHOLE BACKDROP
- DRAINAGE CHANNEL
- PROPOSED SW INTERCEPTOR
- INTERNAL FOUL GULLY PIPE
- ROAD GULLY
- ROOFING EYE
- SUMP UNIT WITH REMOVABLE AIR TRAP
- SOIL VENT PIPE
- STUB STACK
- AIR ADMITTANCE VALVE
- FOUL INTERCEPTOR TRAP
- RAINWATER DOWNPIPE
- SIPHONIC RAINWATER DOWNPIPE

REV	DATE	DESCRIPTION	CHK	DRN
C02	04/07/2022	ISSUED FOR PLANNING	SOR	FJVR
C01	30/11/2020	60% TENDER ISSUE	SOR	FJVR
A	30/10/2020	ISSUED FOR 60%	SOR	FJVR

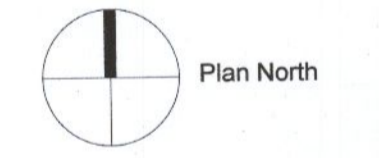

- DRAINAGE NOTES:**
- ALL FOUL SEWERS, MANHOLES AND CONNECTIONS TO BE CONSTRUCTED IN ACCORDANCE WITH IRISH WATER CODE OF PRACTICE FOR WASTEWATER INFRASTRUCTURE AND IRISH WATER WASTEWATER INFRASTRUCTURE STANDARD DETAILS.
 - ALL FOUL SEWER HOUSE CONNECTIONS TO BE MIN 100MM UPVC TO IS EN 1401 2009/2012. STIFFNESS CLASS 8KN/M2 IN ACCORDANCE WITH IRISH WATER SPECIFICATIONS.
 - ALL PUBLIC FOUL SEWERS TO BE MINIMUM 225MM DIAMETER THERMOPLASTIC STRUCTURED WALL PIPES TO IS EN 13746 (2007/2009), TYPE SN8 AND WIS 4-35-01 (2008) AND COMPLY WITH THE REQUIREMENTS OF THE IRISH WATER CODE OF PRACTICE.
 - ALL PUBLIC SURFACE WATER SEWERS TO BE MINIMUM 225 DIA. CLASS H CONCRETE TO EN1916 & IS 6 2004 IN ACCORDANCE WITH THE GREATER DUBLIN REGIONAL CODE OF PRACTICE FOR DRAINAGE WORKS.
 - ALL SURFACE WATER CONNECTIONS TO BE MINIMUM 150MM UPVC TO IS EN 1401 2009/2012 IN ACCORDANCE WITH THE GREATER DUBLIN REGIONAL CODE OF PRACTICE FOR DRAINAGE WORKS.
 - LOCATION AND INVERT LEVELS OF EXISTING MANHOLES OR OUTFLOW POINTS, WHERE APPLICABLE TO BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF DRAINAGE WORKS.
 - ALL FOUL CONNECTIONS TO COMPLY WITH THE REQUIREMENTS OF THE IRISH WATER.
 - ALL FOUL SEWERS TO BE AIR TESTED IN ACCORDANCE WITH IRISH WATER SPECIFICATIONS.
 - ALL COVER LEVELS TO MATCH FINISHED ROAD/VERGE/FOOTPATH/CYCLETRACK LEVELS UNLESS OTHERWISE STATED.
 - CONTRACTOR TO INCLUDE FOR CCTV SURVEY OF ALL SEWERS UPON COMPLETION OF SAME.

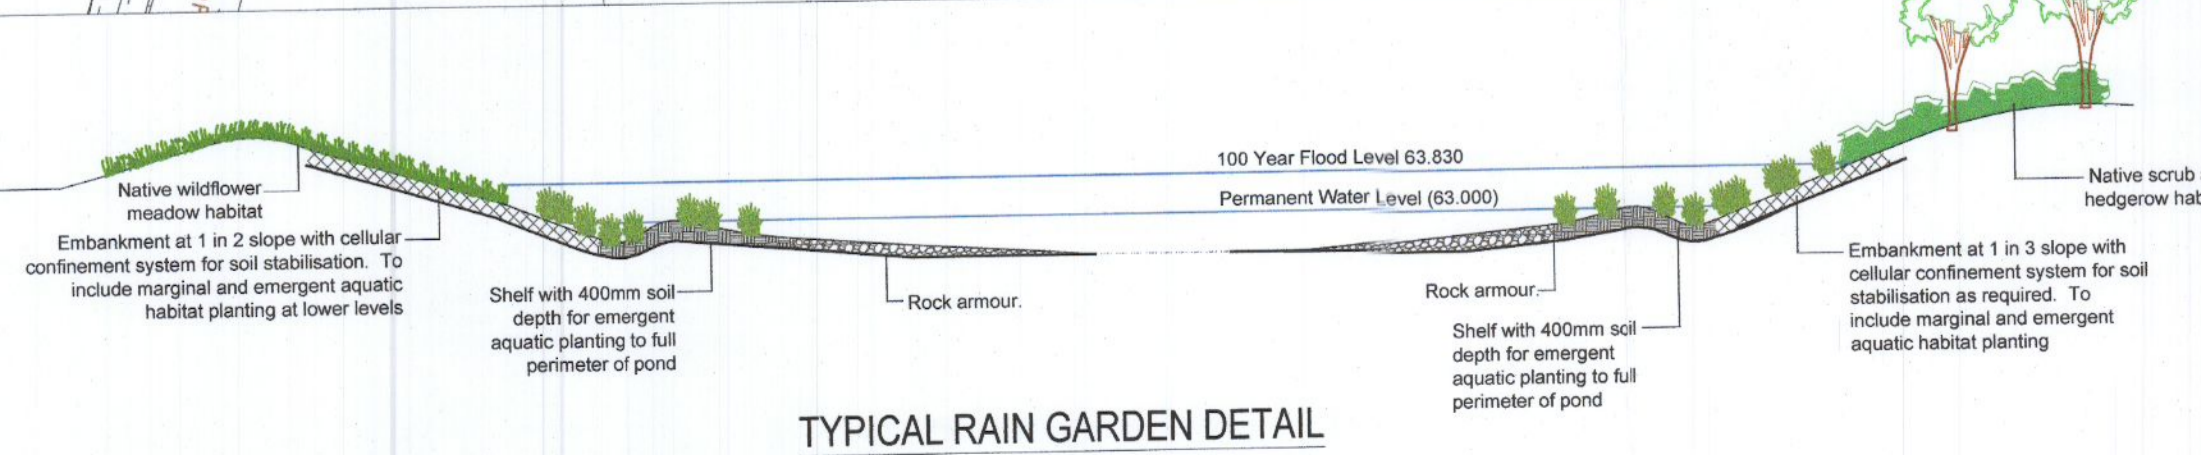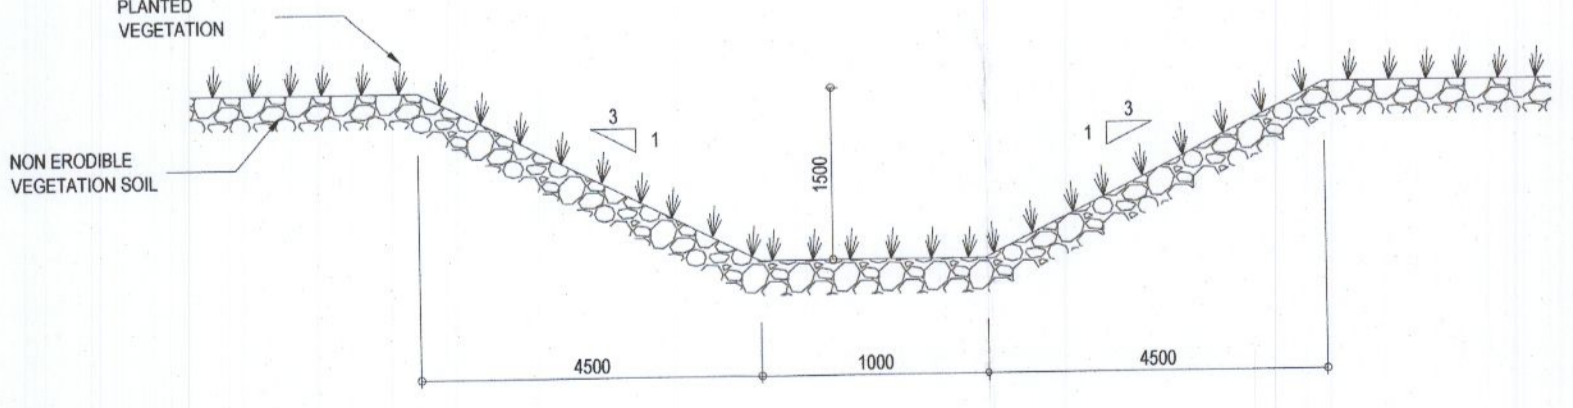

STATUS CODE DESCRIPTION
PLANNING

CLIENT
BCEI

PROJECT
ECCDUB06

DRAWING
PROPOSED DRAINAGE LAYOUT

PROJECT NUMBER
220401
DATE
27.05.2022

SCALE@A1:
1:500
DRAWN/CHECKED:
RKJ/JKM

STATUS CODE: DRAWING NUMBER REVISION
A4 ECCDUB-PIN-06-ZZ-DR-C-201 C02



SIXTH FLOOR PROSPECT HOUSE 100 NEW OXFORD
STREET LONDON WC1A 1HB Tel: 0207 0433410