
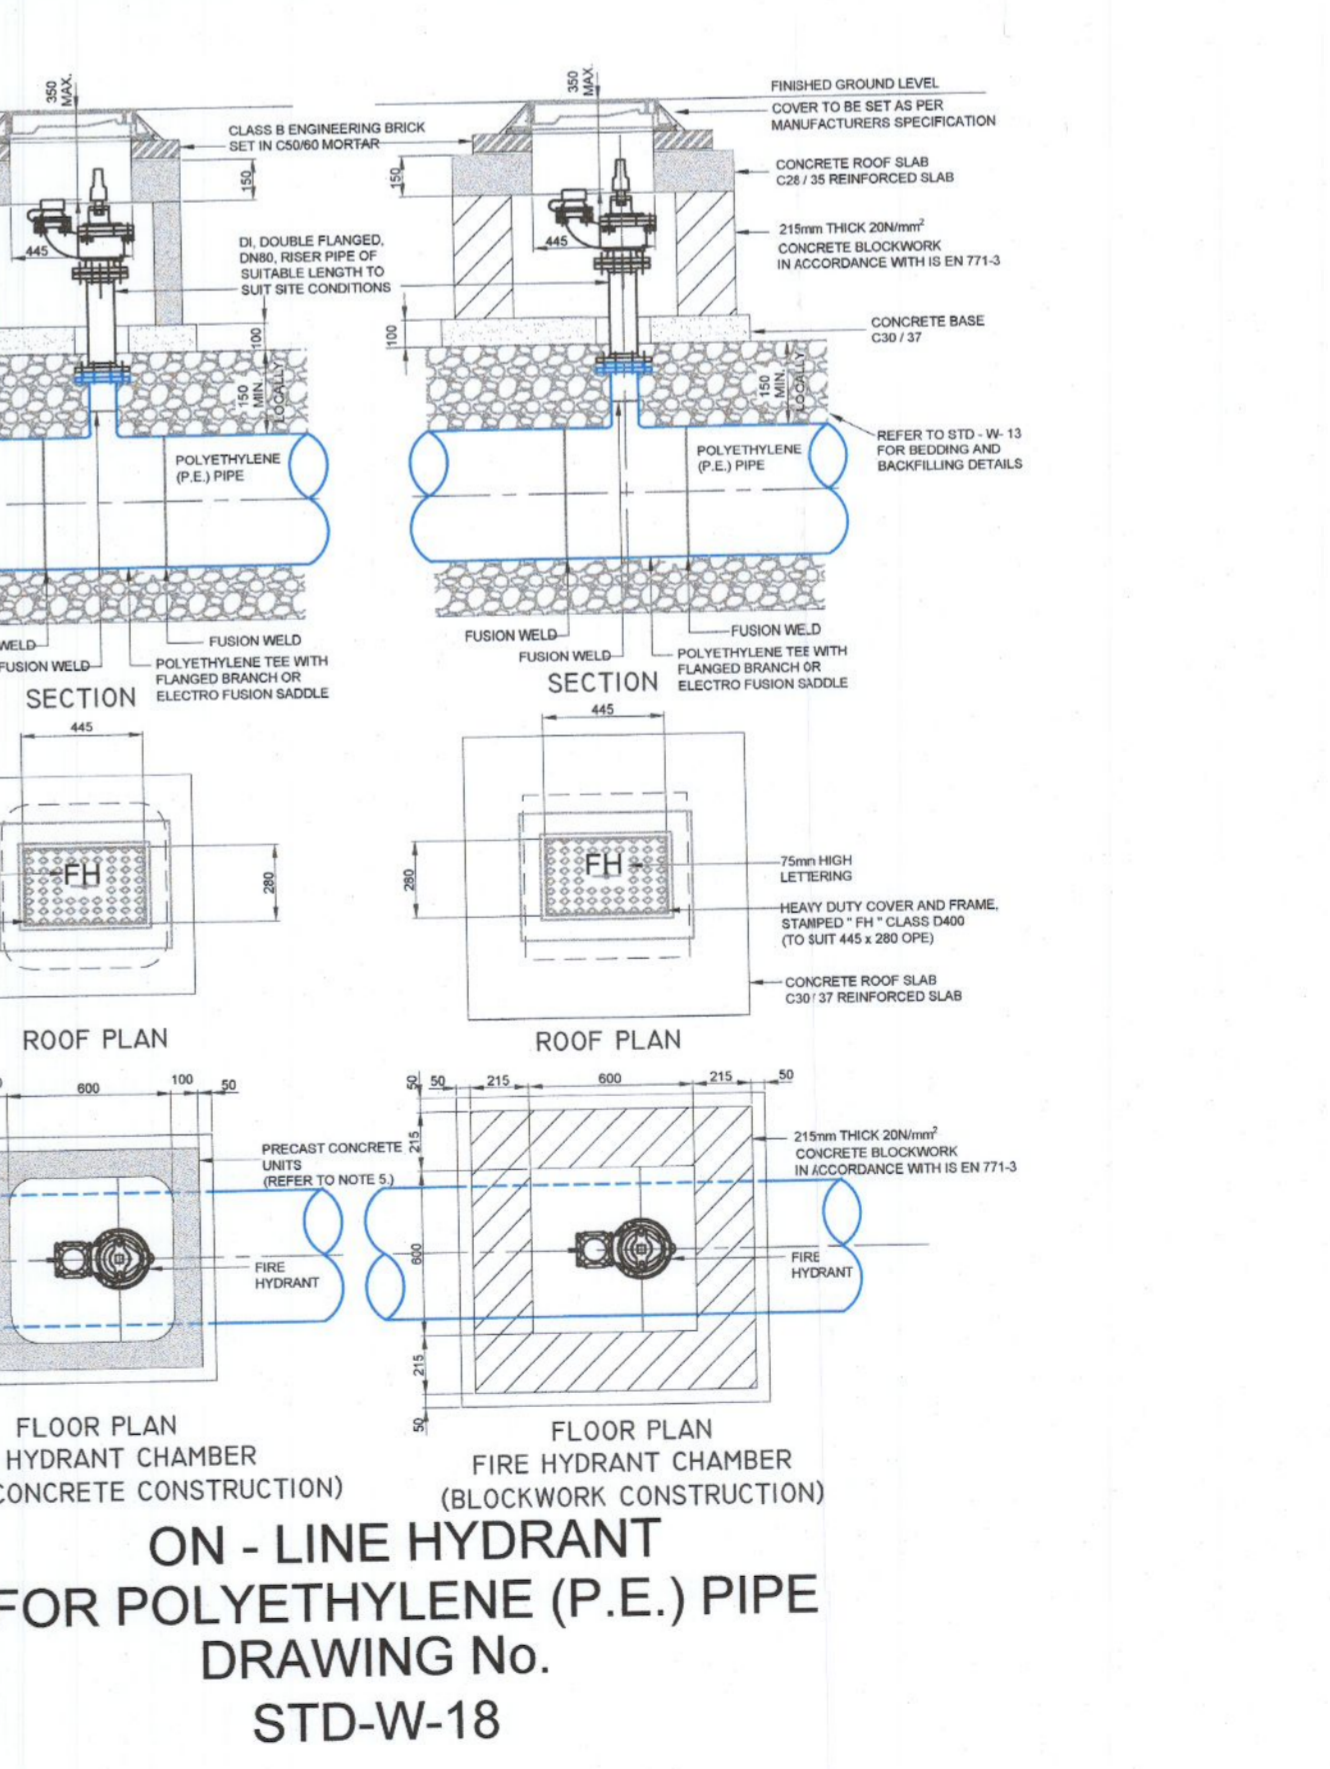
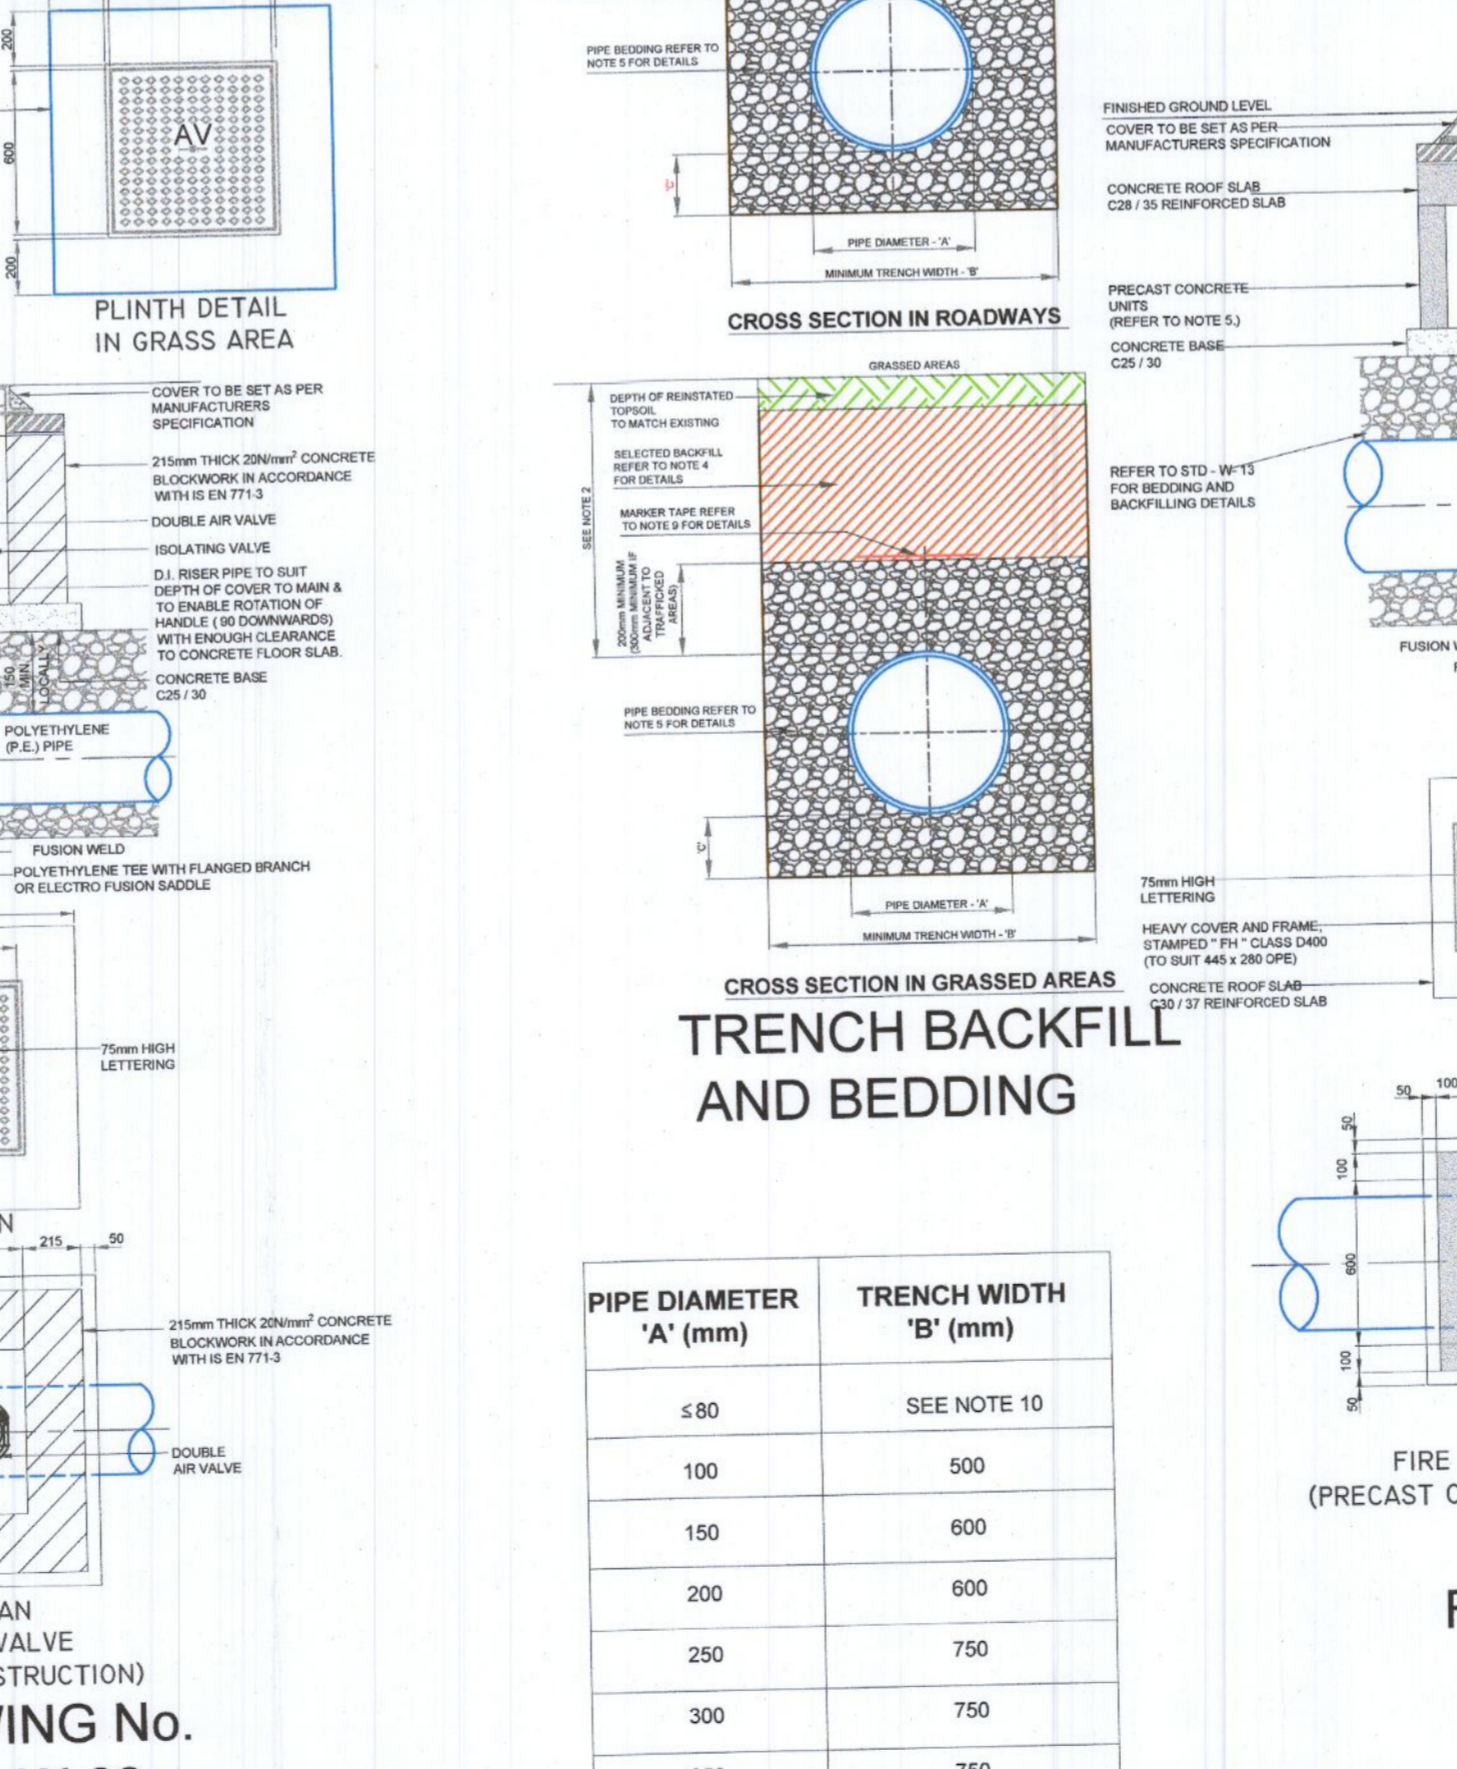
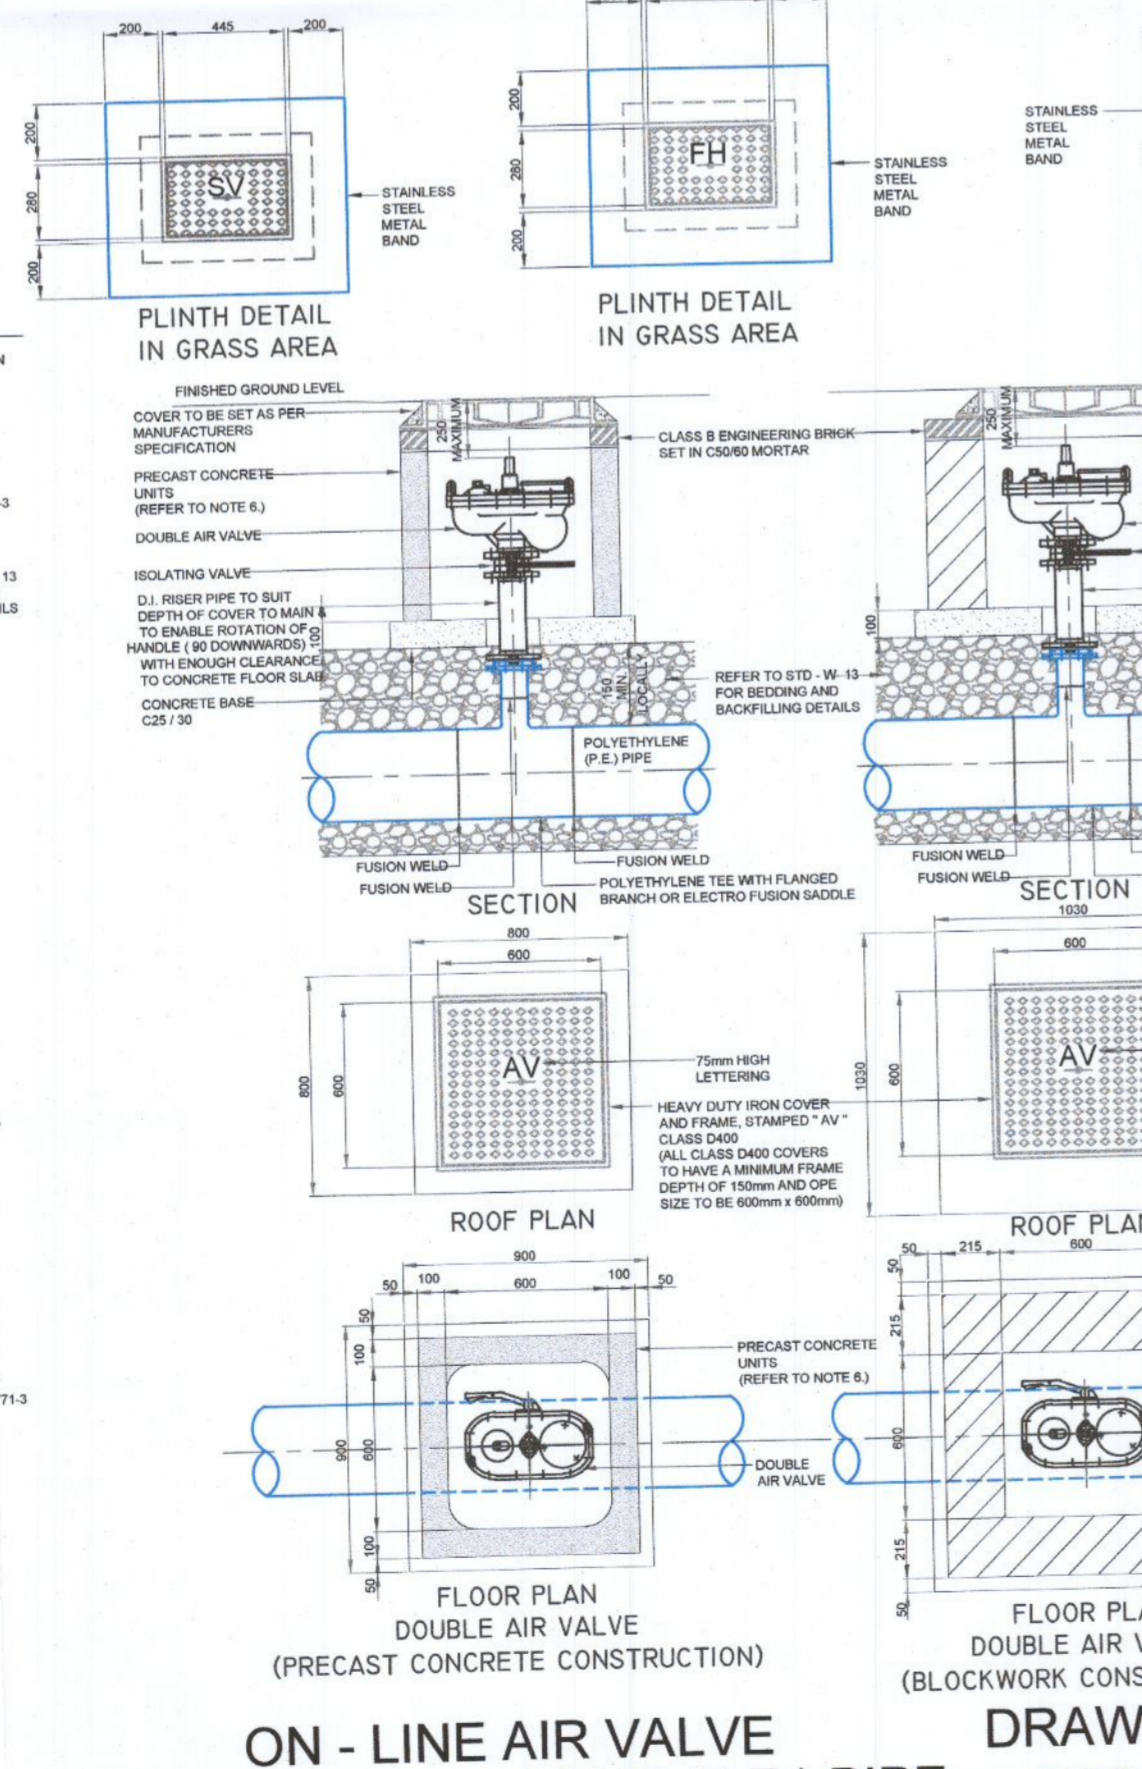
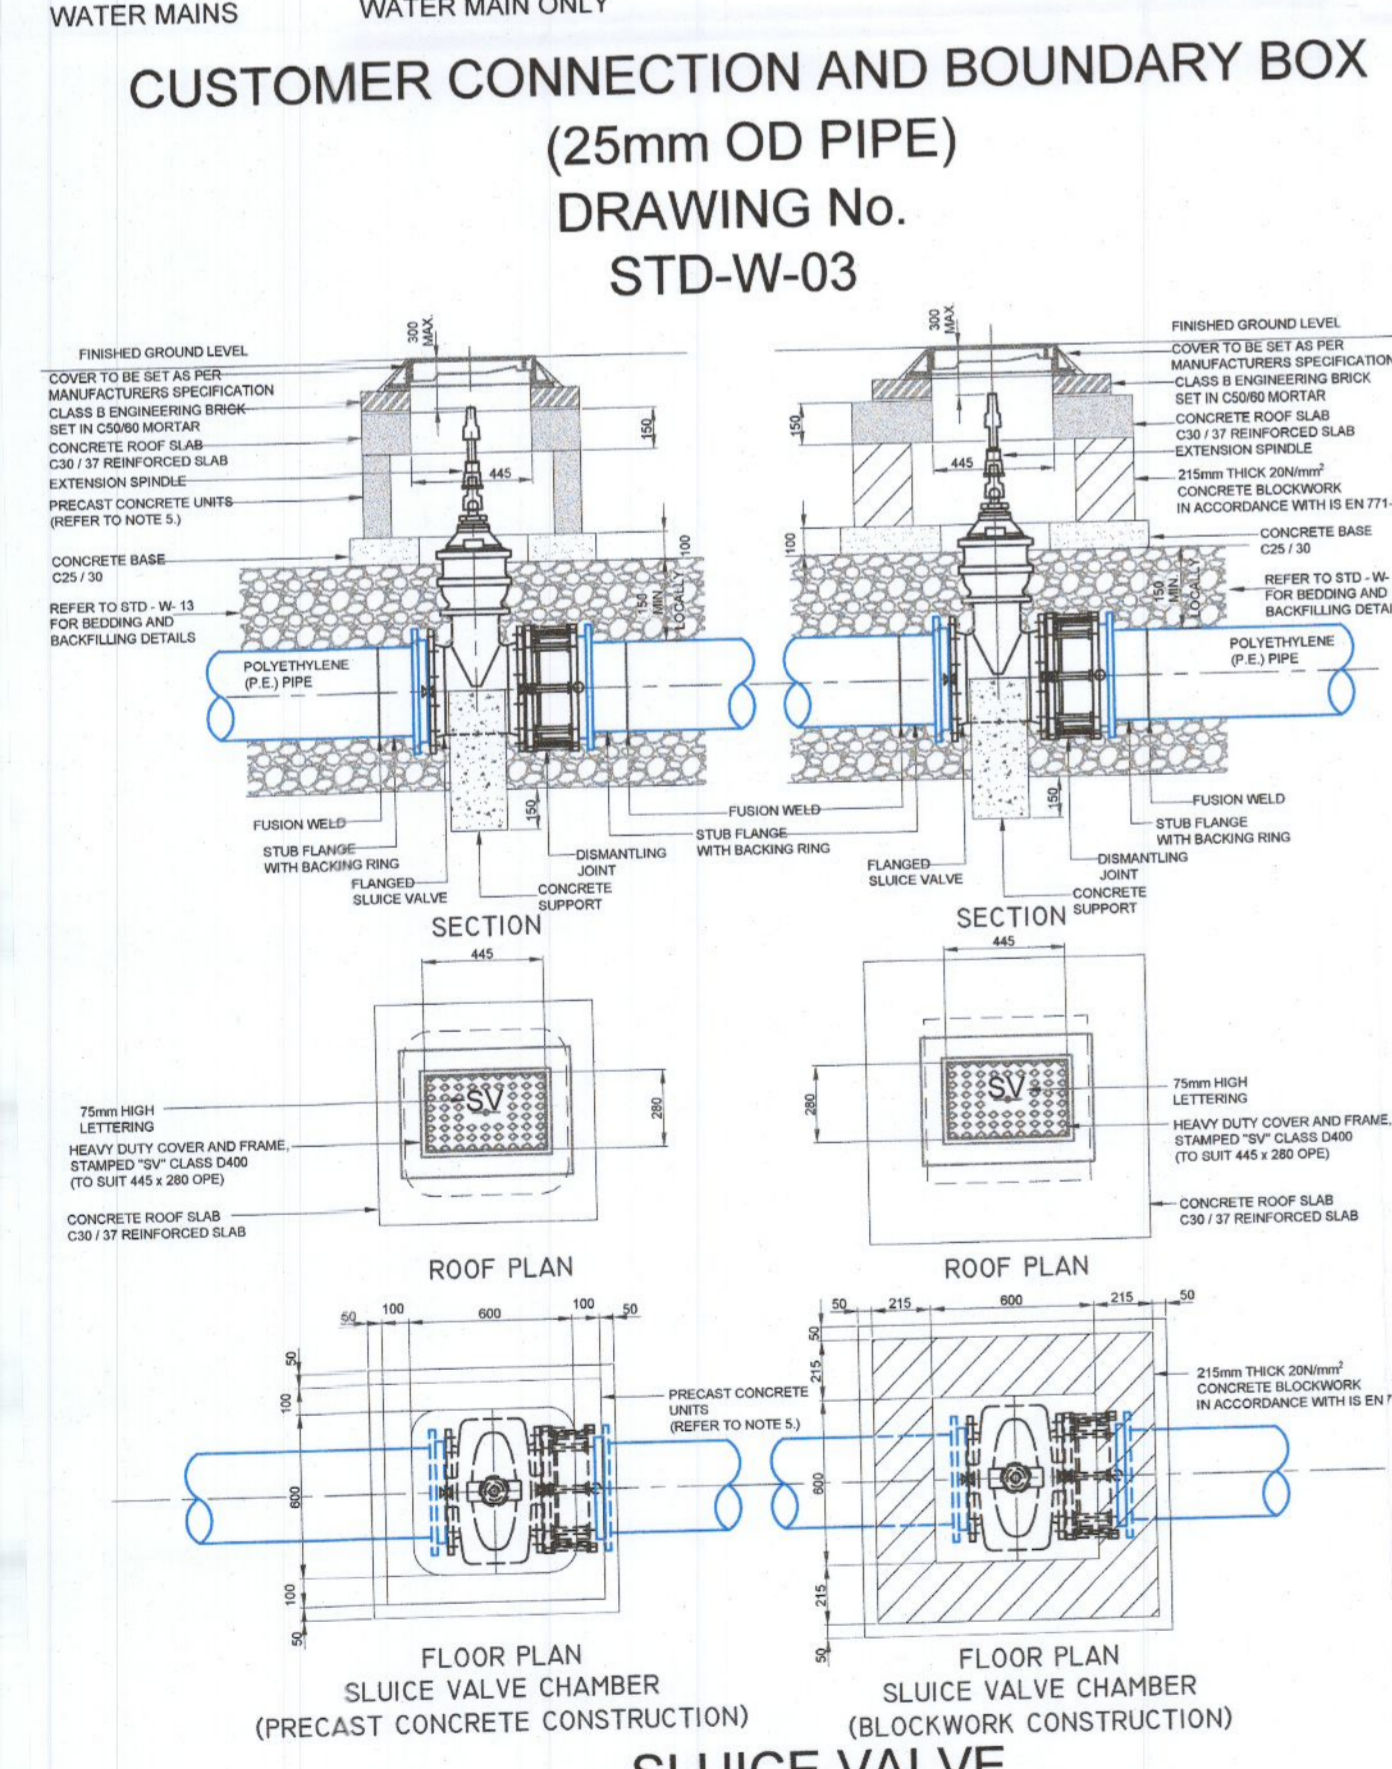
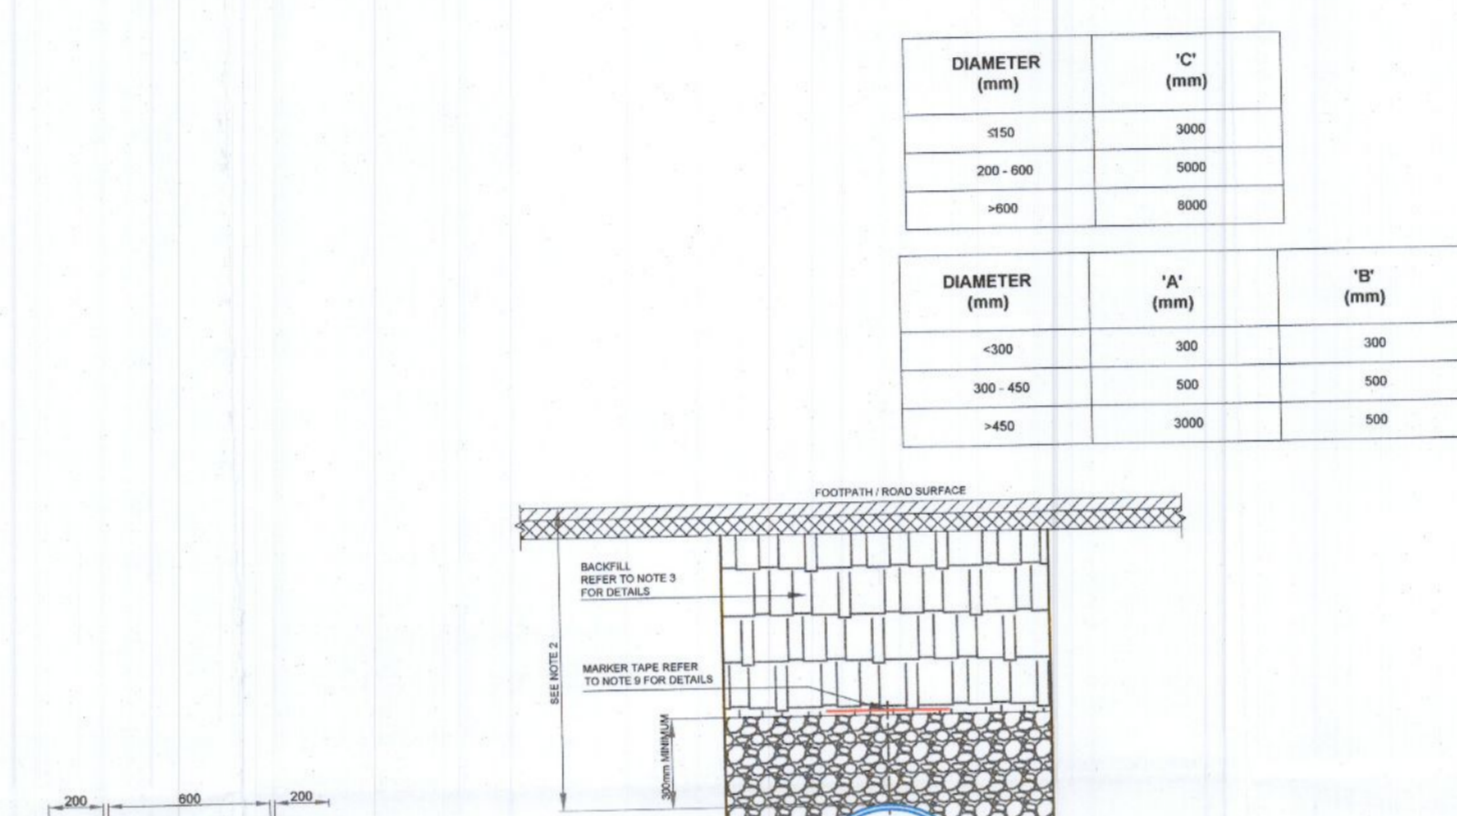
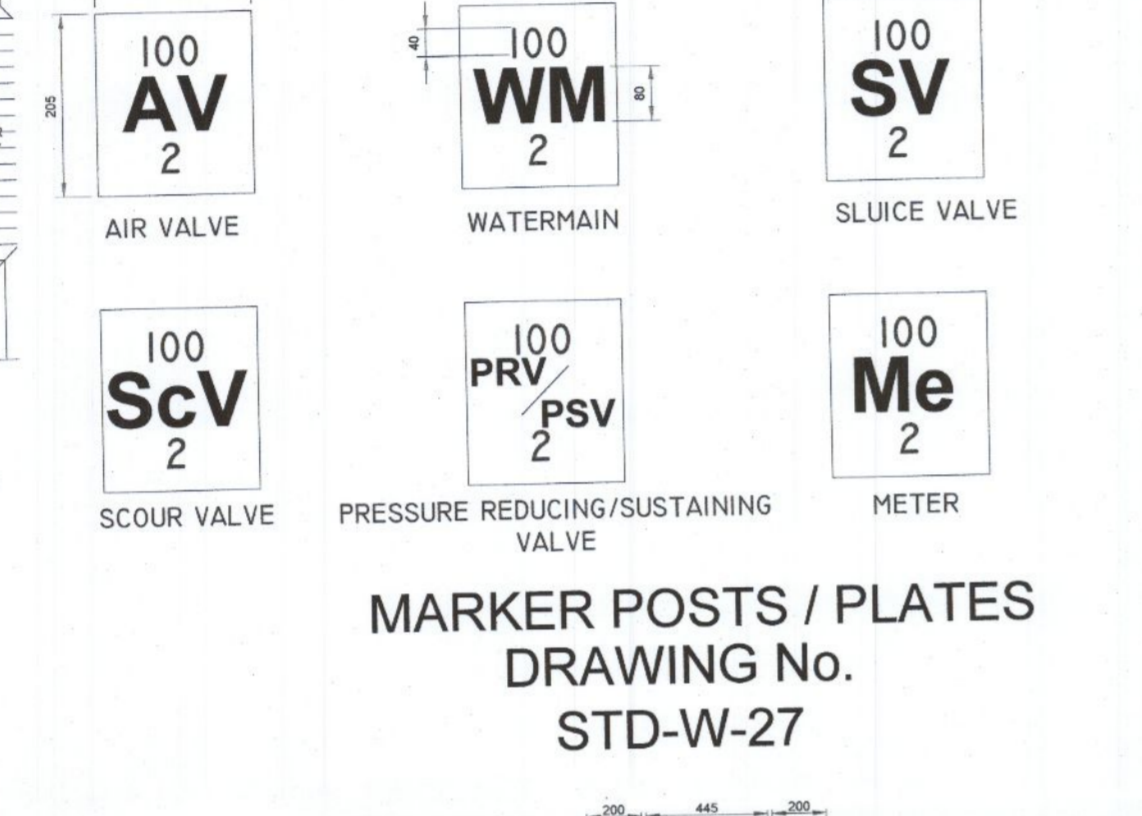
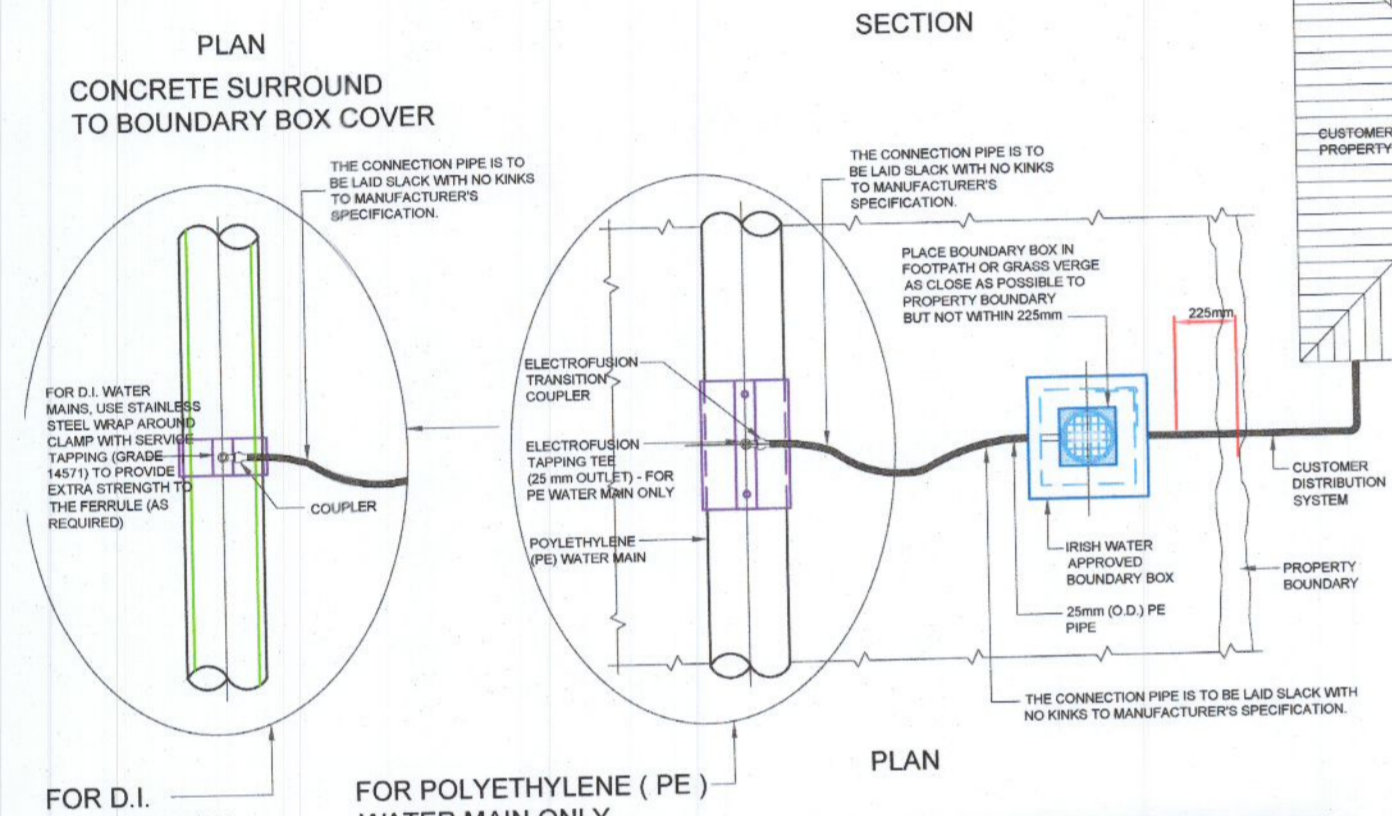
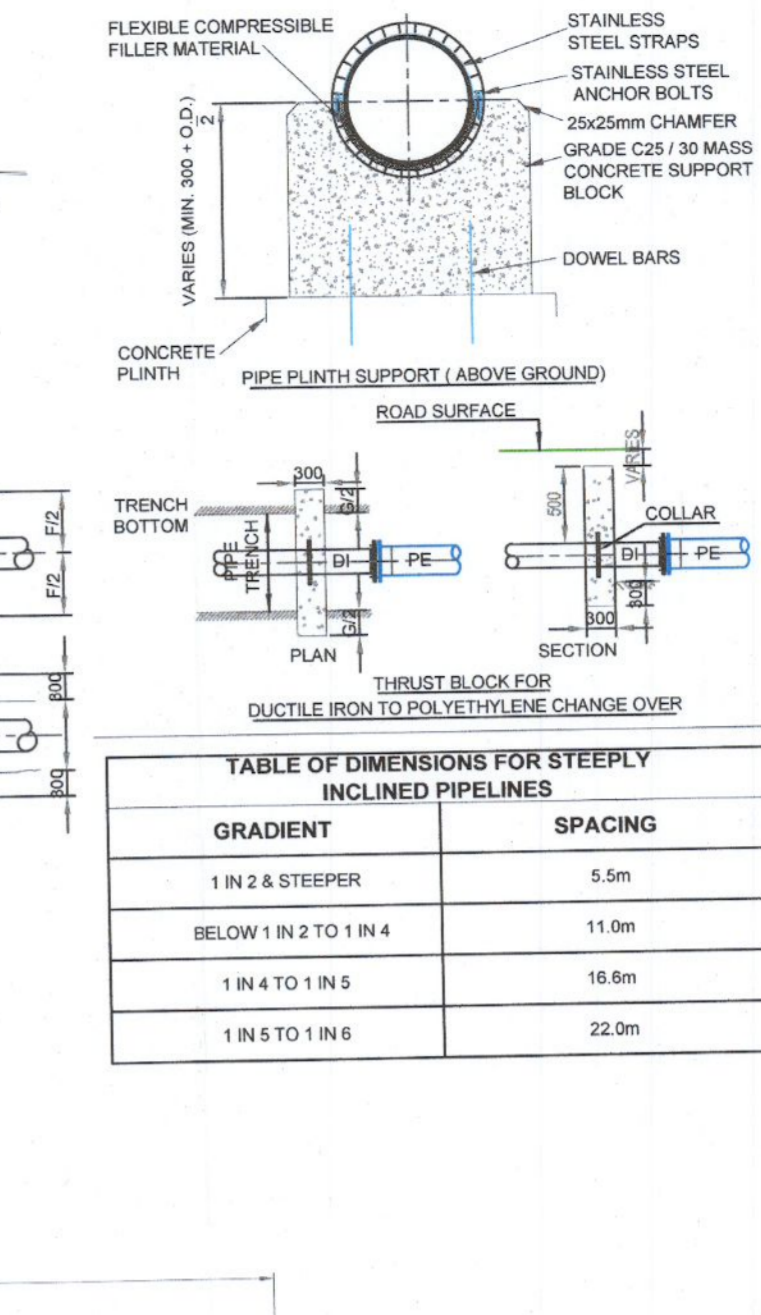
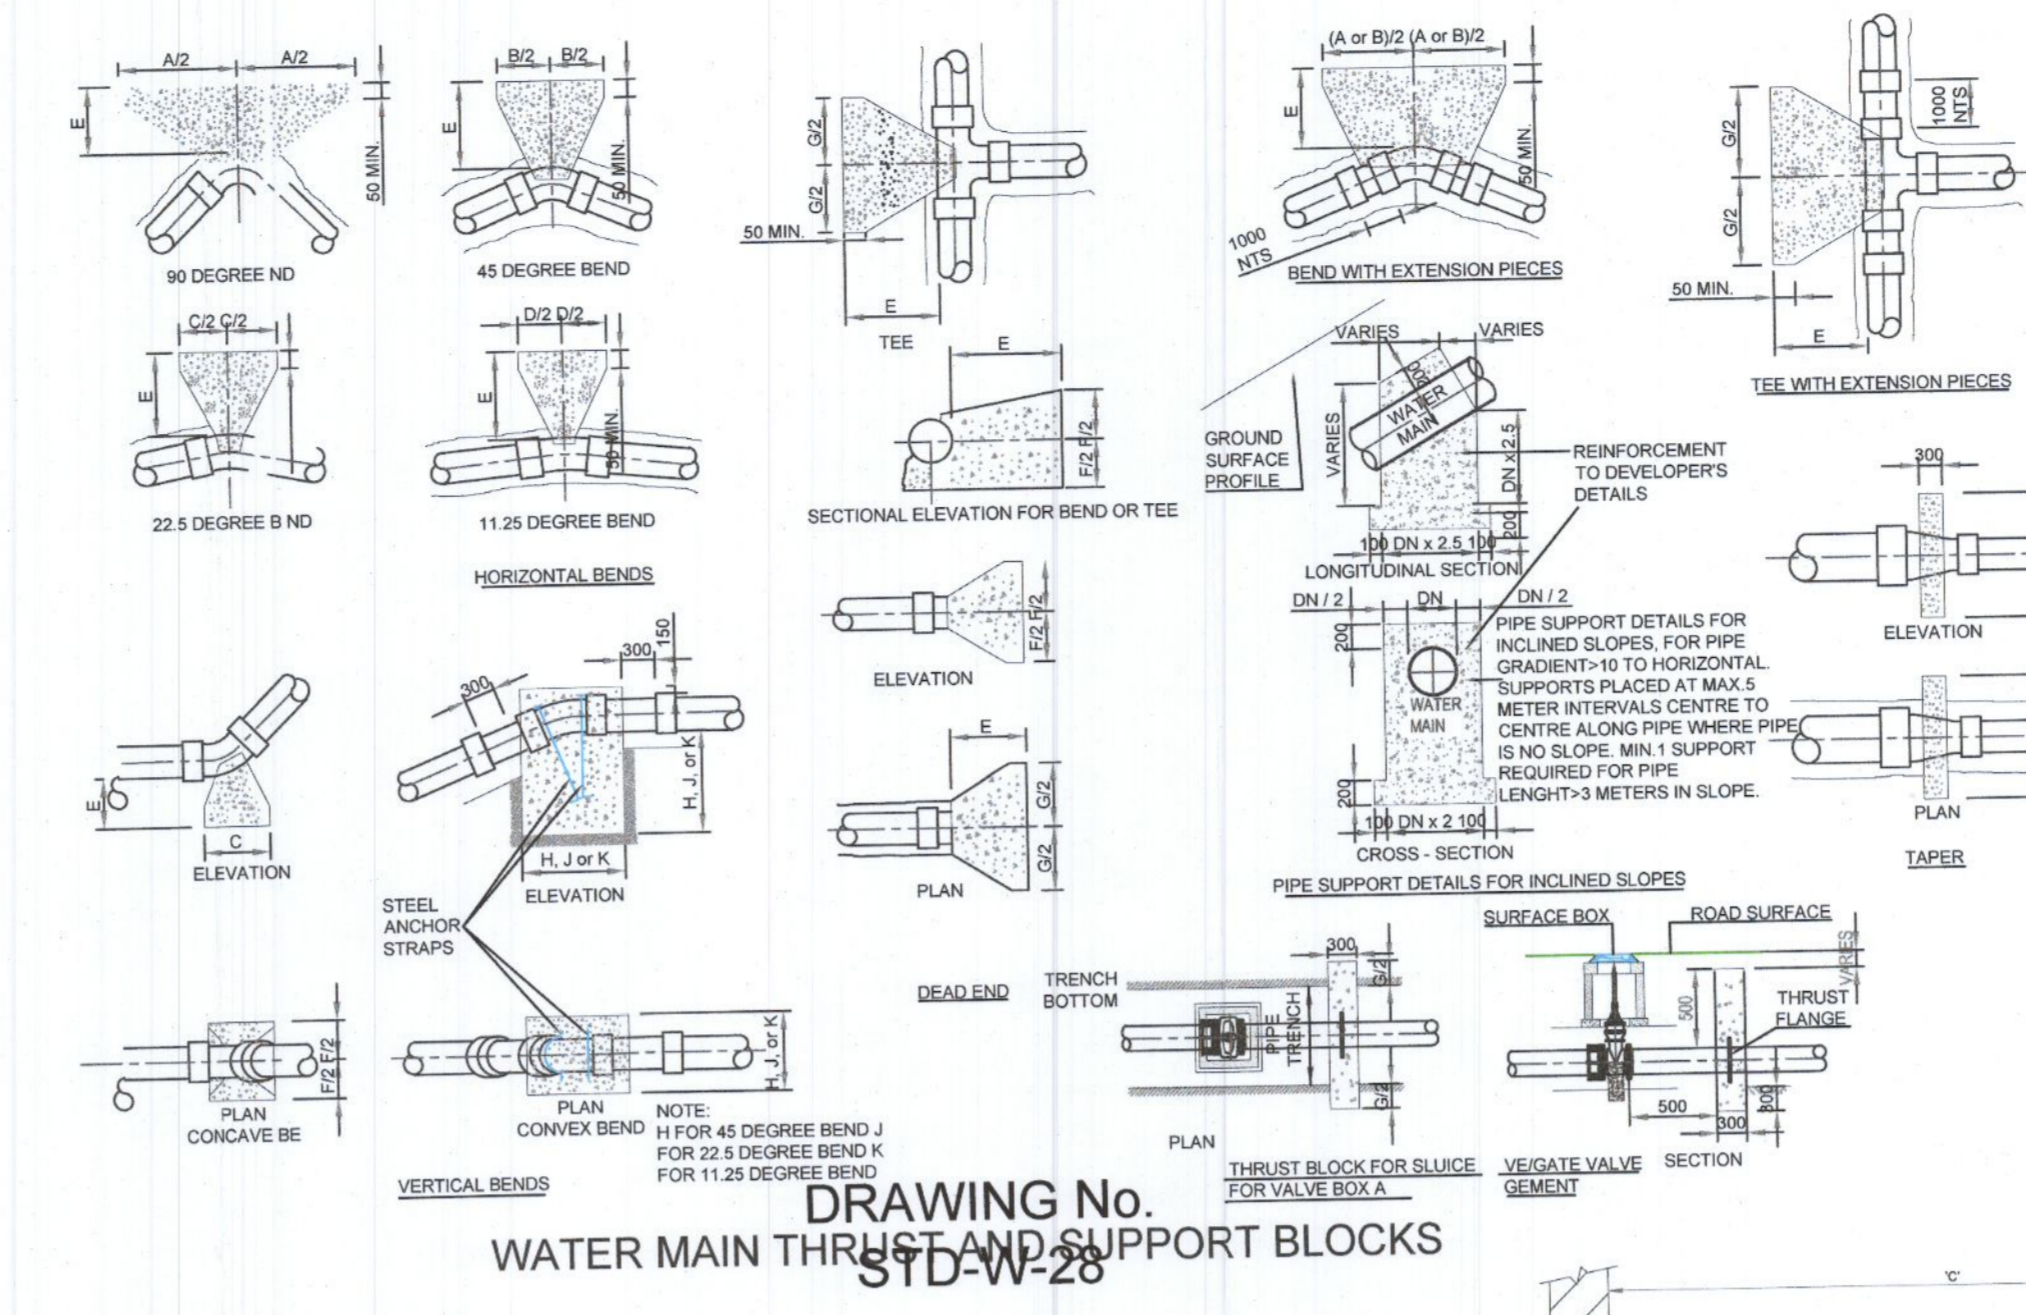


NOTE:
THIS DRAWING TO BE READ IN CONJUNCTION WITH IRISH WATER INFRASTRUCTURE STANDARD DETAILS, DOCUMENT NUMBER: IW-CDS-5020-01, AUGUST 2016. THIS INCLUDES FOR ALL RELEVANT NOTES PERTAINING TO EACH OF THE DETAILS AS INCLUDED.

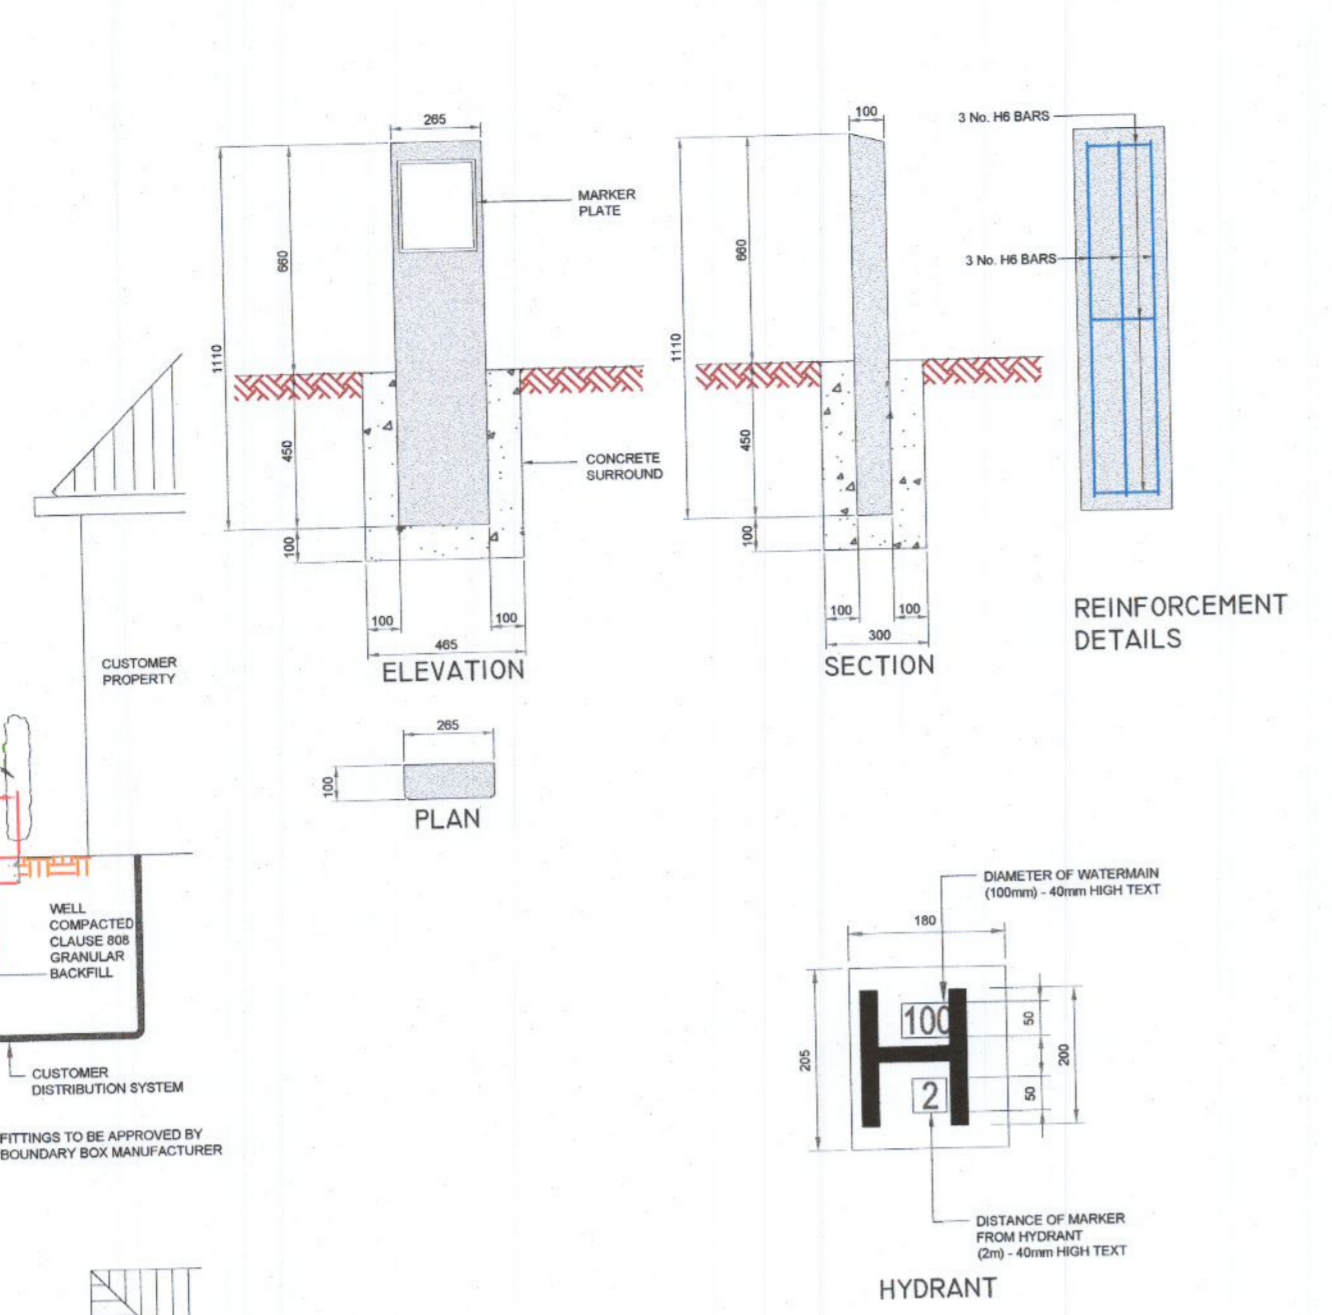

PIPE DIAMETER 'A' (mm)	TRENCH WIDTH 'B' (mm)
≤ 80	SEE NOTE 10
100	500
150	600
200	600
250	750
300	750
350	750
400	900
450	900

PIPE DIAMETER 'A' (mm)	DEPTH OF BEDDING 'C' (mm)
< 200	150
> 250	200

ALL DIMENSIONS TO BE CHECKED ON SITE
NO DIMENSIONS TO BE SCALED FROM THIS DRAWING
DRAWING IS TO BE READ IN CONJUNCTION WITH RELEVANT CONSULTANTS DRAWINGS

edgeconnex
BURR COMPUTER ENVIRONMENTS, INC.

10400 Rodgers Road
Houston, Texas 77070

Phone: 281-374-8644
Fax: 281-374-8992

Henry J Lyons
Architect + Interiors
henryjlyons.com

+353 1 888 3333
info@henryjlyons.com

51-54 Pearse Street
Dublin D02 KA66

ethos ENGINEERING
Apex Business Centre,
Blackthorn Rd, Sandford
Industrial Estate,
Sandford, Co. Dublin
Phone: (01) 293 2220

PINNACLE CONSULTING ENGINEERS
SIXTH FLOOR PROSPECT HOUSE 100 NEW OXFORD STREET LONDON WC1A 1HB Tel: 0207 0433410

REV	DATE	DESCRIPTION	CKH	DRN

STATUS CODE DESCRIPTION
PLANNING

CLIENT
BCEI

PROJECT
ECCDUB06

DRAWING
STANDARD WATER INFRASTRUCTURE DETAILS

PROJECT NUMBER
220401

DATE
27.05.2022

SCALE: AS SHOWN

DRAWN/CHECKED:
RKJ/JKM

STATUS CODE: DRAWING NUMBER REVISION
ECCDUB-PIN-06-ZZ-DR-C-206 C01

PINNACLE CONSULTING ENGINEERS
SIXTH FLOOR PROSPECT HOUSE 100 NEW OXFORD STREET LONDON WC1A 1HB Tel: 0207 0433410