


- WATERMAIN NOTES**
- These are summary notes, refer to Irish Water Code of Practice and Standard Details for full notes and details. Where discrepancy between these and Irish Water publication are identified, Irish Water publications take precedence. All discrepancies should be reported to POGA.
 - The contractor shall agree the exact make, model and closing direction of service valves and hydrants with the Irish Water & the Water Inspector.
 - All boxes shall be as per Irish Water Code of Practice, Connection and Service Developer Services, Water Infrastructure latest standard details.
 - Watermains shall be tested in conjunction with the Irish Water, section 4.10 (Testing and Commissioning) to a minimum pressure of 10 Bars (150psi). The time taken (t) to pressure the watermain loop should be measured on site and the subsequent test held for a minimum duration of 22l. The water pressure should not be topped up during the test. The pressure readings should be recorded at 1 minute intervals and submitted to project engineer for evaluation prior to backfilling.
 - Anchor blocks of grade C20/25 Type F concrete shall be provided on watermains at dead ends, tees, bends of greater curvature than 11.25° and at both sides of sluice valve chambers.
 - All pipework shall be thoroughly flushed out, sterilized with chlorine and then scoured and flushed out again in conjunction with Irish Water Code of Practice, section 4.10.5 and 4.13.
 - Hydrant covers shall be painted canary yellow (BS 381C) and be in paved non-vehicular areas. Hydrant never to be placed in parking bays.
 - Where Watermains terminating in a loop, provide connection to a minimum of four properties and a hydrant. See section 3.5.14 of Irish Water Code of Practice.
 - Provide an offline hydrant downstream of the proposed bulk meter locations. See section 3.15.4 of Irish Water Code of Practice and STD-W-27 of Water Infrastructure Standard Details.
 - Distribution Watermains shall be laid in public areas and be kept a minimum distance from existing structures and trees and shrubs. Distance to be specified in Irish Water Code of Practice, Connection and Service Developer Services, Water Infrastructure standard detail, STD-W11 & STD-W-12 respectively.
 - Where water main is required to be laid in roadway, please ensure that this is located a way from the kerb line, refer to 3.5.8-3.5.13 of the Irish Water Code of Practice.
 - Watermain 150mm diameter and smaller shall be located a minimum of 3m for a structure and 1m from a boundary wall.
 - Air valves shall be provided at all summits on pipelines of 110mm(D) Ø or greater.
 - Pipes should be joined strictly in accordance with manufacturer's requirements.
 - All pipes blue in colour, be HDPE or MDPE for 25mm to 80mm diameters & HDPE or Ductile Iron for minimum 100mm to 300mm inside diameters, or HDPE or Ductile Iron for a minimum 350 to 600mm internal diameters. An example is, 150 internal diameter watermain pipe should be: 180mm outside diameter, SDR-17 and PE-100, this gives an internal dia (from Wavin'ssupersure range) of 158mm. The 100mm internal diameter should be 125mmOD, SDR-17 and PE-100, this gives an internal dia of 109.5mm.
 - HDPE and HDPE pipes to be:
 - Type PE-100
 - SDR-17 rating
 - Compliance with IS EN 12201: Part 1 and Part 2 (Plastic Systems for Water Supply, Drainage and Sewerage Under Pressure - Part 1, General, and Part 2, Pipes)
 - Compliance with I.S. EN 12201-3 (Plastic Systems for Water Supply, Drainage and Sewerage Under Pressure - Part 3, Fittings)
 - ALL PE pipes shall also conform to the following UK Water Industry Specifications:
 - 4-32-08 - Specification for the fusion joining of polyethylene pressure pipeline systems using PE80 and PE100 materials
 - 4-32-18 - Specification for Butt Fusion Joining Machines
 - 4-32-19 - Specification for polyethylene pressure pipeline systems with an aluminium barrier layer for potable water supply in contaminated land
 - IGN 4-01-03 - Pressure Testing of Pressure Pipes and Fittings for use by Public Water Supplies
 - For pipes greater than 600mm refer to Engineer for approval.
 - All Watermain pipes to have minimum 10 bar working pressure rating.
 - Cover to Watermains in roadways as per Irish Water Code of Practice latest, Connection and Service Developer Services, Water Infrastructure standard details.
 - All changes in both vertical and horizontal alignment greater than 4° to be supported by a concrete anchor block.
 - Air valve locations to be accurately set out at summit points on site.
 - All watermains to be backfilled as per as per Irish Water Code of Practice latest, Connection and Service Developer Services, Water Infrastructure standard details, STD-W-13.
 - Service pipes to be a minimum of 20mm(D) and shall not exceed 15m in length.
 - Depth of finished ground to the outlet of the Hydrant not to be greater than 350mm.
 - Boundary Box to be provided on all connection and should be located in pedestrian areas on the public side of the boundary, locations and type to be in constructed in accordance with standard detail STD-W-03.
 - All materials and details to comply with Irish Water Code of Practice latest, Connection and Service Developer Services, Water Infrastructure standard details.

- MARKERS:**
- When a suitable wall is available the sign shall be fixed to it, at a location to be agreed with the Architect.
 - Indicator posts shall be constructed with 10mm grade C30/35 concrete, reinforced with 6mmØ galvanised bars.
 - Hydrant indicator plates shall be canary yellow (BS 381 C) with black lettering to BS 3251.
 - Plates shall be bolted to posts/walls with non-corrosive metal bolts, which shall be compatible with the plate metal.

Please refer to the most up to date Irish Water (IW) documents, IW-CDS-5020 for Water infrastructure standard details. These details superseded all previously issued POGA watermain details and should be used on all new and part constructed developments from the December 2017.

Drawing No.	Drawing Title	Rev
STD-W-01	Water service connection responsibility	0
STD-W-02	Typical layout for water mains within developments	1
STD-W-03	Customer connection & boundary box	3
STD-W-04	General pipe connections (sheet 1 of 7)	2
STD-W-05	General pipe connections (sheet 2 of 7)	3
STD-W-06	General pipe connections (sheet 3 of 7)	2
STD-W-07	General pipe connections (sheet 4 of 7)	1
STD-W-08	General pipe connections (sheet 5 of 7)	1
STD-W-09	General pipe connections (sheet 6 of 7)	1
STD-W-10	General pipe connections (sheet 7 of 7)	1
STD-W-11	Typical service layout indicating separation distances	1
STD-W-12	Restrictions on water infrastructure works adjacent to existing trees	2
STD-W-12A	Restrictions on new trees / shrubs planting adjacent to Watermains	0
STD-W-13	Trench backfill & bedding	1
STD-W-14	Sluice valve for ductile iron (D.I.) pipe (<350mm dia.) (sheet 1 of 2)	3
STD-W-15	Sluice valve for polyethylene (P.E.) pipe (<350mm dia.) (sheet 2 of 2)	2
STD-W-16	Offline hydrant for ductile iron (D.I.) pipe (sheet 1 of 4)	2
STD-W-17	Offline hydrant for ductile iron (D.I.) pipe (sheet 2 of 4)	3
STD-W-18	On-line hydrant for polyethylene (P.E.) pipe (sheet 3 of 4)	2
STD-W-19	On-line hydrant for polyethylene (P.E.) pipe (sheet 4 of 4)	3
STD-W-20	On-line air valve for ductile iron (D.I.) pipe (sheet 1 of 4)	2
STD-W-21	On-line air valve for ductile iron (D.I.) pipe (sheet 2 of 4)	2
STD-W-22	On-line air valve for polyethylene (P.E.) pipe (sheet 3 of 4)	3
STD-W-23	On-line air valve for polyethylene (P.E.) pipe (sheet 4 of 4)	3
STD-W-24	Pressure reducing / sustaining valve (P.R.V. / P.S.V.) chamber	2
STD-W-25	Booster pump station arrangement	1
STD-W-26	Non Mech. Meter chamber (40-250mm Dia.)	0
STD-W-26A	Meter chamber (<300mm dia.)	0
STD-W-27	Marker posts / plates	2
STD-W-28	Water main thrust & support blocks	1
STD-W-29	Dust chamber	2
STD-W-30	Scour chamber & head wall arrangements	3
STD-W-30A	Washout hydrant	2
STD-W-31	Typical ditch / stream crossing for water main	1
STD-W-32	Typical bridge crossing for water main (sheet 1 of 2)	1
STD-W-33	Typical bridge crossing for water main (sheet 2 of 2)	1
STD-W-34	Security gate & fencing	2
STD-W-35	Pipe repair to existing mains	2
STD-W-36	Telemetry and wet kiosks	2
STD-W-37	Lamp bollard & lamp standard	1

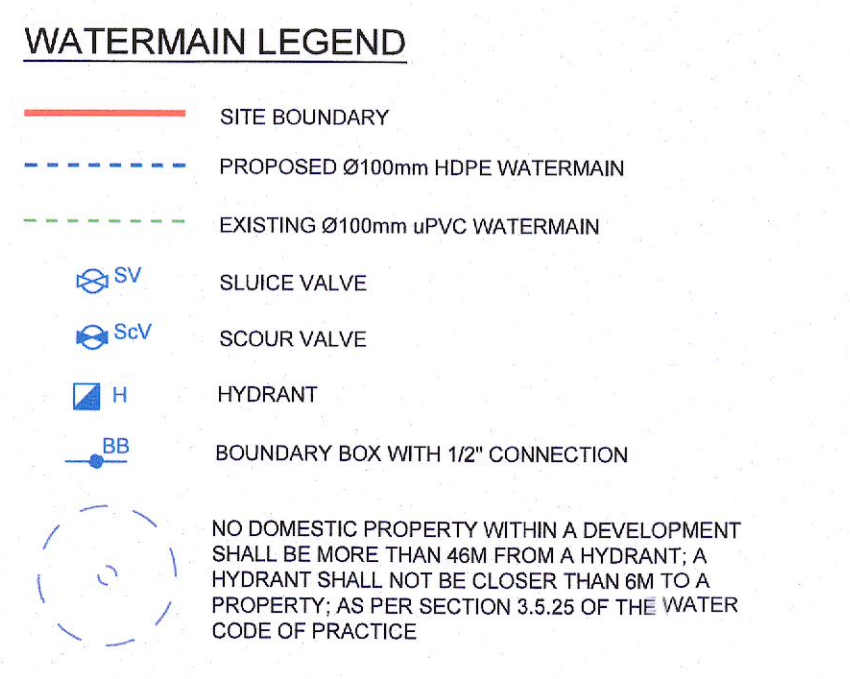

Rev.	Date	Description	By
P1	22.08.22	'FURTHER INFORMATION' SUBMISSION	CB

Project Title
**WHITECHURCH ROAD
 RATHFARNHAM**

Architect
BBA ARCHITECTS

Date	By	Checked	Scale @ A1
FEB 2022	AL	PM	1:250

Drawing Title
WATERMAIN LAYOUT

Drawing Status
PLANNING

Job No.	Drawing No.	Issue
21029	103	P1

POGA
 CONSULTING ENGINEERS
 STRUCTURAL • CIVIL

Unit C2, Nutgrove Office Park
 Rathfarnham
 Dublin 14
 D14 CR2D
 Tel: +353 (0)1 205 1101
 www.poga.ie