
- 1. DO NOT SCALE FROM THIS DRAWING. USE STATED DIMENSIONS ONLY. IF IN DOUBT, CONSULT THE ENGINEER.
- 2. LEVELS REFER TO O.S. DATUM MALIN HEAD.
- 3. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE SPECIFICATION.
- 4. FOR ALL INLETS, OUTLETS AND BRANCHES MATCH CROWN
- LEVELS UNLESS INDICATED OTHERWISE ELSEWHERE. 5. BLINDING CONCRETE SHALL BE CLASS C12/15 TO E.N. 206-1. BLINDING SHALL BE A MINIMUM THICKNESS OF 100mm.
- 6. FOUNDATION CONCRETE SHALL BE CLASS C32/40 Dmax=20mm TO E.N. 206-1. FOUNDATIONS SHALL BE A MINIMUM THICKNESS
- 7. PRECAST MANHOLE CHAMBER WALLS, COVER SLABS AND REDUCING SLABS TO BE CONSTRUCTED TO I.S. E.N. 1917 AND
- 8. FOR BEDDING AND SEALING OF CHAMBER RINGS, THE TOP RING (TO PRE CAST COVER SLAB) AND BOTTOM RING TO BE BEDDED WITH CEMENT MORTAR. FOR INTERMEDIATE RINGS, JOINTS TO BE SEALED WITH TYPE 2 RUBBER GASKETS AND JOINTING RINGS TO BS 2494.
- 9. PRE CAST MANHOLES TO BE SURROUNDED WITH A MINIMUM OF 150mm THICK CONCRETE CLASS C32/40 Dmax=40mm TO E.N.
- 10. BENCHING AND PIPE CHANNEL PIPE SURROUND CONCRETE CLASS C16/20 Dmax=20mm TO E.N. 206-1.
- 11. BENCHING FINISHED IN MINIMUM 25mm THICK 2:1 SAND: CEMENT MORTAR WITH A SMOOTH TROWEL FINISH, AT 1


IN 30 SLOPE TOWARDS CHANNEL.

- 12.1 TO 2 COURSES OF SOLID ENGINEERING BRICKS CLASS B TO I.S.91:1983 SET IN 3:1 SAND: CEMENT MORTAR.
- 13.MANHOLE COVERS AND FRAMES TO BE CLASS D400 OR E600 TO I.S. E.N. 124. 150mm DEEP FRAME FOR ROADS AND 100mm DEEP FOR FOOTPATHS AND GREEN AREAS. NON-ROCK DESIGN, CLOSED KEYWAYS, MANUFACTURED FROM SPHEROIDAL GRAPHITE CAST IRON (DUCTILE CAST IRON), COVER AND FRAME COATED IN BITUMEN OR OTHER APPROVED MATERIAL, COVER TO HAVE A MINIMUM MASS OF 140kg/m², FRAME BEARING AREA SHALL BE 80,000mm² MINIMUM, FRAMES SHALL BE DESIGNED TO PREVENT COVERS FALLING INTO MANHOLE. FRAMES SHALL BE BEDDED ON APPROVED MORTAR TO MANUFACTURER'S INSTRUCTIONS.
- 14. MANHOLE COVERS, FRAMES, REGULATING COURSES AND SLAB OPES TO PROVIDE CLEAR OPENING OF 600mmX600mm (OR 600mm DIAMETER).
- 15. SAFETY CHAINS TO BE PROVIDED ON PIPES THAT EXCEED 450mm IN DIAMETER. MILD STEEL SAFETY CHAIN SHALL BE 10mm NOMINAL SIZE GRADE M(H) NON-CALIBRATED CHAIN, TYPE 1, COMPLYING WITH BS4942 PART 2 OR EQUIVALENT.
- 16. STANDARD RUNGS AT 300mm c/c VERTICALLY AND GALVANIZED TO THE LATEST VERSION OF BS 729 OR EQUIVALENT. NOTE: STEPS IRONS ARE NOT ACCEPTABLE.
- 17. LADDER STRINGERS SHOULD BE ADEQUATELY SUPPORTED FROM THE MANHOLE WALL AT INTERVALS OF NOT MORE THAN 2.0m STRINGERS SHOULD BE BOLTED TO CLEATS TO FACILITATE RENEWAL
- 18.DISTANCE FROM THE TOP RUNG OF THE LADDER TO GROUND LEVEL MUST BE A MAXIMUM OF 675mm.
- 19. ALL LADDERS, RUNGS, SAFETY CHAINS ETC SHALL BE HOT DIP GALVANIZED TO BS729 OR EQUIVALENT.
- 20.MANHOLE OPENINGS TO BE SITUATED FURTHEST FROM THE NEAREST CARRIAGEWAY. MANHOLE STEPS / ACCESS TO BE POSITIONED TO ALLOW VIEWING OF ONCOMING TRAFFIC.
- 21.SHORT LENGTH PIPE AND PIPE JOINT EXTERNAL TO MANHOLE SHALL NOT EXCEED 600mm FROM THE INNER FACE OF MANHOLE WALL
- 22. BLOCK WORK SHALL BE BEDDED AND JOINTED USING MORTAR TO I.S. 406. BEDS AND VERTICAL JOINTS SHALL BE COMPLETELY FILLED WITH MORTAR AS THE BLOCKS ARE LAID. JOINTS SHALL BE FLUSH POINTED AS THE WORK PROCEEDS.
- 23. RELIEVING ARCH FORMED BY 215x103x65 SOLID ENGINEERING BRICK CLASS A OR B AS PER DRAWING. RELIEVING ARCHES USED IN BRICK OR BLOCK WORK MANHOLES EXTEND OVER FULL THICKNESS OF WALL. A DOUBLE ARCH IS TO BE FORMED FOR PIPE DIAMETERS GREATER THAN 600mm
- 24. ALL MANHOLES TO BE WATERTIGHT TO THE SATISFACTION OF THE ENGINEER.

	TABLE	E NO. 2	
DIA. OF PIPE (mm)		LENGTH OF ROCKER PIPE (mm)	
150-600			600
675-750			1000
>750			1250
	TABLE	E NO.3	
Diameter of Incoming Pipe		Diamete	er of Backdrop Pipe
	(mm)		(mm)
	100		100
	150		150
	225		300
	300		375
	375		375
	450		450
	525		450
	600		450
	000	_	

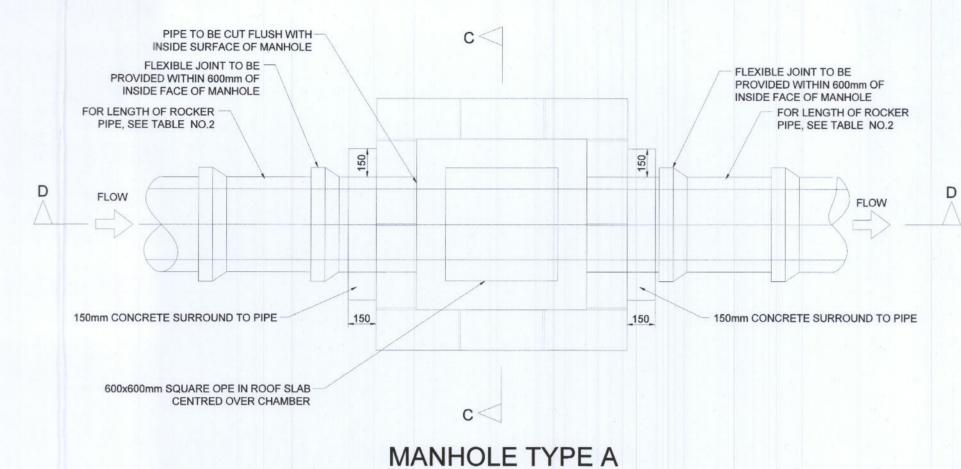


DEPTH OF COVER TO CROWN LESS THAN 1.0m SECTIONAL PLAN

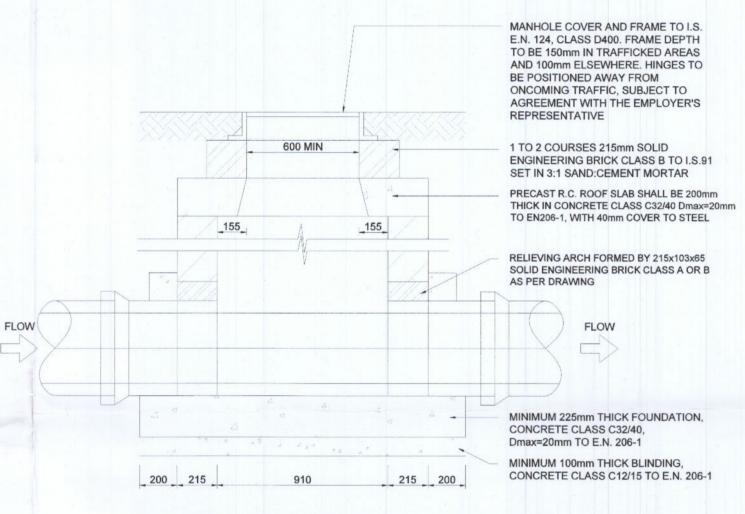

## MANHOLE TYPE A DEPTH OF COVER TO CROWN LESS THAN 1.0m

SECTION D-D

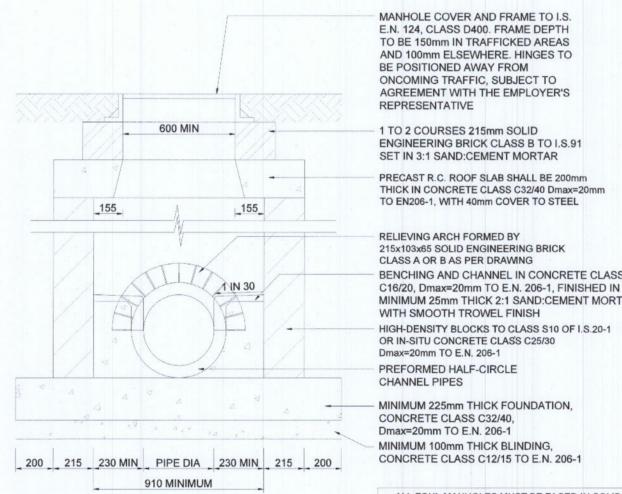

MANHOLE TYPE A DEPTH OF COVER TO CROWN LESS THAN 1.0m SECTION C-C

BENCHING AND CHANNEL IN CONCRETE CLASS C16/20, Dmax=20mm TO E.N. 206-1, FINISHED IN MINIMUM 25mm THICK 2:1 SAND:CEMENT MORTAR


ALL FOUL MANHOLES MUST BE FACED IN SOLID ENGINEERING BRICK (MIN. CLASS A OR B), OR IN-SITU CONCRETE FOR 1 METRE ABOVE BENCHING LEVEL. BRICK TO BE BONDED TO BLOCK WORK USING ENGLISH GARDEN WALL BOND.

PLANNING DRAWING. NOT FOR CONSTRUCTION. ALL LEVELS GIVEN ARE RELATIVE TO ORDNANCE DATUM.

THIS DRAWING HAS BEEN ISSUED FOR INFORMATION

PURPOSES ONLY AND MUST NOT BE USED

FOR CONSTRUCTION UNDER ANY CIRCUMSTANCES

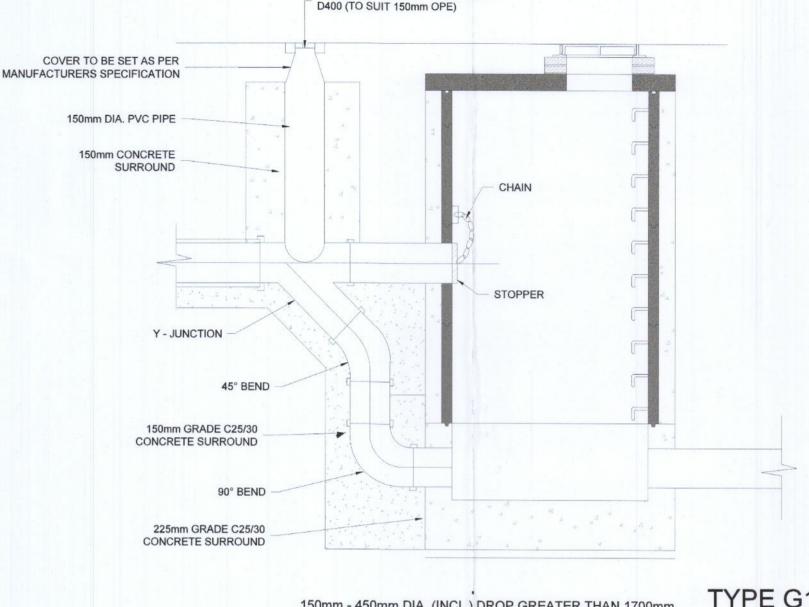


HEAVY DUTY COVER AND FRAME

150mm - 450mm DIA. (INCL.) DROP GREATER THAN 1700mm 500mm - 900mm DIA. (INCL.) DROP GREATER THAN 2300mm

HEAVY DUTY COVER AND FRAME D400 (TO SUIT 150mm OPE) COVER TO BE SET AS PER MANUFACTURERS SPECIFICATION 150mm DIA. PVC PIPE 150mm CONCRETE SURROUND - STOPPER TEE JUNCTION -150mm GRADE C25/30 CONCRETE SURROUND 90° BEND 225mm GRADE C25/30 CONCRETE SURROUND

> 150mm - 450mm DIA. (INCL.) DROP GREATER THAN 900 AND LESS THAN 1700mm 500mm - 900mm DIA. (INCL.) DROP GREATER THAN 1300mm AND LESS THAN 2300mm

TYPE G2 **SCALE 1:20** 

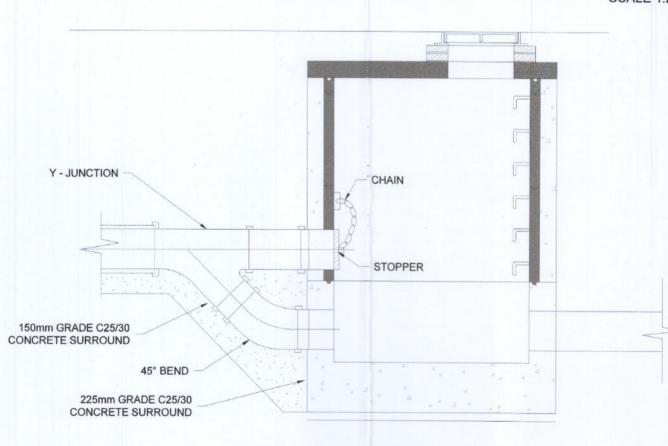

150mm - 450mm DIA. (INCL.) DROP GREATER THAN 600mm AND LESS THAN 900m 500mm - 900mm DIA. (INCL.) DROP GREATER THAN 600mm AND LESS THAN 1300mm

## **BACKDROP MANHOLES**

ORDNANCE SURVEY OF IRELAND LICENCE NO. CYAL50213875 © GOVERNMENT OF IRELAND


- FOR SETTING OUT REFER TO ARCHITECT'S DRAWINGS. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECTURAL AND ENGINEERING DRAWINGS AND ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.
- DO NOT SCALE THIS DRAWING. USE FIGURED DIMENSIONS ONLY.
- NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR STORED IN ANY RETRIEVAL SYSTEM OF ANY NATURE WITHOUT THE WRITTEN PERMISSION OF O'CONNOR SUTTON CRONIN AS COPYRIGHT HOLDER EXCEPT AS AGREED FOR USE ON THE PROJECT FOR WHICH THE DOCUMENT WAS ORIGINALLY ISSUED.

Rev No. Date Revision Note Drn by Chkd by Drn by Chkd by Rev No. Date Revision Note P01 06.09.22 SUITABLE FOR INFORMATION COR PO2 14.09.22 SUITABLE FOR PLANNING COR











TEL +353 (0)1 8682000 e: contactus@ccsc.ie w: www.ocsc.ie

BARTRA PROPERTY COOKSTOWN LIMITED Project: TRANSITIONAL CARE FACILITY COOKSTOWN INDUSTRIAL ESTATE, DUBLIN 24 DRAINAGE DETAILS SHEET 4 OF 6

Code Originator Zone Level Type Role Number Status Revision B981 - OCSC - XX - XX - DR - C -0533 \$4 Dublin London Belfat Galway Cork Birmingham Date: 06.09.22 Scale: SHWN @ A1 Drn by: COR Chkd by: PR Aprvd by: AH