

NOTES:
 THIS DRAWING IN WHOLE OR IN PART SHALL NOT BE COPIED WITHOUT THE PRIOR PERMISSION OF McArdle DOYLE LTD.
 ALL WORKS TO COMPLY WITH THE CURRENT BUILDING REGULATIONS.
 DO NOT SCALE.
 ORDNANCE SURVEY IRELAND LICENCE No. AR 0105722
 © ORDNANCE SURVEY IRELAND / GOVERNMENT OF IRELAND


LEGEND:

- UNLEADED
- DIESEL
- AD-BLUE
- HVO
- - - VAPOUR RECOVERY - STAGE 1
- - - VAPOUR RECOVERY - STAGE 2
- - - VENT LINES - PROPOSED
- - - FILL LINE - UNLEADED
- - - FILL LINE - DIESEL
- - - FILL LINE - AD-BLUE
- - - FILL LINE - HVO
- SUBMERSIBLE PUMP

TANK SCHEDULE		
TANK No.	CAPACITY	PRODUCT
T1	40,000 Litres	UNLEADED
T2	30,000 Litres	DIESEL
T3	20,000 Litres	HVO
T4	10,000 Litres	AD-BLUE

DISPENSER SCHEDULE			
PUMP No.	TYPE	PRODUCT	TANK
1 & 2	4 HOSE	UNLEADED / DIESEL	UNLEADED - TANK No. T1 DIESEL - TANK No. T2
3 & 4	4 HOSE	UNLEADED / DIESEL	UNLEADED - TANK No. T1 DIESEL - TANK No. T2
5 & 6	8 HOSE	UNLEADED / DIESEL / HVO / AD-BLUE	UNLEADED - TANK No. T1 DIESEL - TANK No. T2 HVO - TANK No. T3 AD-BLUE - TANK T4
7	1 HOSE	DIESEL	DIESEL - TANK No. T2

NOTE:
 INTERNAL PREMIUM FUEL BLENDING SYSTEM WITHIN DISPENSER

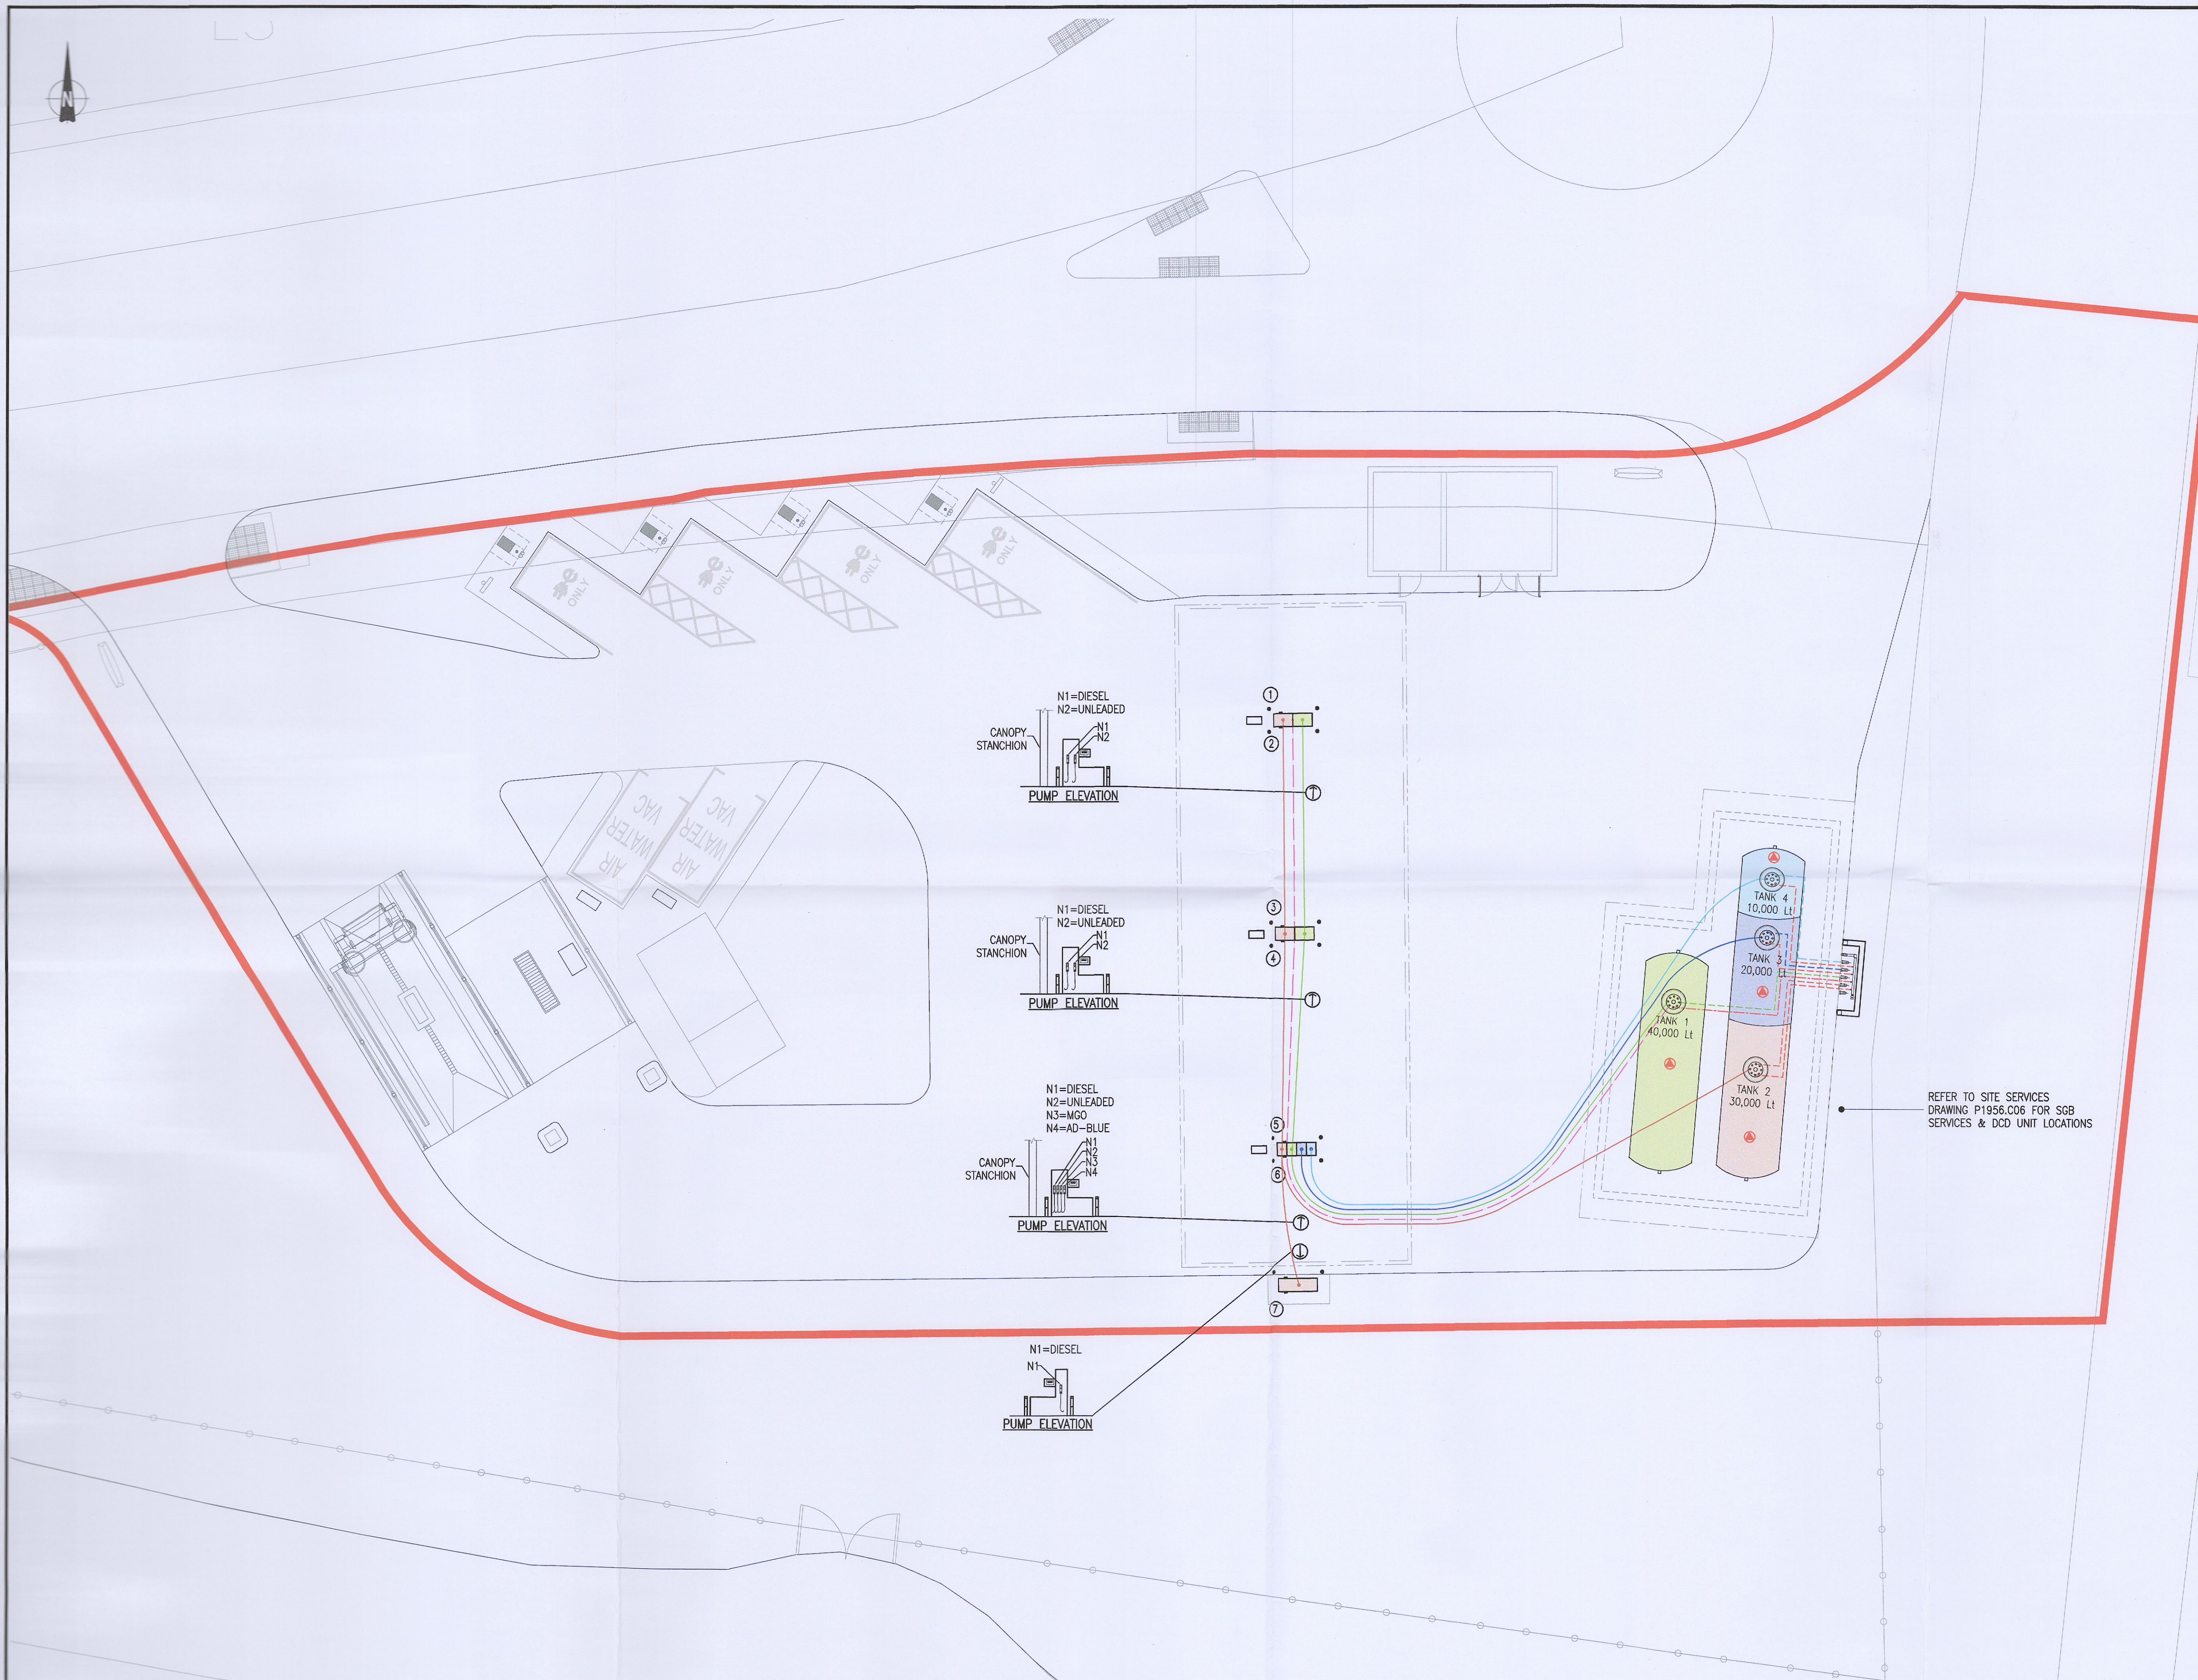

REFER TO SITE SERVICES DRAWING P1956.C06 FOR SGB SERVICES & DCD UNIT LOCATIONS

Rev.	Description	By	Date
-	ISSUED FOR PLANNING	GDR	09.09.22

McArdle Doyle
 Second Floor Exchange Building The Long Walk Dundalk, Co. Louth
 Chartered Engineers Architectural Services & Project Managers
 mail@mcardle Doyle.ie +353(0) 42 942 9052

PROJECT:
 UNMANNED SERVICE STATION, LIFFEY VALLEY

CLIENT:

DRAWING TITLE:
 PROPOSED FUEL PIPEWORK

Date 09/09/22	Drawn GDR	Checked RMA	Approved RMA
Scale at A1 1:125	Drawing Number P1956.C05	Status PL	Rev. -