

The topography of the Site does not include localised low-lying areas that would give rise to groundwater ponding to a significant depth.

7.2 Flood Risk Indicators – Site Walkover

No evidence of flood risk from groundwater was observed during a Site walkover.

7.3 Initial Assessment

The ground investigation did encounter water-bearing strata relatively close to the surface however all indicators suggest the Site is not at risk from groundwater flooding. Detailed assessment of flood risk from this mechanism is not required.

not at risk from pluvial flooding and further assessment is not required. Based on the indicators described in Section 8.1, on the site walkover described in Section 8.2 and the design of the surface drainage system as described in Section 8.3, the initial assessment indicates the Site is not at risk from pluvial flooding and further assessment is not required.

8.4 Initial Assessment

Full compliance with GDS ensures the drainage system will have sufficient capacity to accommodate rainfall events up to 1% AEP (including climate change) without causing pluvial flood risk within the development and without leading to an increase in pluvial flood risk elsewhere.

The surface drainage system proposed development has been designed by Pinnacle Consulting Engineers to comply with the Greater Dublin Strategic Drainage Study.

8.3 Surface drainage system for the proposed development

No indicators of pluvial flood risk were observed during a site walkover.

8.2 Flood Risk Indicators – Site Walkover

The Site is not affected by urban drainage systems that would give rise to overland flow across the Site.

(iv) Urban Drainage Systems

Maps prepared for the CFRAM study programme do not show any pluvial flood risk at the Site.

(iii) CFRAM study programme undertaken by the OPW

The OPW maintains the National Flood Hazard Mapping website (floodinfo.ie) which contains information about locations that may be at risk from flooding. The source of this information includes Local Authorities and other historic records such as newspaper articles and other documentation about reported floods. This source does not register any previous flood events associated with pluvial flood risk at the Site.

The Strategic Flood Risk Assessment for the South Dublin County Council does not contain any information regarding pluvial flood risk at the Site.

(ii) SFRAs

A number of datasets were interrogated for indicators of pluvial flood risk:

8.1 Flood Risk Indicators - Desktop

8. PLUVIAL FLOOD RISK

9. RESIDUAL FLOOD RISK

Residual risk is the risk that remains after all mitigation measures to reduce the frequency of flooding have been taken.

9.1 Flood Risk Management Plan

The assessment to this point has found the proposed development is not at risk of flooding. However, all developments include some element of residual flood risk that must be addressed during their operational lives; for example the failure of building drainage due to lack of maintenance.

To address this residual risk, it is recommended that a Site-Specific Flood Risk Mitigation Plan prepared in accordance with the Guidelines is implemented throughout the operational life of the proposed development.

9.2 Blockage in culvert immediately downstream of the Site

As described already, the stream is culverted downstream of the Site. This culvert comprises two 600mm diameter pipes at its inlet. A CCTV survey of the culvert revealed that one of these pipes changes to 450mm diameter approximately 20m from the inlet. Furthermore, the CCTV survey found both pipes to have significant blockages that greatly reduce the overall capacity of the culvert; the extent of these blockages was such that the survey could not be completed for the full length of the culvert.

Therefore, the condition and size of the culvert downstream of the blockages is unknown and there is potential, for example in the event of culvert collapse, of the stream surcharging within the Site to a level exceeding that predicted by the hydrological models. To mitigate this risk, it is recommended that an overflow be constructed from the Site which would allow such excess to discharge to the stream immediately downstream of the Nangor Road. Subject to the capacity being available, this overflow could possibly discharge to existing surface water drainage in the Nangor Road but a dedicated surface water pipe might be required from the Site to a new outfall downstream of the Nangor Road.

The Flood Risk Mitigation Plan described in Section 9.1 must include should include a maintenance regime for all drainage features within the Site and for regular inspection of drainage features immediately upstream and downstream of the Site.

Report on Site-Specific Flood Risk Assessment

In order to ensure that elements of development of the Site not compatible with water (i.e. roads, buildings etc.) are not at risk of flooding, the Guidelines recommend that floor levels and road levels be kept above the 1% AEP flood level with an appropriate allowance for freeboard.

A freeboard of 500mm is appropriate for floor levels and a freeboard of 250mm is appropriate for road levels. The maximum water level during the 1% AEP flood event is 72.15m. The minimum floor level is 74.00m and the minimum parking level is 73.45m and so both meet the recommendations of the Guidelines.

10. MINIMUM FINISHED LEVELS

11. DEVELOPMENT MANAGEMENT JUSTIFICATION TEST

A Development Management Justification Test was carried out in respect of the proposed development in accordance with Section 5.15 of the Flood Risk Management Guidelines and incorporating the findings of the subject FRA. Table 11.1 presents the results of this test which conclude that the proposed development satisfies the criteria of the Justification test.

1.1	<i>The subject lands have been zoned or otherwise designated for the particular use or form of development in an operative development plan, which has been adopted or varied taking account of these Guidelines.</i>
	Yes
1.2	<i>The proposal has been subject to an appropriate flood risk assessment which demonstrates that :</i>
(i)	<i>the proposed development will not increase flood risk elsewhere and, if practicable, will reduce overall flood risk;</i>
	Yes
(ii)	<i>the proposed development includes measures to minimise flood risk to people, property, the economy and the environment as far as reasonably possible;</i>
	The proposed development includes proposals for treating and controlling surface water discharge which, will minimise flood risk to people, property, the economy and the environment as far as reasonably possible.
(iii)	<i>the proposed development includes measures to ensure that residual risks to the area and/or development can be managed to an acceptable level as regards the adequacy of existing flood protection measures or the design, implementation and funding of any future flood risk management measures and provisions for emergency services access;</i>
	The proposed development does not impact on any existing flood protection measures and will not prevent possible future flood risk management measures.
(iv)	<i>the proposed development addresses the above in a manner that is also compatible with the achievement of wider planning objectives in relation to development of good urban design and vibrant and active streetscapes.</i>
	Yes.

Table 11.1 Justification Test

Report on Site-Specific Flood Risk Assessment

inspection of drainage features immediately upstream and downstream of the Site. This plan should include a maintenance regime for all drainage features within the Site and for regular inspection of drainage features immediately upstream and downstream of the Site.

This plan should include a maintenance regime for all drainage features within the Site and for regular inspection of drainage features immediately upstream and downstream of the Site.

In accordance with the Guidelines, it is recommended that a Site-Specific Flood Risk Mitigation Plan prepared life. To address this residual risk, it is recommended that a Site-Specific Flood Risk Mitigation Plan prepared life. All developments include some element of residual flood risk that must be addressed during their operational life.

All developments include some element of residual flood risk that must be addressed during their operational life.

Recommendations arising from assessment of residual flood risk

The detailed assessment of fluvial flood risk concluded the proposed development will not be at risk of flooding from fluvial sources and will not give rise to fluvial flood risk elsewhere.

Finisched levels for buildings and roads in the proposed development provide an appropriate freeboard above the 1% AEP water level in accordance with the Guidelines.

The proposed development includes a road crossing of the Park Road culvert. A box culvert with internal dimensions of 1.4m in height and 3.5m can installed at this crossing and would provide a significantly greater hydraulic capacity than that of the Park Road culvert and comfortably exceed OWW requirements for clearance between the soft soil level of the culvert and the 1% AEP water level.

The surface water drainage system for the proposed development has been designed by Pinnaclle Consulting Engineers in compliance with the Greater Dublin Strategic Drainage Study. Full compliance with GDSs ensures the drainage system ensures the flood regime in the receiving stream will not be affected, thus not giving rise to flood risk elsewhere.

AEP flood event) and to a greater extent by Flood Risk Zone B (the 0.1% AEP flood event).

The detailed assessment of fluvial flood risk confirmed the Site is not affected by Flood Risk Zone A (the 1%

Detailed assessment of fluvial flood risk

Initial assessment of flood risk indicators suggest the Site could be at risk from Fluvial Flooding during the 1.0% AEP and 0.1% AEP events. Accordingly, a detailed assessment of fluvial flood risk was carried out.

Initial assessment of existing flood risk indicators indicate the Site is not at risk from Pluvial or Groundwater Flooding. The designers of the surface water drainage system have confirmed the surface water drainage system for the proposed development and will not give rise to flood risk elsewhere.

For an inland Site of this nature and for which there are no existing flood defence mechanisms that could affect flood risk at the Site, the potential flood risk mechanisms are Fluvial, Pluvial, Groundwater and failure of drainage infrastructure (assessed as a residual risk).

Initial assessment

Initial assessment

The SSFRA was carried out in accordance with the document *Planning System and Flood Risk Management – Guidelines for Planning Authorities* [the Guidelines].

This report presents the findings of a Site-specific flood risk assessment (SSFRA) carried out by Kilgallen and Partners in regard to proposed development on lands to the south of the New Nangor Road (R134), Dublin 22 and on land within the townlands of Ballybane and Kilbride within Profile Park, Clondalkin, Dublin 22 overall site of 3.79hectares [The Site].

12.1 Summary**12. SUMMARY AND CONCLUSION**

A CCTV survey of a culvert downstream of the Site revealed significant blockages that greatly reduce its capacity. The detailed fluvial flood risk assessment carried out for this report assumed the culvert is cleared of all obstructions and maintained free of debris / deposition throughout the operational life of the proposed development. However, the condition and size of the culvert downstream of the blockages is unknown and there is potential, for example in the event of culvert collapse, of the stream surcharging to the Site to a level exceeding that predicted by the hydraulic model. To mitigate this risk, it is recommended that an overflow be constructed from the Site which would allow such excess to discharge to the stream immediately downstream of the Nangor Road. Subject to the capacity being available, this overflow could possibly discharge to existing surface water drainage in the Nangor Road but a dedicated surface water pipe might be required from the Site to a new outfall downstream of the Nangor Road.

Justification Test

The proposed development was subject to and passed the Development Management Justification Test.

12.2 Conclusion

Assuming the implementation of the recommendations arising from this assessment, the proposed development is not at risk of flooding and will not increase flood risk elsewhere. The proposed development is therefore appropriate from a flood risk perspective.

Report on Site-Specific Flood Risk Assessment

Schedule of Relevant Planning Documents

Appendix A

PINNACLE CONSULTING ENGINEERS

DUB13-DR-SP-C124-V2-WS3-PIN-PROPOSED LEVELS & WATERMAIN LAYOUT

DUB13-DR-UG-C127-V2-WS3-PINPROPOSED DRAINAGE LAYOUT

DUB13-DR-SP-C130-V2-WS3-PIN-EXTERNAL WORKS LAYOUT

DUB13-RP-00-C001-V1-WS3-PIN

Report on Site-Specific Flood Risk Assessment

Estimation of Run-off from Stream Catchment

Appendix B

IH124 Estimation of Q₁₀₀ and Q₁₀₀₀			
$Q_{\text{BAR RURAL}} = 0.00108 \times \text{AREA}^{0.89} \times \text{SAAR}^{1.17} \times \text{SOIL}^{2.17}$			
Characteristic	Value	Unit	Source
Area (A)	1.0	km ²	FSU
Average Annual Rainfall (SAAR)	715	mm	FSU
G1 % =	0	%	Fig I 4.18
G2 % =	0	%	Fig I 4.18
G3 % =	0	%	Fig I 4.18
G4 % =	0	%	Fig I 4.18
G5 % =	100	%	Fig I 4.18
Soil index (G) =	0.50	%	
$Q_{\text{BAR RURAL}} =$	0.52	m ³ /sec	
CWI =	106.3		Fig I 6.62
CIND =	45.96		Eqn 7.2
NC =	0.75		Eqn 7.3
URBAN =	0.4		FSU
$Q_{\text{BAR URBAN}} / Q_{\text{BAR RURAL}} =$	1.367		Eqn 7.4
$Q_{\text{BAR}} =$	0.717	m ³ /sec	
$Q_{100} / Q_{\text{BAR}} (\text{Ireland})$	1.96		FSR - Ireland
$Q_{1,000} / Q_{\text{BAR}} (\text{Ireland})$	2.6		FSR - Ireland
$Q_{100} =$	1.406	m ³ /sec	
$Q_{1,000} =$	1.865	m ³ /sec	
Factorial Error Factor =	1.651		Page 37 IOH124
Climate Change Factor =	1.2		FRMG
$Q_{100} =$	2.79	m³/sec	
$Q_{1,000} =$	3.69	m³/sec	

Report on Site-Specific Flood Risk Assessment

Characteristic	Value	Unit	Source	Q_{100}	Q_{1000}
Area	1.0	km^2	FSU Portal	0.520	0.136
SAR	715	mm	FSU Portal	0.520	0.136
BFI _{Soil}	715	mm	FSU Portal	0.520	0.136
QMED	0.041	m^3/s	FSU Portal	0.520	0.136
Climate Change Factor	1.2	OPW	FSU Portal	0.520	0.136
QMED / QMED	2.77		FSU Portal	0.520	0.136
Q ₁₀₀ / Q ₁₀₀₀	3.74		FSU Portal	0.520	0.136
Q ₁₀₀ / Q ₁₀₀₀ / QMED	3.74		FSU Portal	0.520	0.136
Q ₁₀₀ / Q ₁₀₀₀ / QMED / QMED	3.74		FSU Portal	0.520	0.136
Q ₁₀₀₀	0.183	m^3/sec	FSU Portal	0.520	0.136

FSU-3V estimation of Q_{100} & Q_{1000}

Characteristic	Value	Unit	Source	Q_{100}	Q_{1000}
Area	1.0	km^2	FSU Portal	0.520	0.136
SAR	715	mm	FSU Portal	0.520	0.136
BFI _{Soil}	715	mm	FSU Portal	0.520	0.136
QMED _{Urban}	0.14		FSU Portal	0.520	0.136
Climate Change Factor	1.2	OPW	FSU Portal	0.520	0.136
QMED _{Rural}	2.77		FSU Portal	0.520	0.136
Q ₁₀₀ / QMED _{Rural}	3.74		FSU Portal	0.520	0.136
Q ₁₀₀₀ / QMED _{Rural}	3.74		FSU Portal	0.520	0.136
Q ₁₀₀ / QMED _{Urban}	3.74		FSU Portal	0.520	0.136
Q ₁₀₀₀ / QMED _{Urban}	3.74		FSU Portal	0.520	0.136
Q ₁₀₀	0.473	m^3/sec	FSU Portal	0.520	0.136
Q ₁₀₀₀	0.639	m^3/sec	FSU Portal	0.520	0.136

FSU Update estimate of Q_{100} & Q_{1000}

FSU-7V estimation of Q_{100} & Q_{1000}			
Characteristic	Value	Unit	Source
Area	1.0	km ²	FSU Portal
BFI _{soil}	0.520		FSU Portal
SAAR	715	mm	FSU Portal
FARL	1.0		FSU Portal
DRAIND	0.72	km/km ²	
S1085	0.10	m/km	FSU Portal
ARTDRAIN	0.00		
QMED _{rural}	0.072	m ³ /s	
URBEXT	0.36		FSU Portal
QMED _{urban}	0.11		
Climate Change Factor	1.2		OPW
Q_{100} / QMED _{rural}	2.77		FSU Portal
Q_{1000} / QMED _{rural}	3.74		FSU Portal
Q_{100}	0.375	m³/sec	
$Q_{1,000}$	0.506	m³/sec	

FEH-Statistical estimation of Q_{100} & Q_{1000}			
Characteristic	Value	Unit	Source
Area	1.0	km ²	FSU Portal
SAAR	715	mm	FSU Portal
FARL	1.0		FSU Portal
BFI _{soil}	0.520		FSU Portal
QMED	0.27	m ³ /s	
Climate Change Factor	1.2		OPW
Q_{100} / QMED	2.77		FSU Portal
Q_{1000} / QMED	3.74		FSU Portal
Q_{100}	0.885	m³/sec	
$Q_{1,000}$	1.195	m³/sec	

**Report
Ecological Impact Assessment
Technical Appendix 11.1:**

Proposed Industrial Development, DUB13, Profile Park, Grangecastle, Co. Dublin

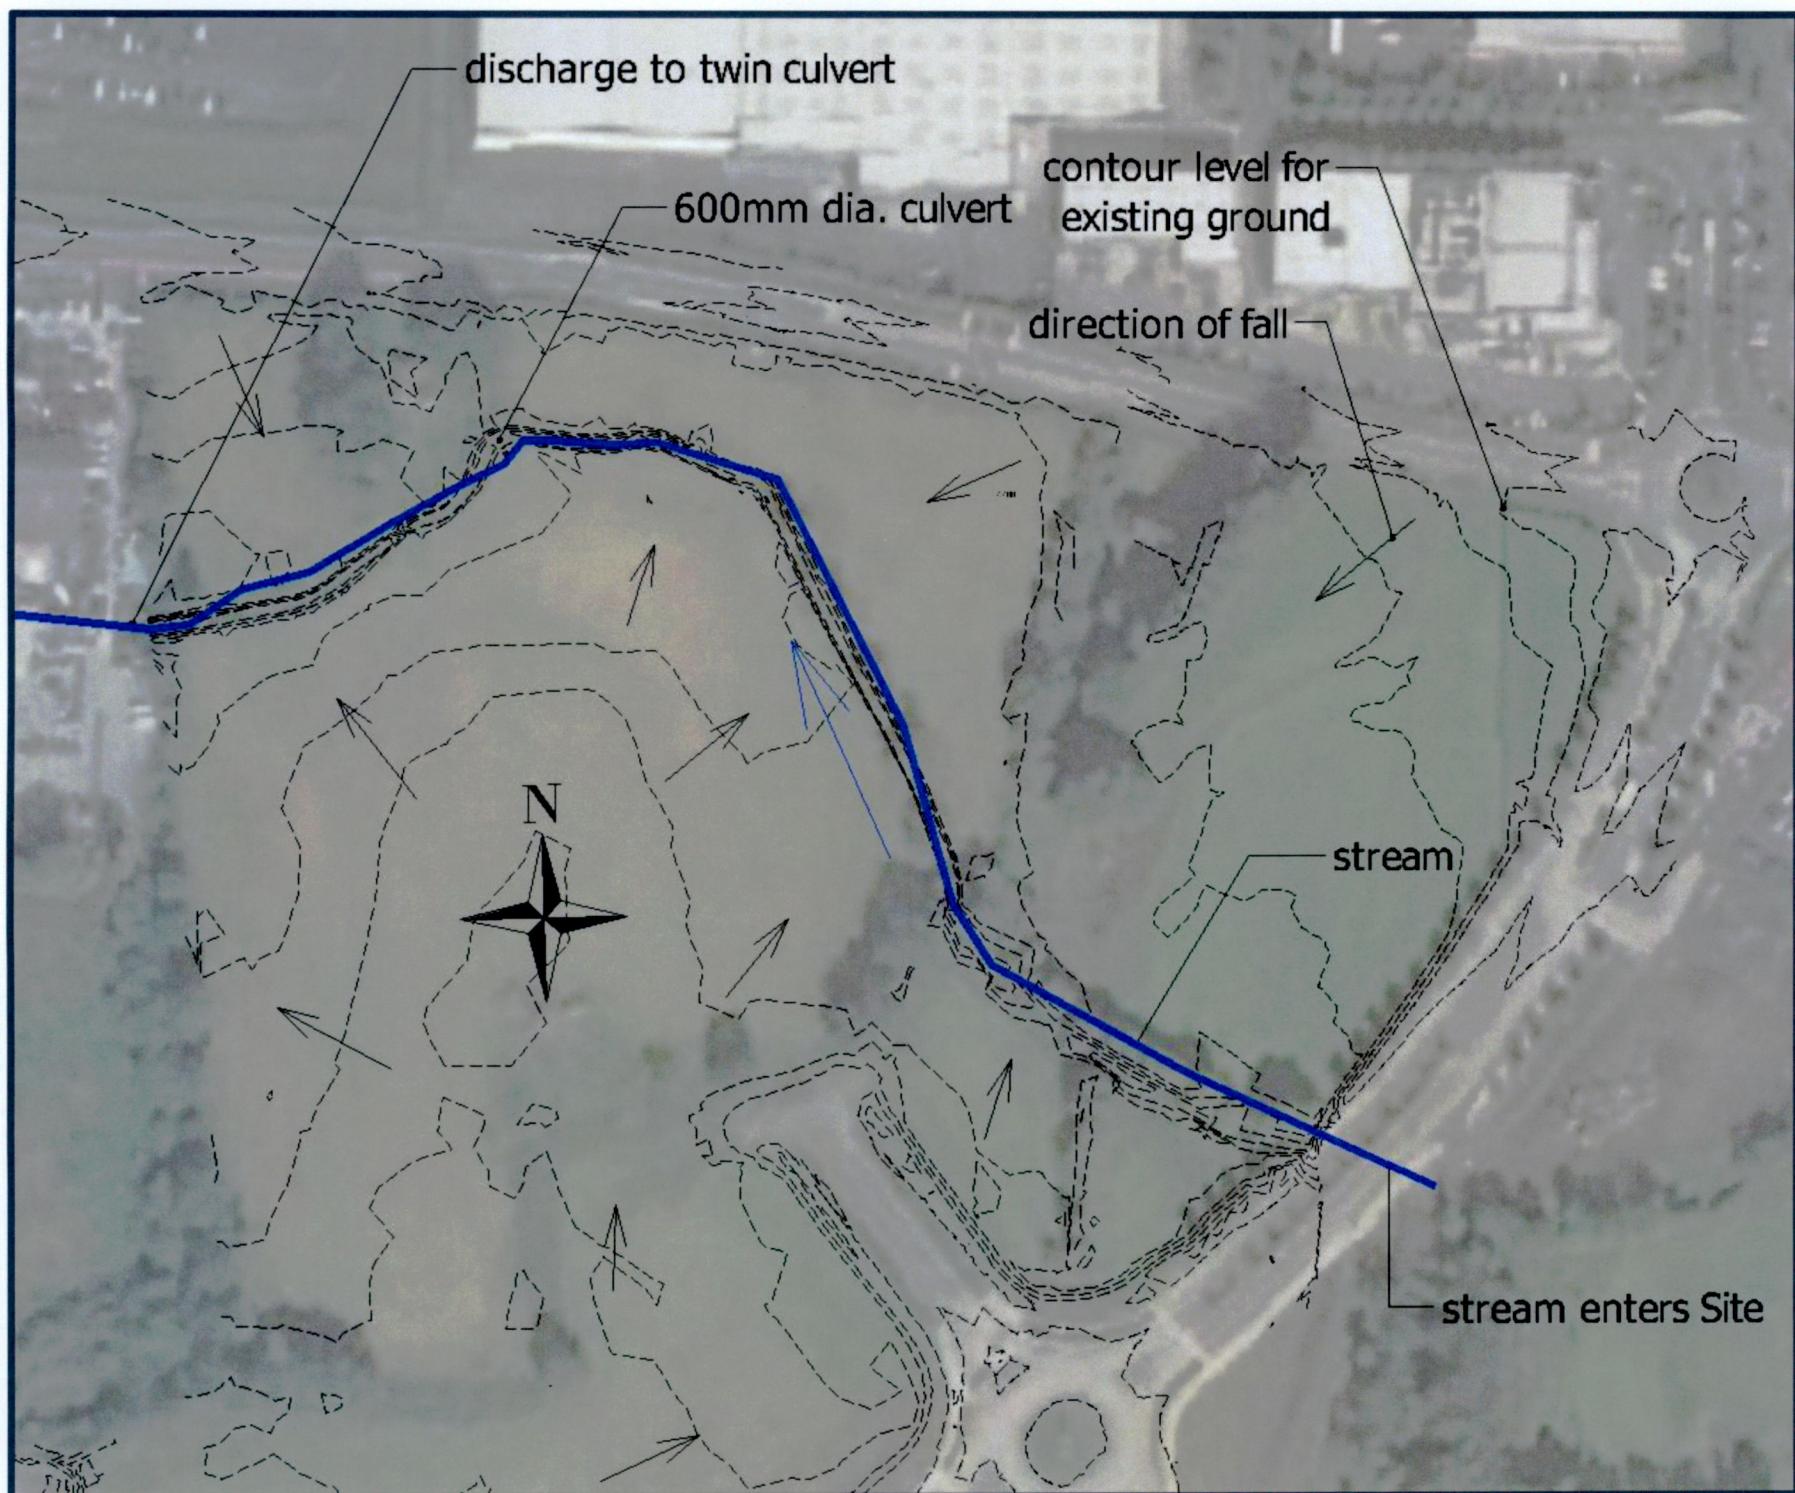


Figure 3-2 Site Topography / Main Drainage Features

Report on Site-Specific Flood Risk Assessment

A schematic layout for the proposed development is shown in Figure 4-1. Relevant proposals for the development are shown on the schedule of documents contained in Appendix A.

- Consist of the following:
 - 1 no. two storey data center (Building 13) with a gross floor area of 12,893sqm. It will include 13 no. emergency back-up generators of which 12 will be double stacked and one will be single stacked within a compound to the south-western side of the data center with associated flues that each will be 22.316m in height and 7 no. hot-air exhaust cooling vents that each will be 20.016m in height;
 - the data center will include storage rooms, associated electrical and mechanical plant rooms, loading bays, maintenance and storage spaces, office administration areas, and plant including PV panels at roof level as well as a separate house generator that will provide emergency power to the admin and ancillary spaces. Each generator will include a diesel tank and there will be a refuelling area to serve the proposed emergency generators;
 - The data center will have a primary parapet height of 14.246m above ground level, with plant and screen around plus a plant room above at roof level. The plant room has an overall height of 21.571m;
 - Construction of an internal road network and circulation areas, with a staff entrance off Falcon Avenue to the east, as well as a secondary vehicular access for service and delivery vehicles only across a new bridge over the Baldonnel Stream from the permitted entrance as granted under SDCC Planning Ref. SD21A/0241 from the south-west, both from within Profile Park that contains an access from the New Nangor Road
 - Provision of 60 no. car parking spaces (to include 12 EV spaces and 3 disabled spaces), and 34 no. cycle parking spaces;
 - Signage (5.7sqm) at first floor level at the northern end of the eastern elevation of the data center building, and
 - Ancillary site development works, will include footpaths, attenuation ponds that will include an amendment to the permitted attenuation pond as granted to the north of the Baldonnel Stream under SDCC Planning Ref. SD21A/0241, as well as green walls and green roof. The installation and connection to the underground foul and storm drainage network, and installation of utility ducts and cables, that will include the drilling and laying of ducts and cables under the internal road network within Profile Park.
 - Other ancillary site development works will include hard and soft landscaping that will include an amendment to the permitted landscaping as granted under SDCC Planning Ref. SD21A/0241, lighting, fencing, signage, entrance gates, and sprinkler tanks.

4.1 Description

The proposed development comprises industrial buildings, parking areas, circulation roads, ancillary land comprising (including SUDS measures) services and ancillary Site works

4. PROPOSED DEVELOPMENT

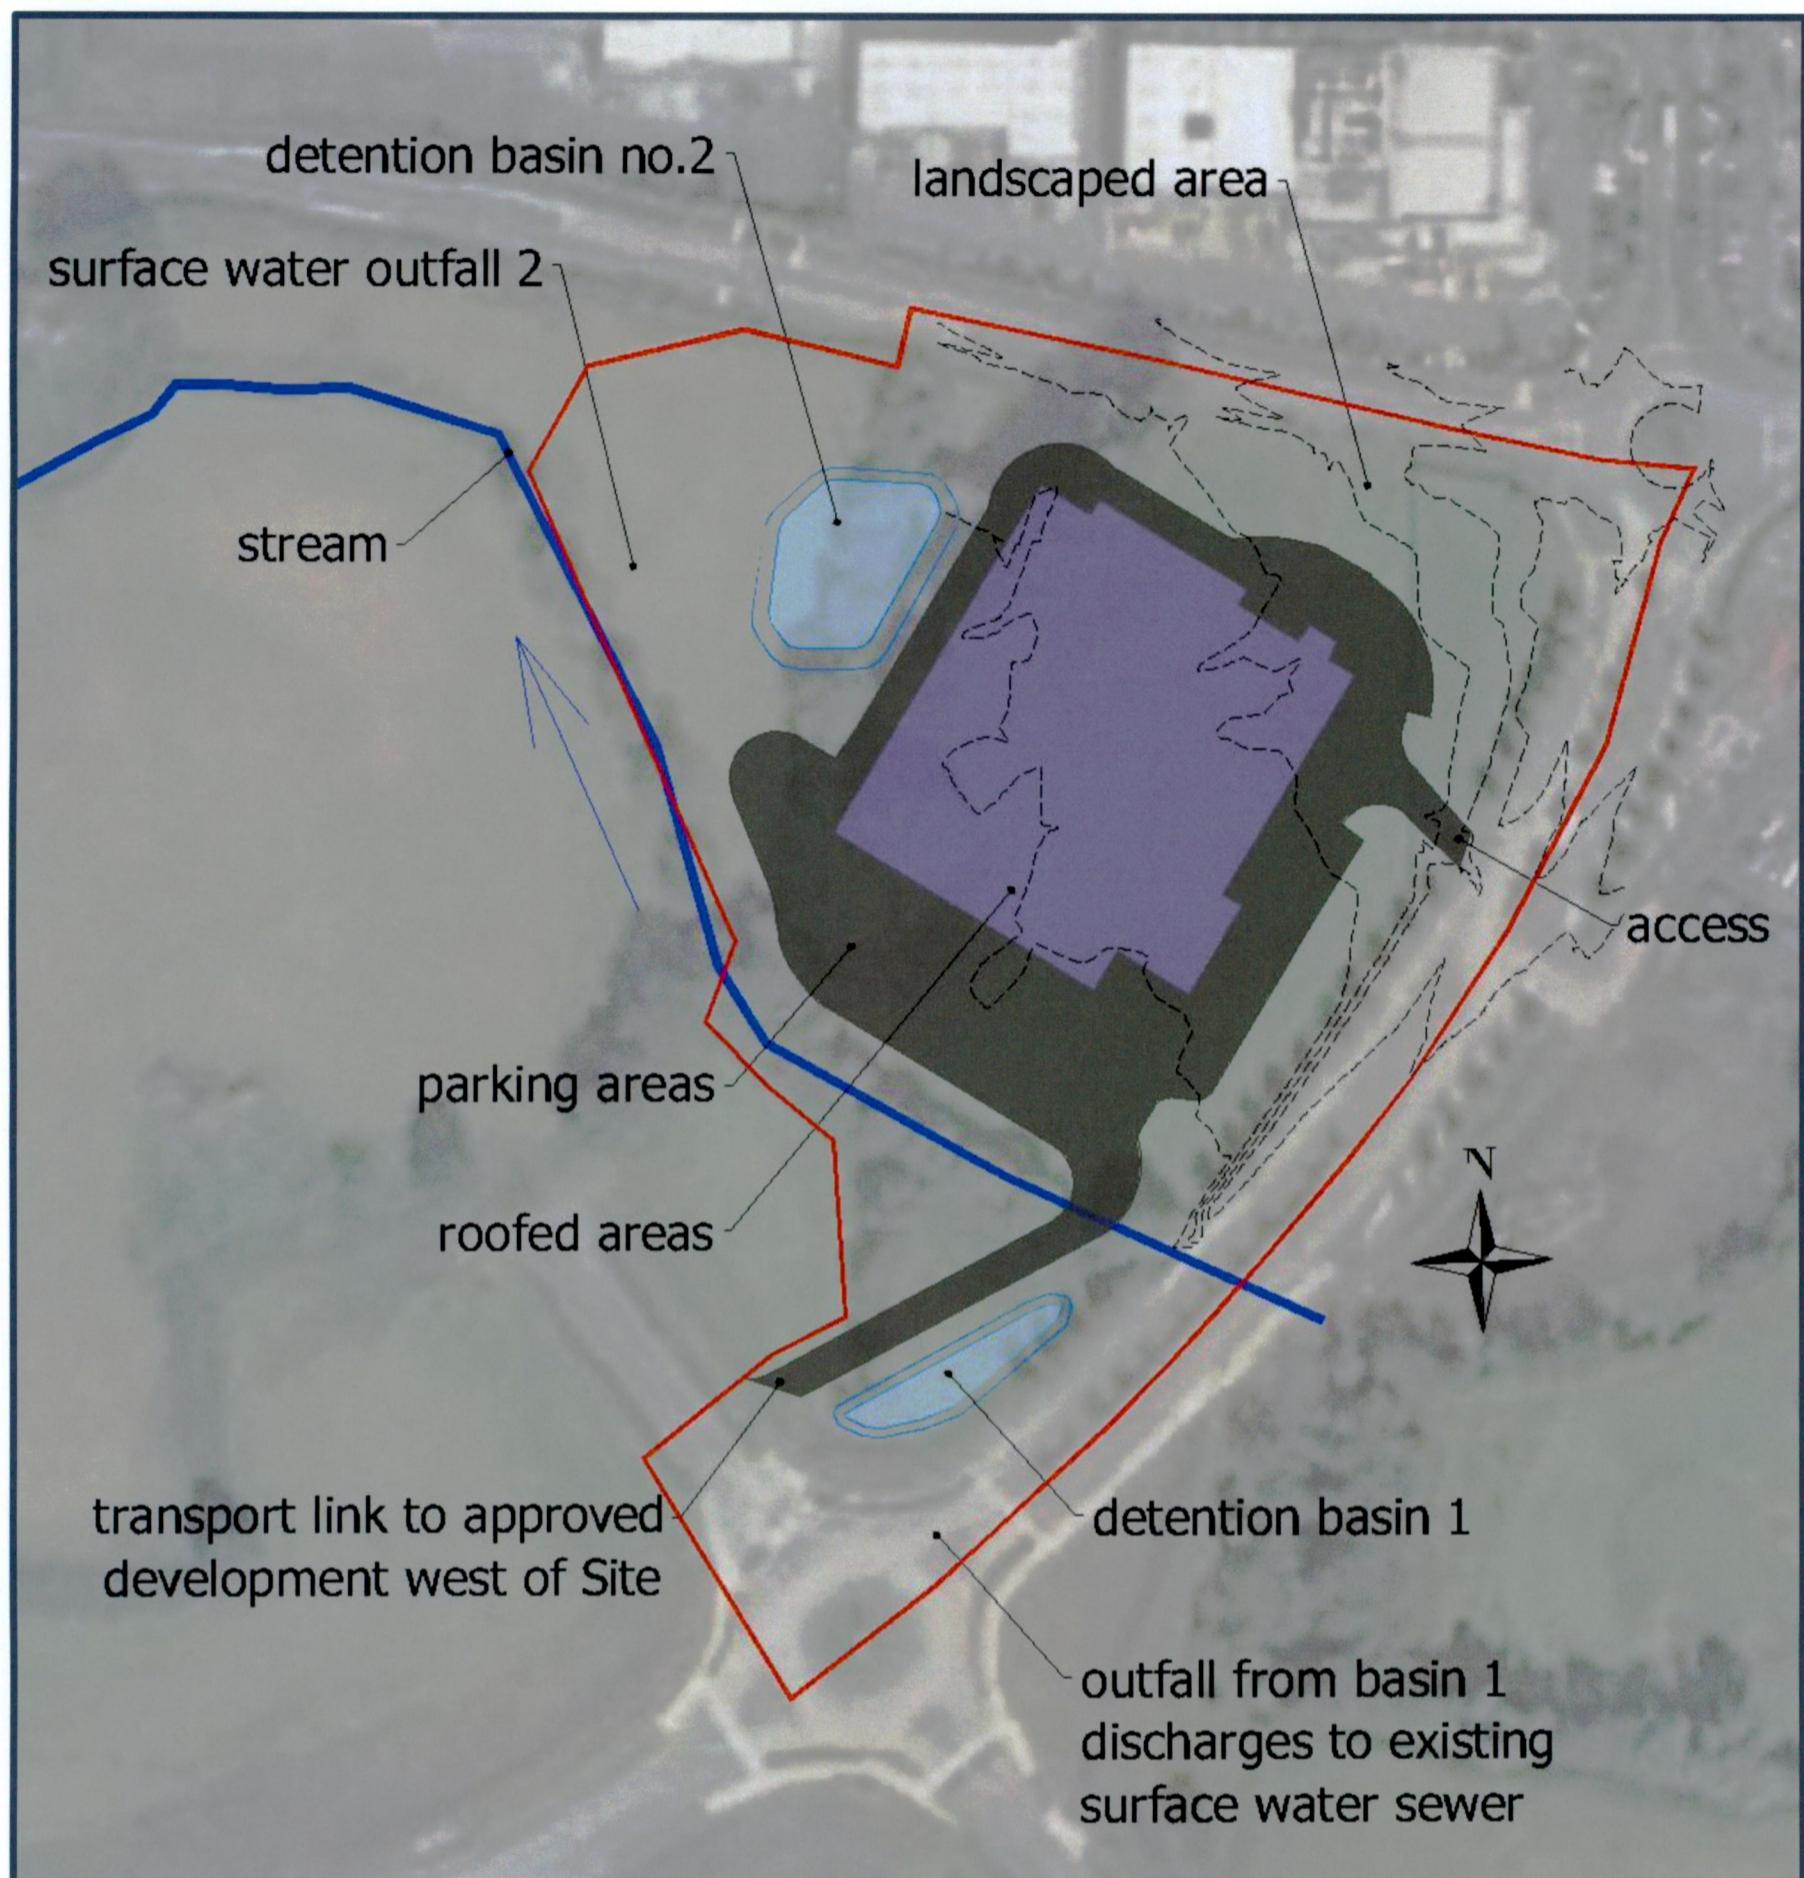


Figure 4-1 Schematic Layout of Proposed Development

4.2 Vulnerability

Table 3.1 of the Guidelines classifies different types of development in terms of their vulnerability to flooding. Figure 4-2 contains an extract from this table which shows industrial development classified as Less Vulnerable. The proposed development is an industrial development and so falls under this classification.

Report on Site-Specific Flood Risk Assessment

Figure 4-3 Matrix of vulnerability versus Flood Zone

			Flood Zone A	Flood Zone B	Flood Zone C			
		Highly vulnerable	Less vulnerable	(including essential infrastructure)	Less vulnerable	Less vulnerable	Less vulnerable	Less vulnerable
		development						
		Test						
		Justification						
		Appropriate						
		Water-compatibile						
		development						
		and that required to meet the Justification Test.	and that required to meet the Justification Test.	and that required to meet the Justification Test.	and that required to meet the Justification Test.	and that required to meet the Justification Test.	and that required to meet the Justification Test.	and that required to meet the Justification Test.

Table 3.2 of the Guidelines provides a matrix of development vulnerability versus Flood Zone which illustrates the appropriateness of a development type for each Flood Zone. This table is reproduced in Figure 4-3 and shows the Guidelines regards Less Vulnerable development as being appropriate for Sites in Flood Zone B and requiring the Justification Test for Sites in Flood Zone A

Figure 4-2 Classification of development type by vulnerability to flooding

Less vulnerable	vulnerable	vulnerable	vulnerable
BUILDINGS USED FOR: retail, leisure, warehousing, commercial, industrial and non-residential institutions;	Land and buildings used for holiday or short-let caravans and camping, subject to specific warning and evacuation plans;	Land and buildings used for agriculture and forestry;	Waste treatment (except landfill and hazardous waste);
			Mineral working and processing; and
			Local transport infrastructure.

5. FLUVIAL FLOOD RISK – INITIAL ASSESSMENT

5.1 Flood Risk Indicators - Desktop


A number of datasets were interrogated for indicators of fluvial flood risk:

(i) *SFRA*

Mapping prepared as part of the Strategic Flood Risk Assessment for the South Dublin County Development Plan indicates the Site is not affected by either the 0.1% AEP and 1.0% AEP flood events. The only exception is at the southern corner where the existing Park Road is shown to be subject to flood risk. An extract from this mapping is shown in Figure 5-1.



Figure 5-1 Extract from SFRA showing fluvial flood risk at the Site

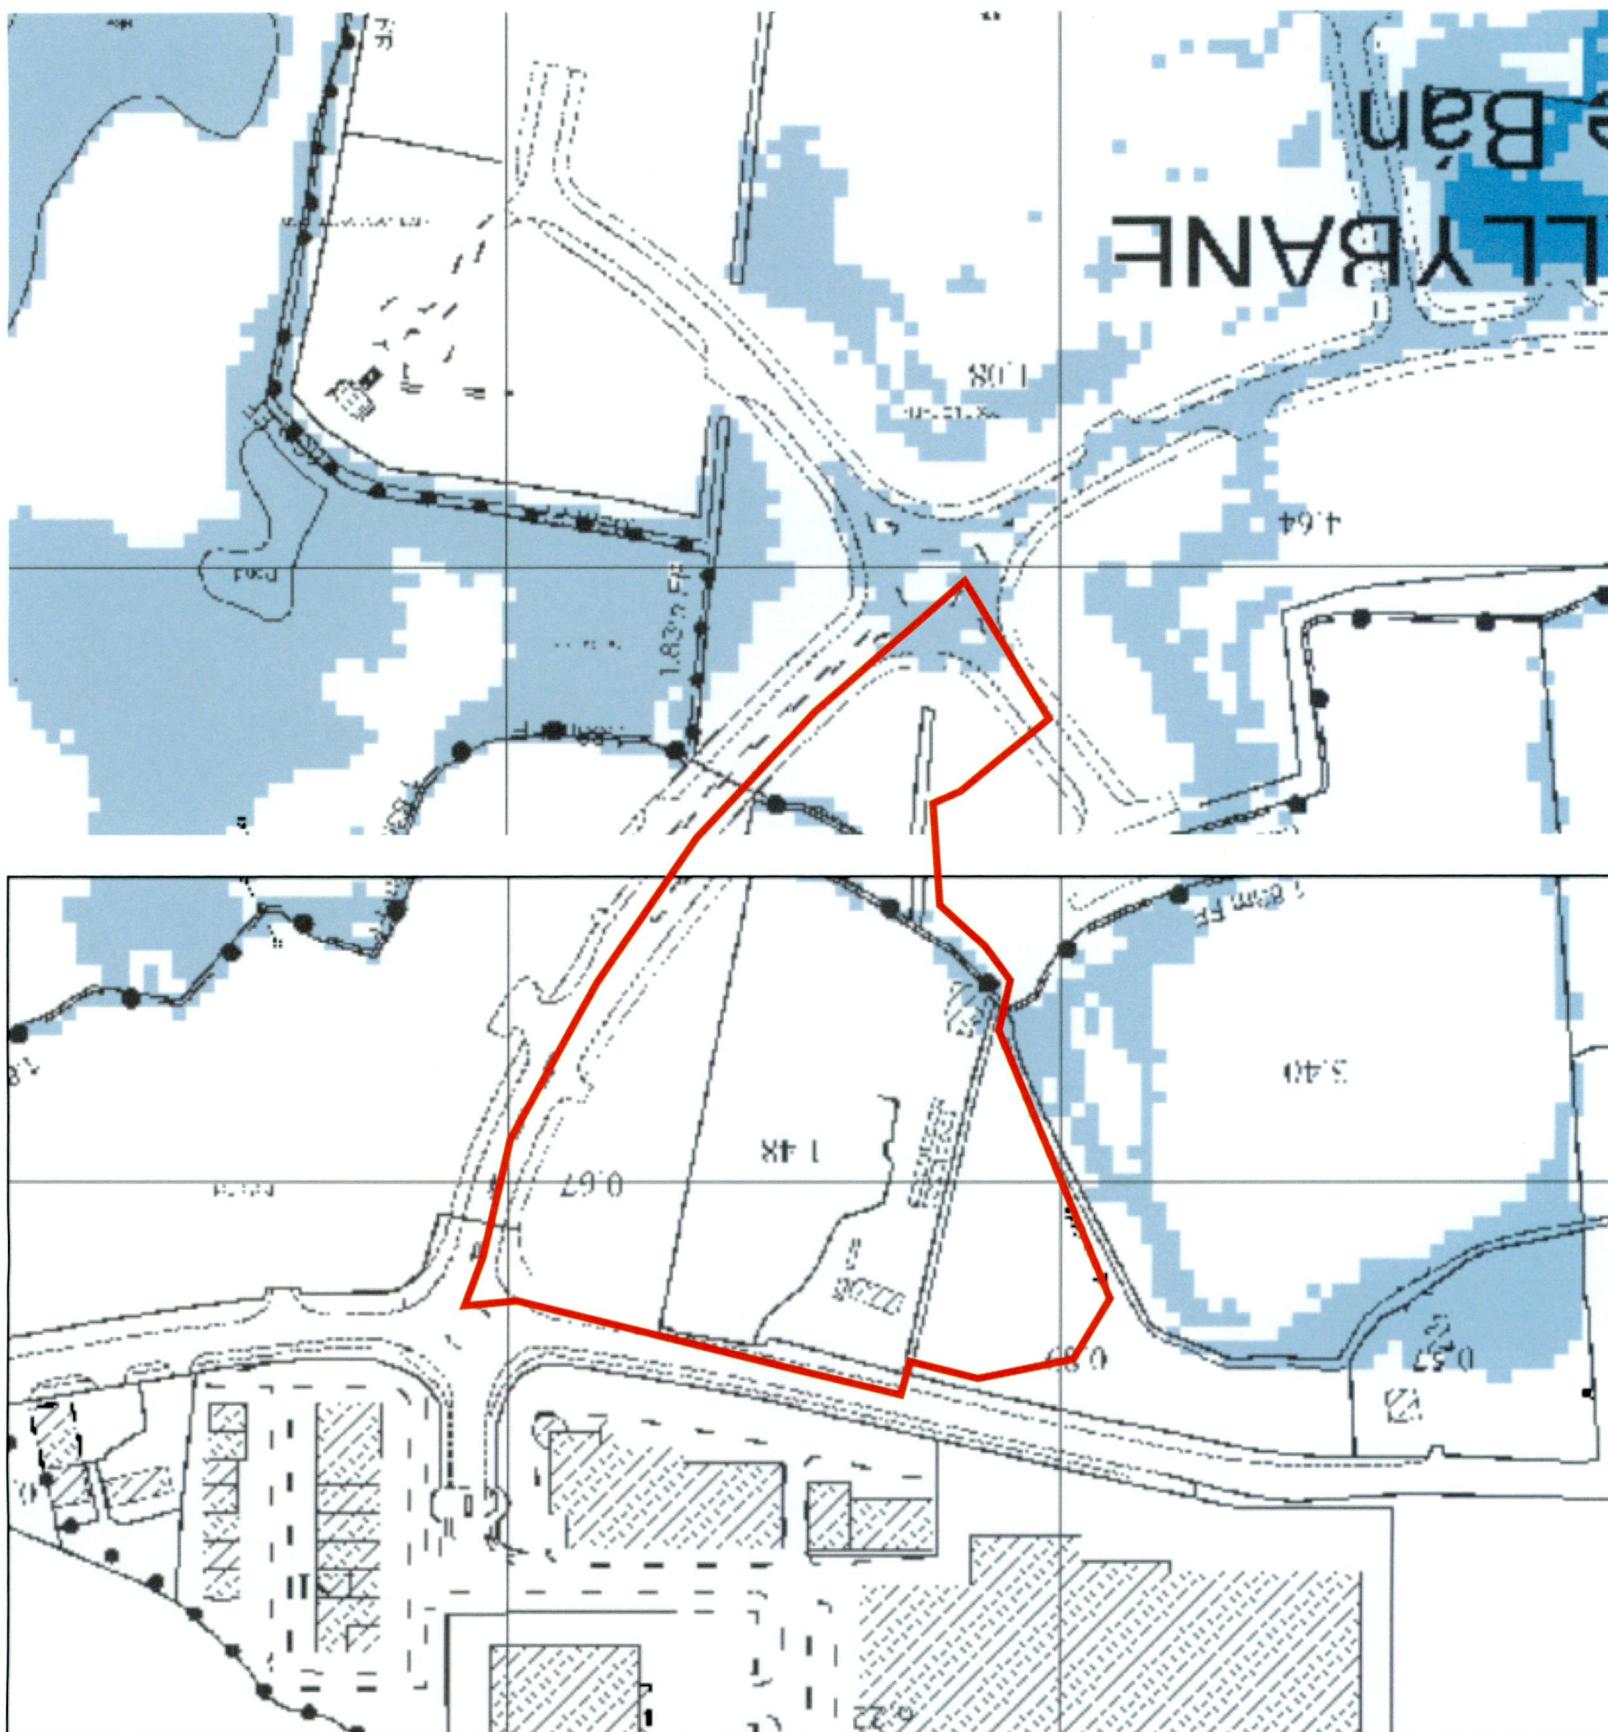Figure 5-2 Extract from CFRAM mapping showing fluvial flood risk at the Site**Figure 5-2.**

Mapping prepared as part of the CFRAM programme indicates the Site is not affected by the 0.1% AEP flood event but not the 1.0% AEP event. As with SSFRA mapping, the only exception is at the southern corner where the existing Park Road is shown to be subject to flood risk. An extract from this mapping is shown in

(iii) CFRAM

The website does not have any records of flooding at this location.

The OPW maintains the National Flood Hazard Mapping website (floodinfo.ie) which contains information about locations that may be at risk from flooding. The source of this information includes Local Authorities and other historic records such as newspaper articles and other documentation about reported floods.

(ii) OPW National Flood Hazard Mapping Website

(iv) Ordnance Survey Mapping

Figure 5-3 shows the historic 25" OS mapping for the Site and its immediate surroundings. There is no indication of flood risk at the Site.

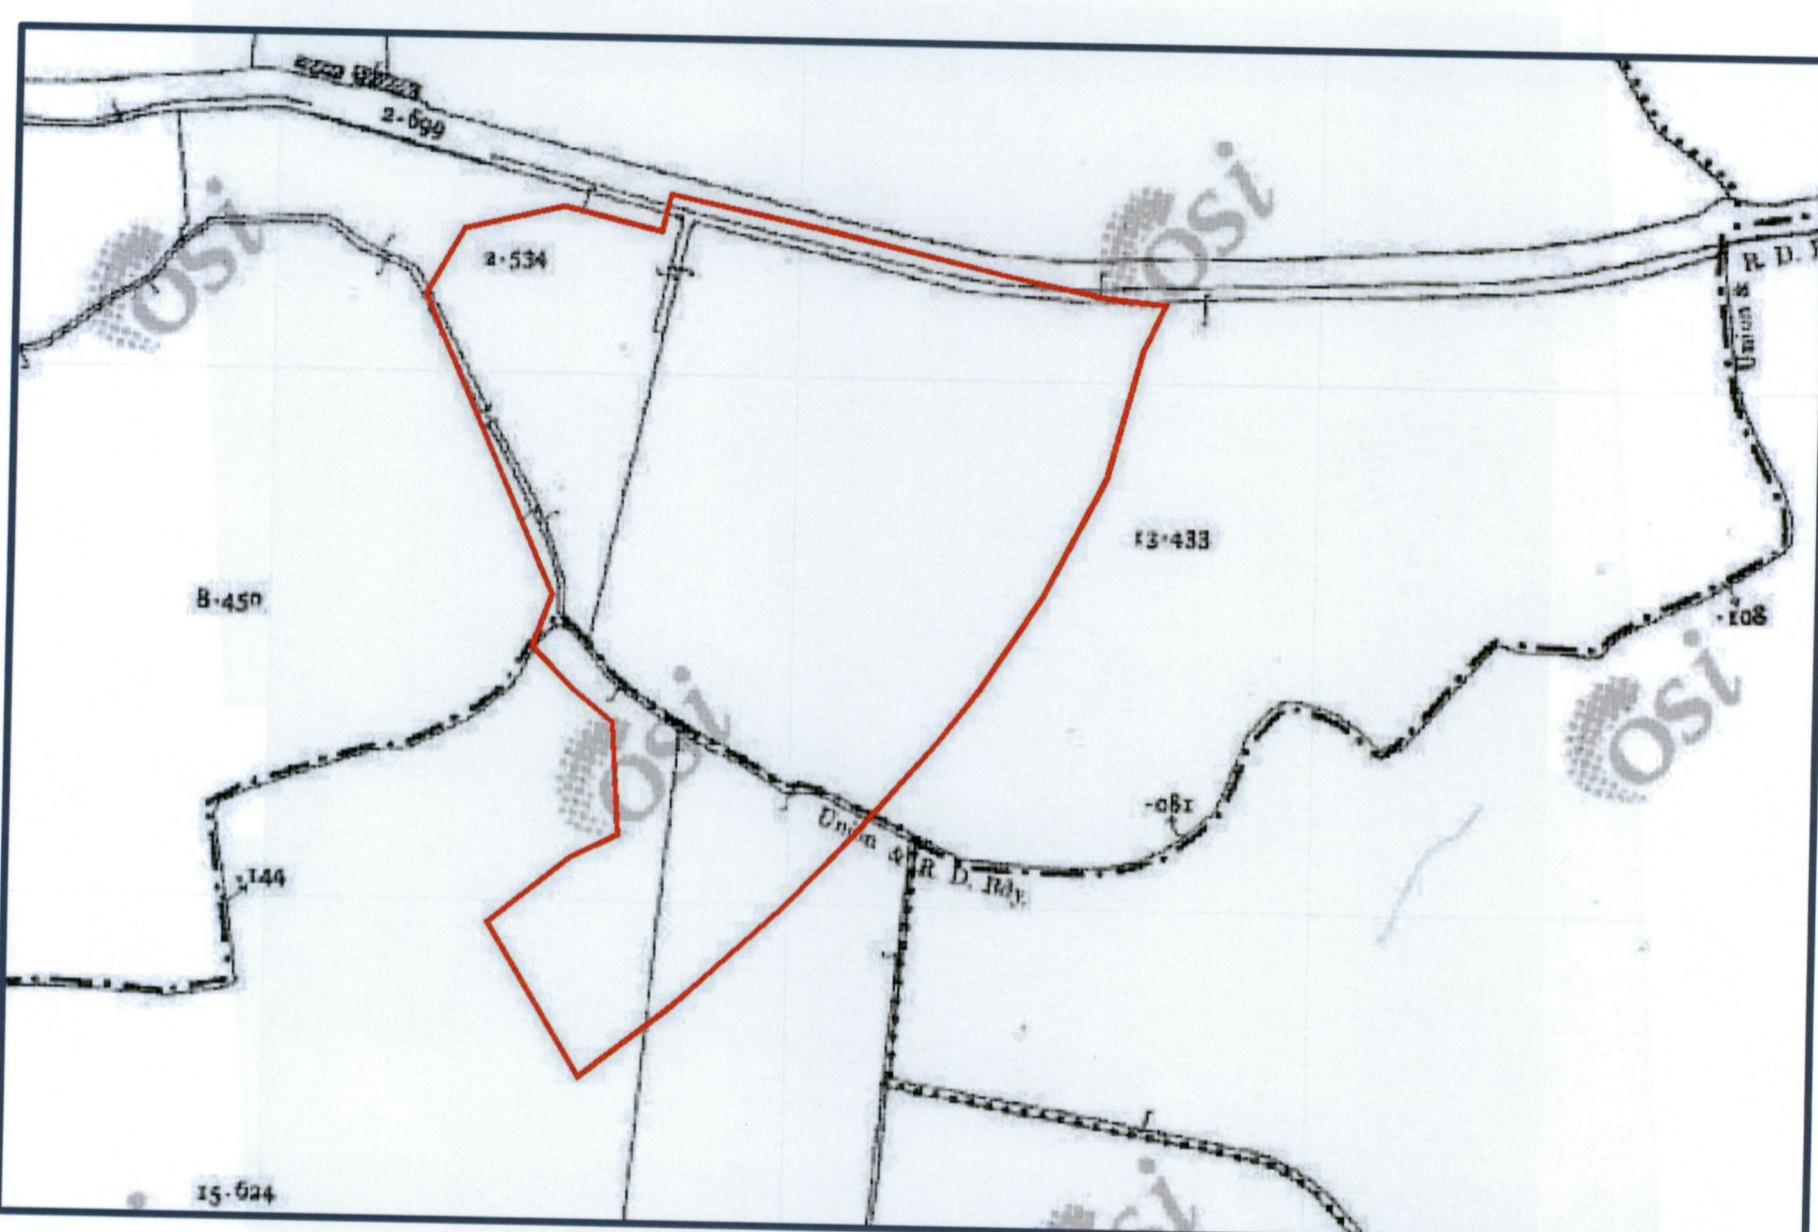


Figure 5-3 Historic OS Map

5.2 Flood Risk Indicators - Site Walkover

The Baldonell Stream ['the Stream'] crosses under the Park Road through a twin-pipe culvert, each pipe 1400mm diameter, and enters the Site close to its southern boundary.

The Baldonell Stream flows through the Site for approximately 45m and then exits the Site at its west boundary.

190m downstream of the Site the Stream flows through a short 600mm dia. culvert.

300m downstream of the Site, the Stream discharges to a long twin-pipe culvert. The inlet to this culvert is poorly constructed and hydraulically inefficient; it was observed that in addition to the pipes, the gaps between the pipes also provides a flow path for the stream to discharge to.

A visual assessment of the channel of the stream suggests the twin-pipe culvert will have a significantly lower hydraulic capacity than the channel.

Figure 5-8 Typical View of Stream Channel through Site



Proposed Industrial Development, DUB13, Profile Park, Grangecastle, Co. Dublin

Kilgallen and Partners

Vantage Data Centres Ltd.

Proposed Industrial Development, DUB13, Profile Park, Grangecastle, Co. Dublin

Kilgallen and Partners

Vantage Data Centres Ltd.



Figure 5-7 Typical Section of Stream Channel downstream of Site



Figure 5-8 Inlet to twin-pipe culvert

Accordingly, it is the conclusion of this SSFRA that detailed assessment of fluvial flood risk is appropriate.

The indicators described in Section 5.1 suggest the Site may be at risk of flooding caused by inadequate hydraulic culvert capacity. The Site Walkover suggests the Site is not at significant risk from fluvial flooding. However, downstream of the Site.

5.3 Initial Assessment

To meet the requirements of the Office of Public Works (OPW) for granting Section 50 approval under the Arterial Drainage Act, culverts are typically required to have a minimum 300mm clearance between the 1% AEP water level and the soffit of the culvert. Figure 6-3 shows the box culvert will have 650mm clearance between the 1% AEP water level and the soffit level, thus comfortably exceeding OPW requirements.

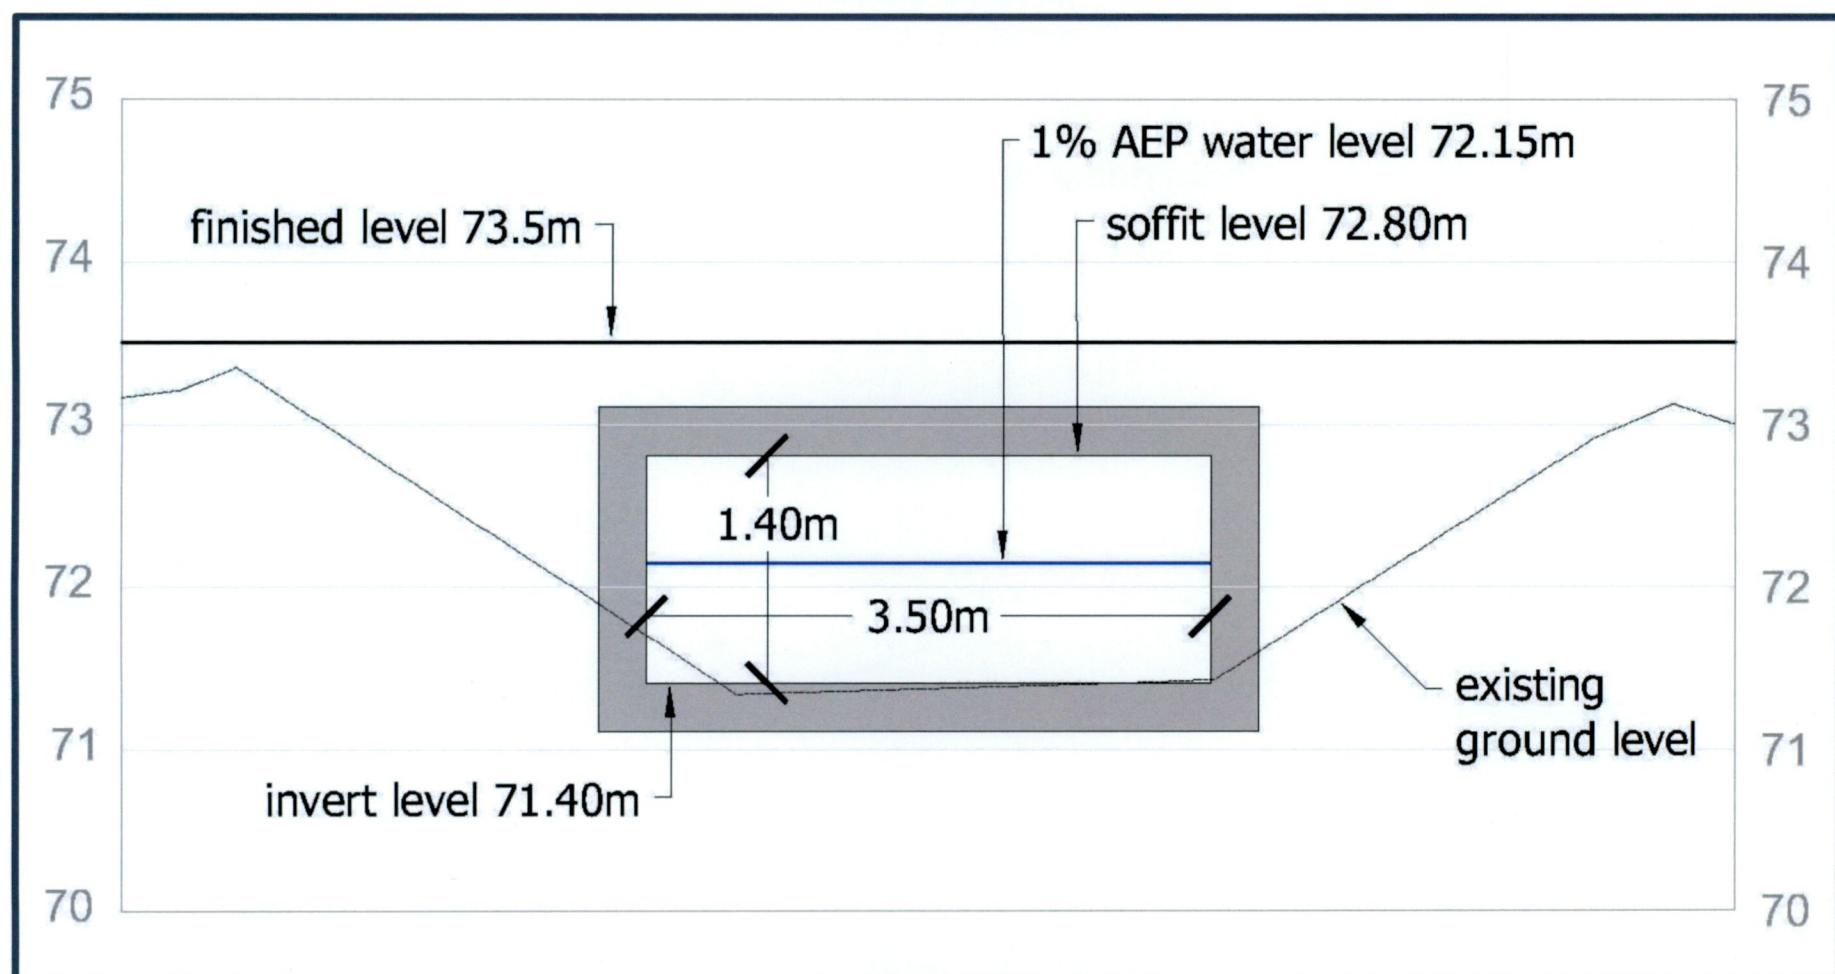


Figure 6-3 Fluvial flood risk zones - Pre-Development

6.5 Conclusion of Detailed Assessment of Fluvial Flood Risk

The proposed development will not be at risk of flooding from fluvial sources and will not give rise to fluvial flood risk elsewhere.

Report on Site-Specific Flood Risk Assessment

(v)


existing ground level.

A ground investigation at the Site encountered groundwater generally between 1.0m and 2.0m below

existing ground level.

(iv)

Ground Investigation

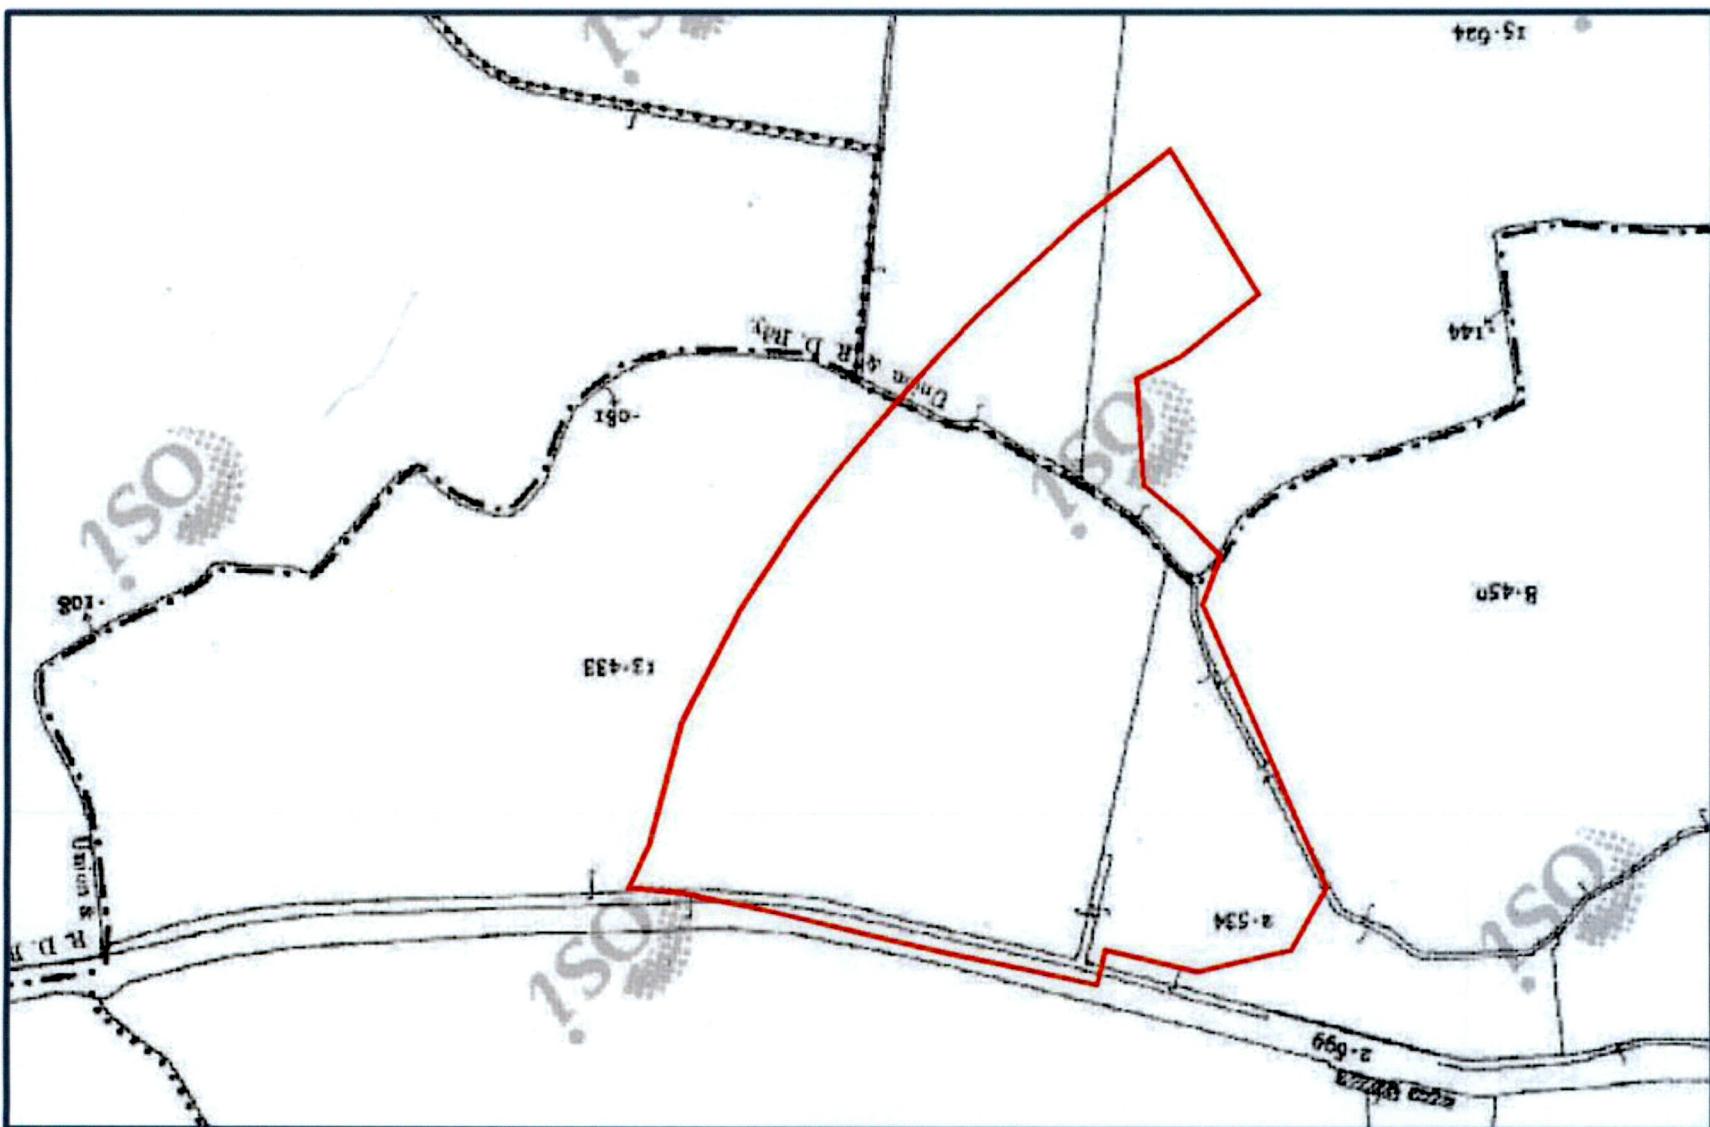Figure 7-1 Historic OS Mapping

for this well. There is no indication of springs at the Site.

Historical OS maps shows a well immediately northwest of the Site. No other information is available

for this well.

(iii)

Historical Ordnance Survey Mapping

permeability.

The portal indicates the Site to be in an area of high groundwater vulnerability with subsoils of low

permeability.

(ii)

The portal does not show any groundwater flooding at or in the vicinity of the Site.

The GSI maintains a web portal that provides data for Groundwater (<https://www.gsi.ie>), including

geological Survey of Ireland (GSI)

(ii)

evidence of flood events at the Site associated with fluctuations in groundwater level;

Records from the National Flood Hazard Mapping website maintained by the OPW do not contain any

OPW National Flood Hazard Mapping

(i)

Various datasets were interrogated for indicators of flood risk from Ground Water. These comprise:

Flood Risk Indicators - Desktop

(i)

7. FLOOD RISK FROM GROUNDWATER