























-  ASD Lighting HWD2-44K12 300-S4 1.81m in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted post top at zero degree inclination on 6m column. 12W connected load, averaged for CLO.
-  ASD Lighting HWD2-44K12 300-S4 1.81m and HWD2-44K04 200-N3 0.44m, both in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted on minimal outreach TEE bracket at zero degree inclination on 6m column. 12W and 4W each, connected load, averaged for CLO.
-  ASD Lighting HWD2-44K12 300-S4 1.81m in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted post top at zero degree inclination on 6m hinged column. 12W connected load, averaged for CLO.
-  Twin ASD Lighting HWD2-44K12 300-S4 1.81m in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted on minimal outreach TEE bracket at zero degree inclination on 6m hinged column. 12W connected load each, averaged for CLO.
-  ASD Lighting HWD2-44K04 400-N3 0.74m in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted post top at zero degree inclination on 6m hinged column. 6W connected load, averaged for CLO.
-  ASD Lighting HWD2-44K12 300-S4 1.73m in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted post top at zero degree inclination on 6m column. 12W connected load, averaged for CLO.
-  ASD Lighting HWD2-44K08 350-S4 1.38m in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted post top at zero degree inclination on 6m column. 10W connected load, averaged for CLO.
-  ASD Lighting HWD2-44K16 700-M2 3.95m in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted post top at zero degree inclination on 6m column. 33W connected load, averaged for CLO.
-  ASD Lighting HWD2-44K12 400-S4 2.29m in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted post top at zero degree inclination on 6m column. 15W connected load, averaged for CLO.
-  ASD Lighting HWD2-44K04 200-N3 0.44m in neutral white with 7 pin NEMA socket, DALI registered driver and CLO. Programmed to dim by 25% from 00:00 to 06:00. Mounted post top at zero degree inclination on 6m column. 4W connected load, averaged for CLO.
-  Mid pillar installed and fitted out in accordance with South Dublin County Council specifications and I.S. 10101: Latest version.
-  Management Mid pillar installed and fitted out in accordance with South Dublin County Council specifications and I.S. 10101: Latest version. Pillar and associated infrastructure will not be offered for taking in charge.
-  Cable access chamber constructed in accordance with South Dublin County Council specifications. Spare duct to be provided at each road crossing.
-  Ducts and cables to be laid in accordance with South Dublin County Council specifications and I.S. 10101: Latest version.
-  Columns and mid pillars shall not be located within 2m of ESB Customer service pillars.
-  Cables can share duct.
-  Cable joints are not permitted.
-  9M draw rope to be provided in each duct.
-  No element of public lighting can stand in, or pass under private property.



Be advised that other services may exist that are not shown on this drawing. This drawing should not be taken as definitive or an indication that it is safe to dig.

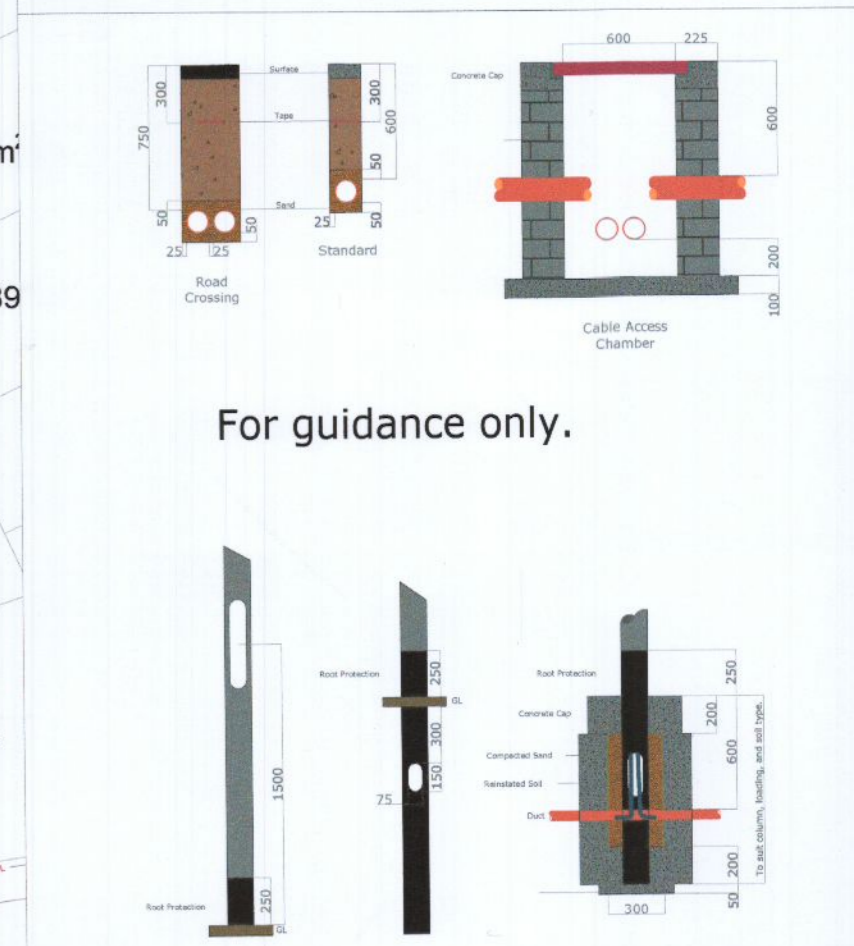Drawing title: Public Lighting Layout	
Project title: Clonburris, K1	
Client: Kelland Homes Ltd.	
Project number: 22047	Date: 15/11/22
Drawing number: 22047 - 1	Revision: B
Read in conjunction with associated lighting calculations	
Do not scale from drawing	All dimensions in metres
Document control: TD 09	Version: 1.0

Redmond Analytical Management Services Ltd.
 053 9231112 info@redmondams.ie www.redmondams.ie

