


Pedestrian Entrance Detail



Bicycle Entrance Detail

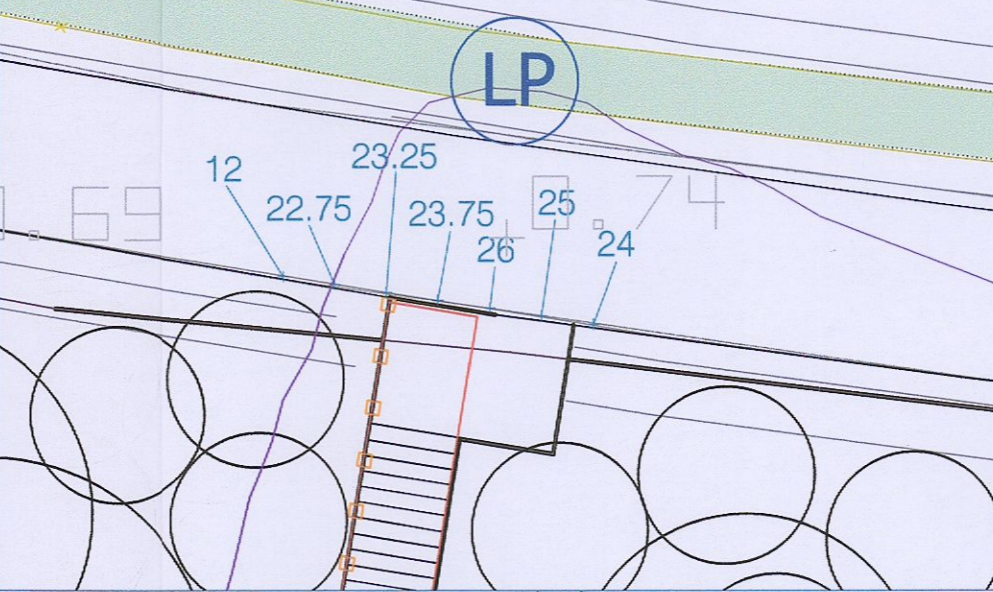

Paths & Parking Results - Horizontal Illuminance (lux)
 E_{min}/E_{avg} = 0.2
 E_{min}/E_{max} = 0.43
 E_{min}/E_{avg} = 0.02
 E_{min}/E_{max} = 0.01
 E_{min}/E_{avg} = 0.02

Bike Paths Results - Horizontal Illuminance (lux)
 E_{min}/E_{avg} = 0.02
 E_{min}/E_{max} = 0.01
 E_{min}/E_{avg} = 0.02

Isolines
 - 0.2 lux
 - 0.4 lux
 - 1 lux
 - 5 lux

Point Values
 - Calculated
 - Measured on site

wink
enhancing spaces with light

Ref	Fitting description
L1	LED 150W Projector
L2	LED 150W Flood Light & Street Light Luminaire
L3	LED 150W Flood Light Luminaire
L4	LED 150W Flood Light Luminaire
L5	LED 150W Flood Light Luminaire



Rev	Description	Date	Client
1	Proposal	19.12.22	- Clondalkin RFC
			- Kingswood
			- Project #: - 22112
			- Drawing: - Lux Levels
			- Drawn by: - COB