



- NOTES:**
- DO NOT SCALE. USE FIGURED DIMENSIONS ONLY.
  - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS.
  - IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT ALL WORKS ARE CONSTRUCTED IN ACCORDANCE WITH THE IRISH WATER CODE OF PRACTICE AND STANDARD DETAILS. THE CODE OF PRACTICE AND STANDARD DETAILS ARE AVAILABLE TO DOWNLOAD FROM THE IRISH WATER WEBSITE AT [WWW.WATER.IE/CONNECTIONS/DEVELOPER-SERVICES/](http://WWW.WATER.IE/CONNECTIONS/DEVELOPER-SERVICES/) WHERE THE DETAILS CONTAINED ON THIS DRAWING DIFFER FROM THE IRISH WATER CODE OF PRACTICE OR STANDARD DETAILS THIS MUST BE BROUGHT TO THE ATTENTION OF THE ENGINEER IMMEDIATELY. IRISH WATER STANDARDS WILL TAKE PRECEDENCE.

**NOTES:**

ALL PROPOSED PUBLIC STORM WATER DRAINAGE WORKS TO BE IN ACCORDANCE WITH FINCH COUNTY COUNCIL'S REQUIREMENTS FOR TAKING IN CHARGE AND IN ACCORDANCE WITH THE GREATER DUBLIN REGIONAL CODE OF PRACTICE FOR DRAINAGE WORKS.

ALL PROPOSED PUBLIC FOUL WATER DRAINAGE WORKS TO BE IN ACCORDANCE WITH IRISH WATER REQUIREMENTS.

ALL PRIVATE DRAINAGE WORKS SHALL BE IN ACCORDANCE WITH THE BUILDING REGULATIONS PART H.

ALL COVER LEVELS ARE INDICATIVE ONLY AND SHOULD BE SET TO SUIT THE FINISHED ROAD OR PAVED LEVEL. LEVELS IN REAR GARDENS HAVE BEEN ASSUMED AS STRAIGHT GRADE TO ADJACENT BOUNDARY FROM FFL - 150mm. EXTERNAL LEVELS TO BE CONFIRMED BY ARCHITECT

**GRAVITY SEWER PIPE MATERIAL TYPES**

WASTEWATER PIPE MATERIALS SHALL BE IN ACCORDANCE WITH SECTION 3.13 OF THE IRISH WATER CODE OF PRACTICE FOR WASTEWATER INFRASTRUCTURE.

THE TYPES AND FITTINGS OUTLINED HEREIN SHALL BE USED IN THE CONSTRUCTION OF THE GRAVITY SEWERS. PIPE MATERIAL SHOULD NOT CHANGE BETWEEN MANHOLES. THE LIST BELOW DOES NOT APPLY TO PIPES INSTALLED BY PIPE JACKING OR MICRO TUNNELLING.

**CONCRETE:** CONCRETE SEWER PIPES WITH SPIGOT AND SOCKET JOINTS AND RUBBER RING FITTINGS SHALL COMPLY WITH IS EN 1916 (2002), BS 5911, PART 1 (2002 - 2010) AND IS 6 (2004) OR EQUIVALENT STANDARDS, STRENGTH CLASS 120 WITH MINIMUM CRUSHING LOADS IN ACCORDANCE WITH TABLE 6 OF BS 5911-1 (2002/2010).

ALL PIPES AND FITTINGS SHALL HAVE GASKET TYPE JOINTS OF SPIGOT AND SOCKET OR REBATED FORM (PIPE DIAMETERS 225MM AND ABOVE).

**THERMOPLASTIC STRUCTURED WALL PIPES:** THERMOPLASTIC STRUCTURED WALL PIPES SHALL COMPLY WITH THE PROVISIONS OF IS EN 13476 (2007/2009). PIPES TO BE OF STIFFNESS CLASS B8/M/2 AND TO BE CAPABLE OF DEMONSTRATING A JETTING RESISTANCE OF 2,800 PSI (180 BAR) WITHOUT DAMAGE WHEN TESTED IN ACCORDANCE WITH SECTION 3.3 OF WS 4-35-01 (2008). (SEWER DIAMETERS 150MM UP TO 450MM, SERVICE CONNECTIONS OF 100MM DIAMETER).

**UNPLASTICISED PVC:** UNPLASTICISED PVC PIPES AND FITTINGS SHALL COMPLY WITH THE PROVISIONS IN EN 1401 2009/2012. PIPES TO BE APPLICATION AREA CODE 'UD', STIFFNESS CLASS B8/M/2. PROVISION FOR JETTING SHALL BE BASED ON THE WRG SEWER JETTING CODE OF PRACTICE, JUNE 1997. PIPES TO BE CAPABLE OF RESISTING A MAXIMUM JETTING PUMP PRESSURE OF 2,800PSI (180 BAR) WITHOUT DAMAGE. (SEWER DIAMETERS 150MM UP TO 450MM, SERVICE CONNECTIONS OF 100MM DIAMETER).


**OTHER:** THE USE OF ALTERNATIVE PIPE TYPES AND MATERIALS WILL REQUIRE THE PRIOR WRITTEN AGREEMENT OF IRISH WATER.

WHERE 1.2m COVER TO FOUL WATER PIPE SOFFIT IS NOT ACHIEVABLE IN ROADWAYS, CONCRETE SURROUND SHALL BE PROVIDED IN ACCORDANCE WITH STD-WW-06 OF WASTEWATER INFRASTRUCTURE STANDARD DETAILS.

**SERVICE LAYOUT DISTANCES:** HORIZONTAL AND VERTICAL SERVICE LAYOUT DISTANCES SHALL BE AS PER IRISH WATER STANDARD DETAIL STD-WW-05.

THE EXTERNAL FACE OF MANHOLES SHALL BE AT LEAST 0.5m FROM KERB LINE.

**RESTRICTIONS ON PLANTING:** PLANTING ADJACENT TO WASTEWATER INFRASTRUCTURE SHALL BE IN COMPLIANCE WITH IRISH WATER STANDARD DETAILS STD-WW-06 AND STD-WW-06A.

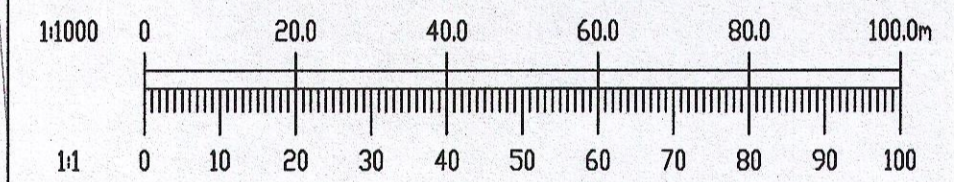

Ordnance Survey Ireland Licence No. EN 0006023 © Ordnance Survey Ireland/Government of Ireland.

A	05/12/22	REVISED TO SUIT COMMENTS FROM IRISH WATER	NS	RM
REV. DATE		AMENDMENT	DRN	APPD

STATUS **PLANNING**

**Waterman Moylan**  
Engineering Consultants

BLOCK 5, EASTPOINT BUSINESS PARK, ALPIE BYRNE ROAD, DUBLIN D03 K7W7 (IRELAND)  
Tel: (01) 664 8900 Fax: (01) 661 3618  
Email: info@waterman-moylan.ie www.waterman-moylan.ie

CLIENT **QUINTAN**  
ARCHITECT **BKD ARCHITECTS**

PROJECT **CLONBURRIS**

TITLE **DRAINAGE GENERAL ARRANGEMENT**

DRAWN MS	DESIGNED RM	APPROVED MD	DATE JAN 2023
SCALE 1:1000 @ A1	JOB NO. 21-055	DRG. NO. P1200	REVISION A

**NOTE:**  
CONTRACTOR TO VERIFY ON SITE EXISTING INFRASTRUCTURE DEPTHS AT ALL PROPOSED CROSSING POINTS TO ENSURE SUITABLE INFRASTRUCTURE SEPARATION DISTANCES CAN BE ACHIEVED IN ACCORDANCE WITH IRISH WATER CODE OF PRACTICE AND STANDARD DETAIL REQUIREMENTS.

**NOTE:**  
1. CONTRACTOR TO ALLOW FOR 100mm DIAMETER UPVC DRAINS BETWEEN PROPERTY AJS AND STORM/FOUL COLLECTOR DRAINS. MINIMUM FALL 1:40 BETWEEN AJ AND COLLECTOR DRAIN.  
2. 100mm FILTER DRAIN AND FREE DRAINING STONE TO BE ALLOWED FOR AT ALL BOUNDARY RETAINING WALLS, ALLOW 1 CHAMBER PER 20m OF FILTER DRAIN AND CONNECTION LENGTH TO NEAREST STORM NETWORK