
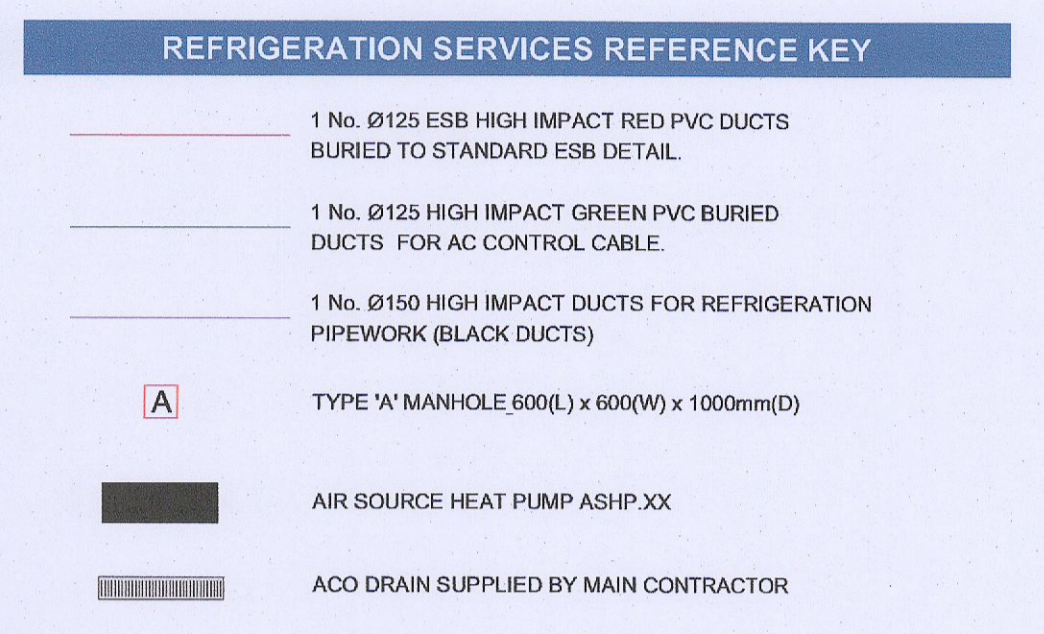
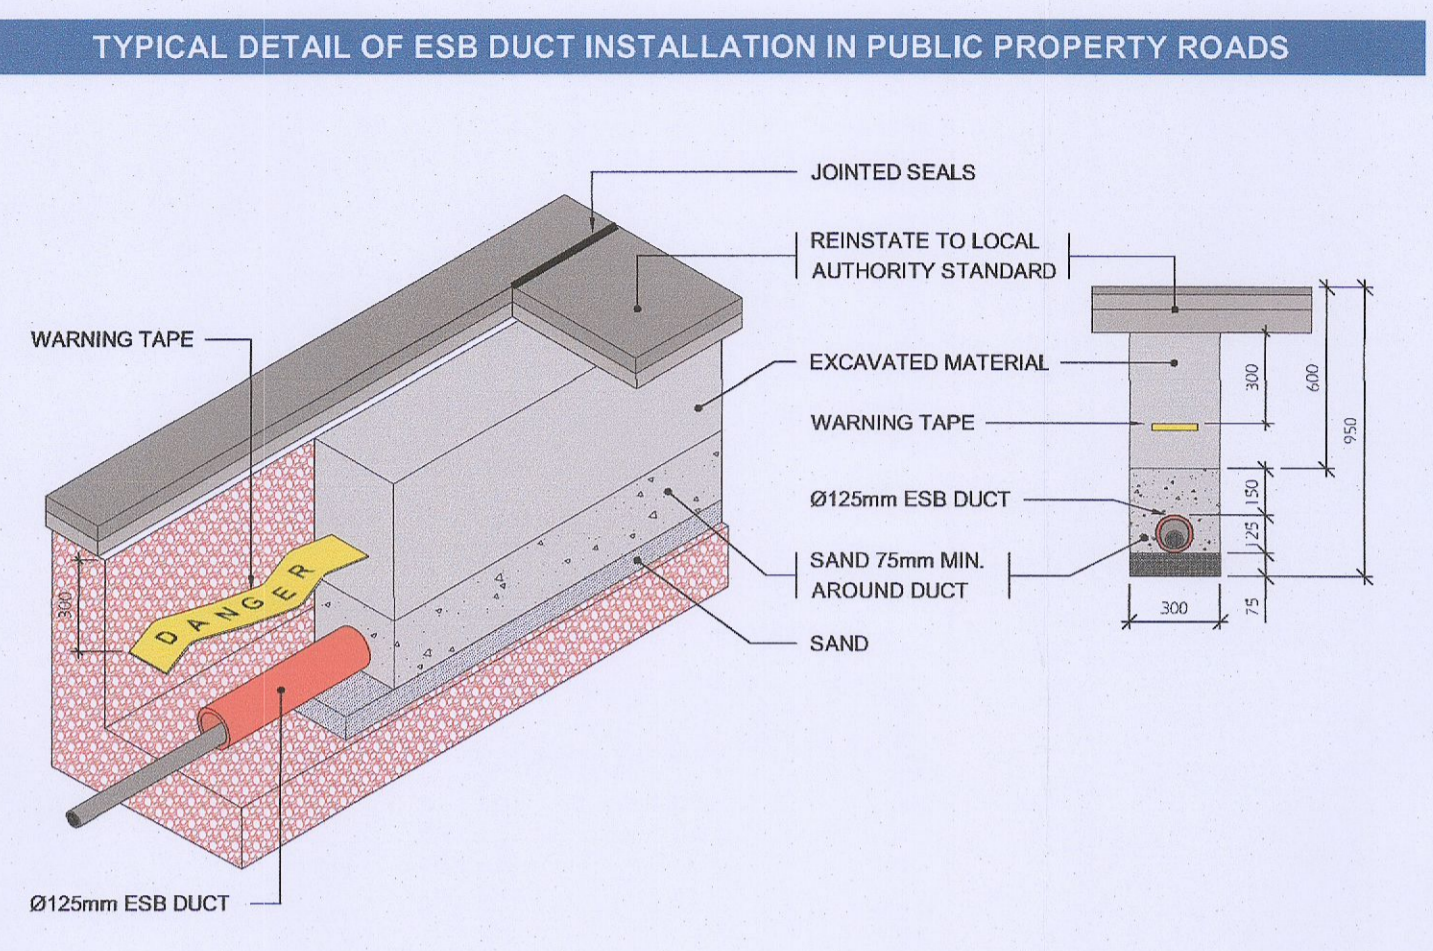
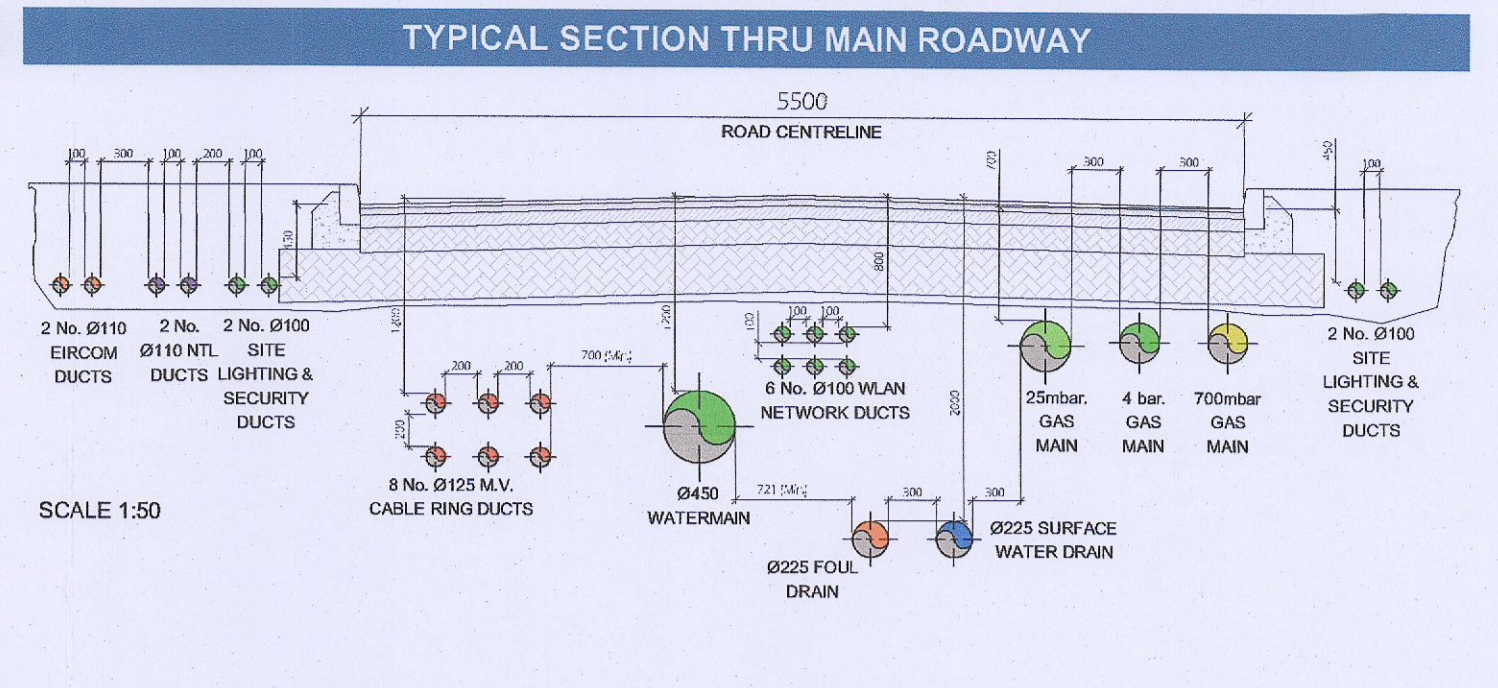



ALL HEATING PIPEWORK & CONTROL CABLES TO BE ROUTED WITHIN BELOW GROUND FROM PLANTROOM TO EXTERNAL COMPOUND  
 2No. Ø150mm BLACK PRE INSULATED UNDERGROUND HEATING PIPEWORK WITH LEAK DETECTION  
 1No. Ø125mm GREEN UNDERGROUND CONTROL CABLE DUCT  
 1No. Ø125mm RED UNDERGROUND ELECTRICAL DUCT  
 1No. Ø125mm RED UNDERGROUND ELECTRICAL DUCT TO SERVE OUTDOOR HEAT PUMP COMPOUND

PROPOSED LOCATION OF AIR SOURCE HEAT PUMP ASHP 01  
 HEAT PUMP DIMENSIONS: 3,200mm(L)x1,100mm(W)x1,740mm (H)  
 COMPOUND AREA REQUIRED: 22m²  
 WEIGHT: 859kg.

MAIN CONTRACTOR SHALL INCLUDE FOR SUPPLY INSTALLATION OF ACO DRAINS TO AC COMPOUND.  
 DIMENSIONS: 6,200mm(L) x 4,100mm(W).  
 PROPOSED LOCATION OF EXTERNAL COMPOUND. MAIN CONTRACTOR SHALL INCLUDE FOR CONCRETE PLINTH AND SECURITY FENCING.

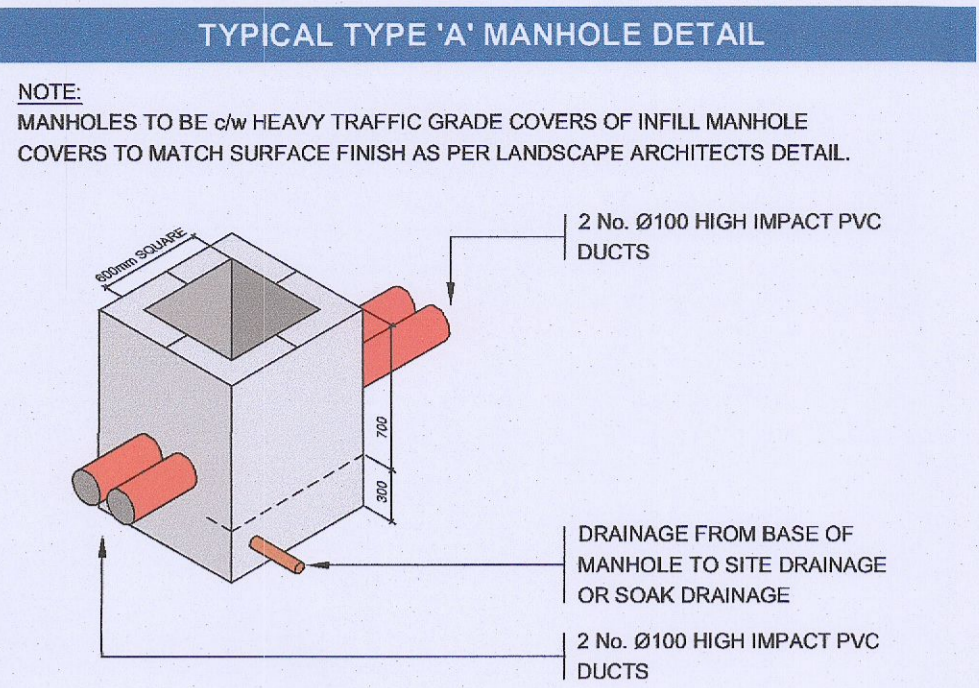

NOTE: THIS DRAWING IS FOR COORDINATION INFORMATION ONLY. PLEASE REFER TO CIVIL ENGINEER DRAWINGS FOR CIVIL ENGINEERING TENDER INFORMATION.

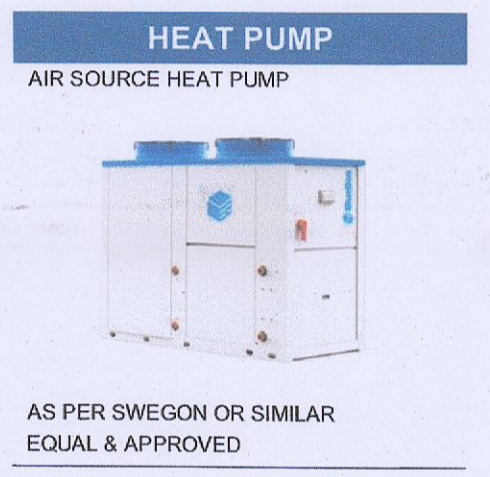

STATUS	DATE	DESCRIPTION	DRN	ENG	APP	REV
S2	03.03.2023	UPDATE TO PLANT EQUIPMENT	DM	SM	CD	P02
S2	14.07.2021	PRELIMINARY STAGE ISSUE	FL	SM	CD	P01

