


ON ORIGINAL

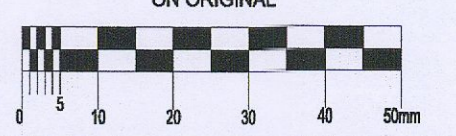

© COPYRIGHT OF THIS DRAWING IS RESERVED BY DBFL CONSULTING ENGINEERS. NO PART SHALL BE REPRODUCED OR TRANSMITTED WITHOUT THEIR WRITTEN PERMISSION.

NO CHANGES OF WHATSOEVER NATURE ARE TO BE MADE TO ANY DETAILS SET OUT OR CONTAINED IN ANY DBFL SPECIFICATIONS OR DRAWINGS UNLESS THE EXPRESS CONSENT HAS BEEN OBTAINED IN ADVANCE, IN WRITING, FROM DBFL.

NOTES:

GENERAL NOTES:

1. ALL DRAWINGS TO BE CHECKED BY CONTRACTOR ON SITE AND ENGINEER INFORMED OF DISCREPANCIES BEFORE WORK COMMENCES.
2. THE CONTRACTOR SHALL SATISFY HIMSELF AS TO THE ACCURACY OF EXISTING DRAINAGE LEVELS AND LOCATION OF EXISTING SERVICES ON SITE PRIOR TO COMMENCEMENT OF WORKS ON SITE.
3. ALL DIMENSIONS AND LEVELS ARE IN METERS AND ARE RELATED TO ORDINANCE DATUM. CO-ORDINATES RELATE TO IRISH NATIONAL GRID.
4. ALL WATERMANS VALVES AND FITTINGS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE IRISH WATER STANDARD DETAILS AND IRISH WATER CODE OF PRACTICE FOR WATER INFRASTRUCTURE.
5. ALL WATERMANS SHALL BE HDPE, PE100, SDR17 TO IS EN 12201 PART 22011 AND IS EN 12201-3:2011.
6. CONNECTION BETWEEN EXISTING AND PROPOSED WATERMANS TO BE CARRIED OUT IN ACCORDANCE WITH IRISH WATER STANDARD DETAILS STD-W-03 TO STD-W-10.
7. ANCHOR BLOCKS TO BE POSITIONED AT DEAD ENDS, TEES, BENDS AND AT EACH SIDE OF HYDRANTS AND VALVES IN ACCORDANCE WITH THE REQUIREMENTS OF IRISH WATER STANDARD DETAIL STD-W-28 WATER MAIN TRUST AND SUPPORT BLOCKS DISMANTLING JOINTS TO BE INSTALLED AT EACH SLUCE VALVE AS PER IRISH WATER STANDARD DETAIL STD-W-16.
8. CONNECTION TO INDIVIDUAL HOUSES IN ACCORDANCE WITH IRISH WATER STD-W-23.
9. INSTALLATION OF SLUCE VALVES, AIR VALVES AND HYDRANTS SHALL BE IN ACCORDANCE WITH IRISH WATER STANDARD DETAILS STD-W-14 TO STD-W-23.
10. MARKER POSTS AND PLATES ARE TO BE PROVIDED IN ACCORDANCE WITH IRISH WATER STANDARD DETAIL STD-W-27.
11. CONNECTION TO EXISTING WATERMANS TO BE COORDINATED BY THE CONTRACTOR WITH IRISH WATER AND/OR THE LOCAL AUTHORITY.
12. CONTRACTOR TO LIASE WITH IRISH WATER AND / OR THE LOCAL AUTHORITY AS REQUIRED REGARDING TESTING, CLEANSING AND STERILISATION OF WATERMANS.
13. WATERMANS TO BE PRESSURE TESTED IN ACCORDANCE WITH THE REQUIREMENTS OF IRISH WATER AND ICA 4.01.03. GUIDE TO TESTING OF PRESSURE PIPES AND FITTINGS FOR USE BY PUBLIC WATER SUPPLIERS, OCTOBER 2015. A FORMAL TEST REPORT SHALL BE SUBMITTED TO THE ENGINEER DETAILING THE TEST CARRIED OUT.
14. METERS FOR APARTMENTS OR SIMILAR PROPERTIES WILL BE INSTALLED INTERNALLY WITHIN THE PREMISES IN ACCORDANCE WITH THE BUILDING CONTROL AUTHORITY REQUIREMENTS AND SUBJECT TO REVIEW BY IRISH WATER.

LEGEND

- SITE BOUNDARY
- - - EXISTING WATERMAIN CONSTRUCTED AS PART OF SEPARATE CONTRACT
- - - PROPOSED Ø180mm OD PE 100 SDR17 WATERMAIN
- - - PROPOSED Ø125mm OD PE 100 SDR17 WATERMAIN
- PROPOSED WATER METER
- PROPOSED SLUCE VALVE (W STD-W-14/ STD-W-15)
- PROPOSED HYDRANT (W STD-W-18/ STD-W-19)
- BOUNDARY BOX AND 200mm OD PE80 SERVICE CONNECTION (W STD-W-03)
- GNI WAYLEAVE

| | | | | |
|-----|----------|---------------------|-----|-------|
| 1 | 07-07-23 | FURTHER INFORMATION | RMC | DCB |
| 0 | 13-12-22 | ISSUED FOR PLANNING | RMC | DCB |
| rev | date | description | by | chkd. |

STATUS CODES
purpose acceptance
P3 - PLANNING PERMISSION S - ISSUED

DBFL Consulting Engineers
Civil, Structural & Transportation Engineering
www.dbfl.ie

DUBLIN OFFICE: Ormeau House, Upper Ormeau Quay, Dublin 7, D07 W9H4
PHONE: +353 1 460 4000
CORKE OFFICE: 14 South Mall, Cork, T12 C191
PHONE: +353 21 504688
WATERFORD OFFICE: Suite 10 The Arcade, Maritime Quay, Canalside Street, Waterford, X91 W628
PHONE: +353 51 309 500

project ref.
CLONBURRIS T2

drawing title
WATERMAIN LAYOUT

client
CAIRN HOMES

| | | | |
|----------------------------------|----------|-------|------------|
| designed by | author | scale | sheet size |
| DCB | RMC | 1:500 | A1 |
| drawing no. | revision | | |
| CLB-1B-93-SW-DTM-DR-DBFL-CE-1001 | 1 | | |

